


# Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

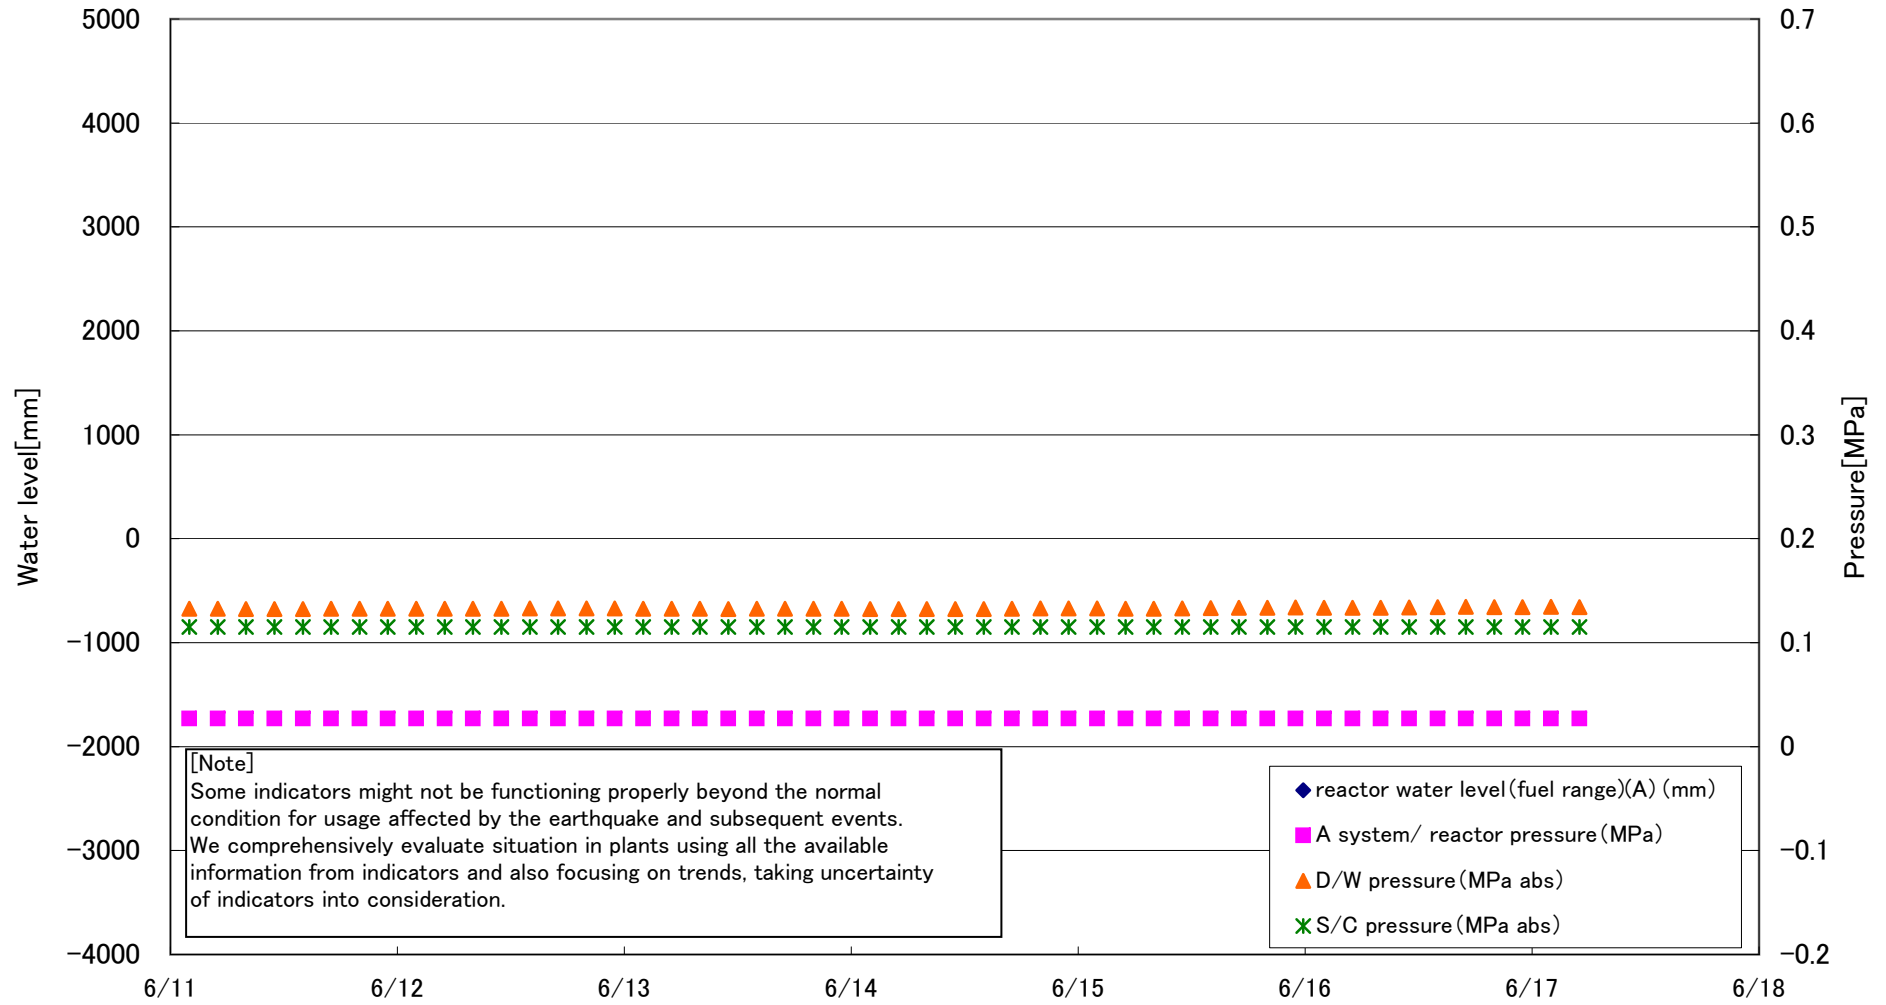

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level (fuel range)(A) (mm) | reactor water level (fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | note |
|------------|--|--|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|------|
| 6/11 2:00  |  | -1650                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 2.46E+02           | 8.21E-01           | 8.41E-01           |      |
| 6/11 5:00  |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 9.11E+01           | 8.20E-01           | 8.41E-01           |      |
| 6/11 8:00  |  | -1700                                    | 0.027                            | -                                | 0.1324                 | 0.115                  | 0.00E+00           | 6.50E+01           | 8.19E-01           | 8.40E-01           |      |
| 6/11 11:00 |  | -1700                                    | 0.027                            | -                                | 0.1324                 | 0.115                  | 0.00E+00           | 3.14E+01           | 8.19E-01           | 8.40E-01           |      |
| 6/11 14:00 |  | -1700                                    | 0.027                            | -                                | 0.1323                 | 0.115                  | 0.00E+00           | 9.17E+01           | 8.19E-01           | 8.40E-01           |      |
| 6/11 17:00 |  | -1700                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 3.46E+01           | 8.18E-01           | 8.39E-01           |      |
| 6/11 20:00 |  | -1700                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 7.30E+01           | 8.18E-01           | 8.39E-01           |      |
| 6/11 23:00 |  | -1700                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 6.10E+01           | 8.17E-01           | 8.38E-01           |      |
| 6/12 2:00  |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.60E+02           | 8.17E-01           | 8.39E-01           |      |
| 6/12 5:00  |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.51E+02           | 8.17E-01           | 8.37E-01           |      |
| 6/12 8:00  |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.56E+02           | 8.16E-01           | 8.37E-01           |      |
| 6/12 11:00 |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.61E+02           | 8.16E-01           | 8.38E-01           |      |
| 6/12 14:00 |  | -1650                                    | 0.027                            | -                                | 0.1328                 | 0.115                  | 0.00E+00           | 2.98E+01           | 8.16E-01           | 8.38E-01           |      |
| 6/12 17:00 |  | -1700                                    | 0.027                            | -                                | 0.1330                 | 0.115                  | 0.00E+00           | 2.71E+01           | 8.15E-01           | 8.36E-01           |      |
| 6/12 20:00 |  | -1700                                    | 0.027                            | -                                | 0.1329                 | 0.115                  | 0.00E+00           | 2.43E+02           | 8.15E-01           | 8.35E-01           |      |
| 6/12 23:00 |  | -1700                                    | 0.027                            | -                                | 0.1329                 | 0.115                  | 0.00E+00           | 2.94E+01           | 8.14E-01           | 8.34E-01           |      |
| 6/13 2:00  |  | -1700                                    | 0.027                            | -                                | 0.1327                 | 0.115                  | 0.00E+00           | 3.30E+01           | 8.14E-01           | 8.36E-01           |      |
| 6/13 5:00  |  | -1700                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 1.02E+02           | 8.13E-01           | 8.35E-01           |      |
| 6/13 8:00  |  | -1750                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.73E+01           | 8.12E-01           | 8.34E-01           |      |
| 6/13 11:00 |  | -1700                                    | 0.027                            | -                                | 0.1324                 | 0.115                  | 0.00E+00           | 2.28E+02           | 8.12E-01           | 8.34E-01           |      |
| 6/13 14:00 |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.52E+02           | 8.11E-01           | 8.33E-01           |      |
| 6/13 17:00 |  | -1650                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 5.10E+01           | 8.11E-01           | 8.32E-01           |      |
| 6/13 20:00 |  | -1700                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 5.06E+01           | 8.10E-01           | 8.32E-01           |      |
| 6/13 23:00 |  | -1700                                    | 0.027                            | -                                | 0.1325                 | 0.115                  | 0.00E+00           | 2.54E+01           | 8.10E-01           | 8.33E-01           |      |
| 6/14 2:00  |  | -1700                                    | 0.027                            | -                                | 0.1324                 | 0.115                  | 0.00E+00           | 3.14E+01           | 8.10E-01           | 8.31E-01           |      |
| 6/14 5:00  |  | -1700                                    | 0.027                            | -                                | 0.1323                 | 0.115                  | 0.00E+00           | 3.95E+01           | 8.09E-01           | 8.31E-01           |      |
| 6/14 8:00  |  | -1700                                    | 0.027                            | -                                | 0.1323                 | 0.115                  | 0.00E+00           | 2.69E+02           | 8.08E-01           | 8.30E-01           |      |
| 6/14 11:00 |  | -1700                                    | 0.027                            | -                                | 0.1323                 | 0.115                  | 0.00E+00           | 2.81E+01           | 8.08E-01           | 8.30E-01           |      |
| 6/14 14:00 |  | -1700                                    | 0.027                            | -                                | 0.1324                 | 0.115                  | 0.00E+00           | 4.06E+01           | 8.08E-01           | 8.29E-01           |      |
| 6/14 17:00 |  | -1650                                    | 0.027                            | -                                | 0.1326                 | 0.115                  | 0.00E+00           | 2.59E+02           | 8.07E-01           | 8.29E-01           |      |
| 6/14 20:00 |  | -1650                                    | 0.027                            | -                                | 0.1328                 | 0.115                  | 0.00E+00           | 2.55E+02           | 8.07E-01           | 8.29E-01           |      |
| 6/14 23:00 |  | -1700                                    | 0.027                            | -                                | 0.1328                 | 0.115                  | 0.00E+00           | 2.64E+02           | 8.07E-01           | 8.27E-01           |      |
| 6/15 2:00  |  | -1700                                    | 0.027                            | -                                | 0.1328                 | 0.115                  | 0.00E+00           | 2.62E+02           | 8.06E-01           | 8.27E-01           |      |
| 6/15 5:00  |  | -1700                                    | 0.027                            | -                                | 0.1327                 | 0.115                  | 0.00E+00           | 1.62E+02           | 8.06E-01           | 8.26E-01           |      |
| 6/15 8:00  |  | -1700                                    | 0.027                            | -                                | 0.1327                 | 0.115                  | 0.00E+00           | 2.53E+01           | 8.06E-01           | 8.27E-01           |      |
| 6/15 11:00 |  | -1700                                    | 0.027                            | -                                | 0.1329                 | 0.115                  | 0.00E+00           | 2.76E+01           | 8.06E-01           | 8.27E-01           |      |
| 6/15 14:00 |  | -1650                                    | 0.027                            | -                                | 0.1332                 | 0.115                  | 0.00E+00           | 3.26E+01           | 8.05E-01           | 8.26E-01           |      |
| 6/15 17:00 |  | -1600                                    | 0.027                            | -                                | 0.1337                 | 0.115                  | 0.00E+00           | 3.13E+01           | 8.05E-01           | 8.26E-01           |      |
| 6/15 20:00 |  | -1600                                    | 0.027                            | -                                | 0.1337                 | 0.115                  | 0.00E+00           | 4.59E+01           | 8.04E-01           | 8.27E-01           |      |
| 6/15 23:00 |  | -1600                                    | 0.027                            | -                                | 0.1338                 | 0.115                  | 0.00E+00           | 5.51E+01           | 8.04E-01           | 8.25E-01           |      |
| 6/16 2:00  |  | -1600                                    | 0.027                            | -                                | 0.1337                 | 0.115                  | 0.00E+00           | 1.37E+02           | 8.04E-01           | 8.24E-01           |      |
| 6/16 5:00  |  | -1600                                    | 0.027                            | -                                | 0.1337                 | 0.115                  | 0.00E+00           | 1.45E+02           | 8.03E-01           | 8.25E-01           |      |
| 6/16 8:00  |  | -1600                                    | 0.027                            | -                                | 0.1337                 | 0.115                  | 0.00E+00           | 2.58E+02           | 8.03E-01           | 8.24E-01           |      |
| 6/16 11:00 |  | -1600                                    | 0.027                            | -                                | 0.1338                 | 0.115                  | 0.00E+00           | 2.63E+02           | 8.02E-01           | 8.26E-01           |      |
| 6/16 14:00 |  | -1600                                    | 0.027                            | -                                | 0.1342                 | 0.115                  | 0.00E+00           | 3.41E+01           | 8.02E-01           | 8.24E-01           |      |
| 6/16 17:00 |  | -1600                                    | 0.027                            | -                                | 0.1344                 | 0.115                  | 0.00E+00           | 3.46E+01           | 8.01E-01           | 8.23E-01           |      |
| 6/16 20:00 |  | -1600                                    | 0.027                            | -                                | 0.1343                 | 0.115                  | 0.00E+00           | 2.91E+02           | 8.01E-01           | 8.23E-01           |      |
| 6/16 23:00 |  | -1600                                    | 0.027                            | -                                | 0.1343                 | 0.115                  | 0.00E+00           | 4.84E+01           | 8.01E-01           | 8.24E-01           |      |
| 6/17 2:00  |  | -1650                                    | 0.027                            | -                                | 0.1345                 | 0.115                  | 0.00E+00           | 5.32E+01           | 8.00E-01           | 8.23E-01           |      |
| 6/17 5:00  |  | -1650                                    | 0.027                            | -                                | 0.1343                 | 0.115                  | 0.00E+00           | 3.96E+01           | 7.99E-01           | 8.22E-01           |      |

DS

measurement measurement  
 instrument instrument  
 malfunction malfunction