


# Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

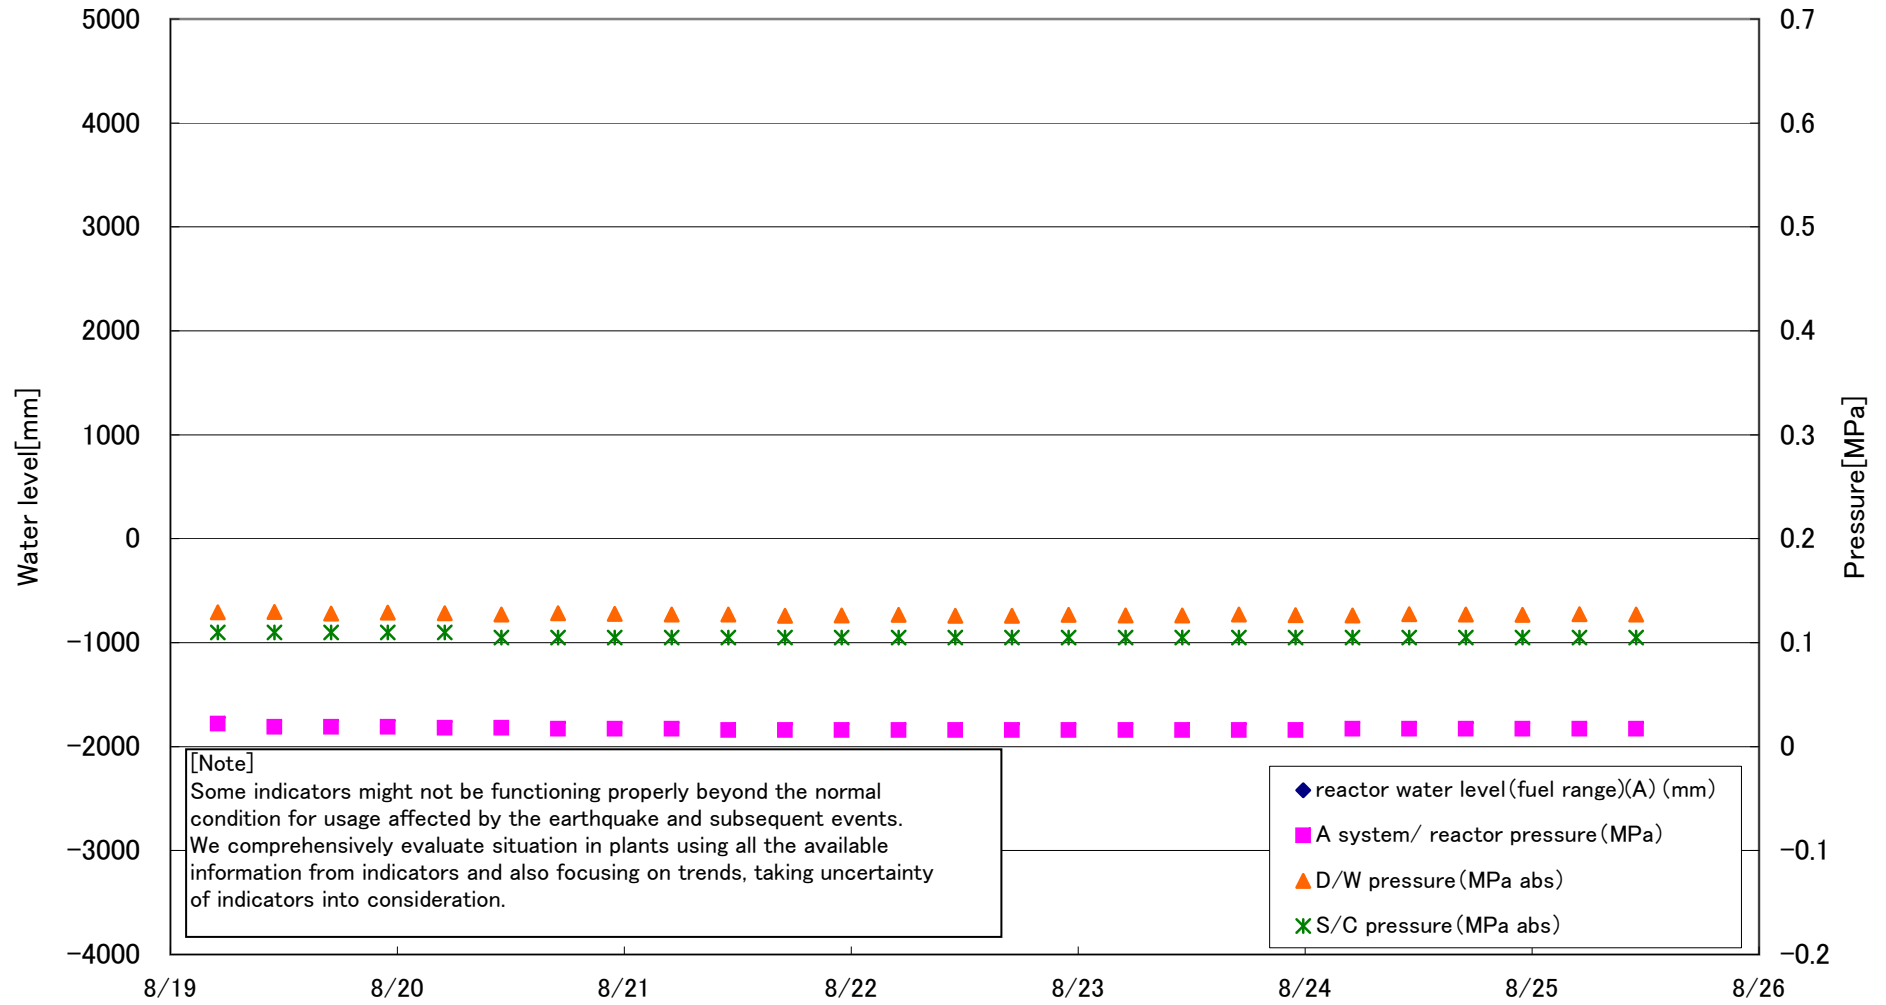

## Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level(fuel range)(A) (mm) | reactor water level(fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | note |
|------------|---|---|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|------|
| 8/19 5:00  |   | -1700                                   | 0.022                            | -                                | 0.1293                 | 0.110                  | 0.00E+00           | 3.06E+01           | 6.86E-01           | 6.97E-01           |      |
| 8/19 11:00 |   | -1700                                   | 0.019                            | -                                | 0.1295                 | 0.110                  | 0.00E+00           | 7.77E+01           | 6.87E-01           | 6.98E-01           |      |
| 8/19 17:00 |   | -1700                                   | 0.019                            | -                                | 0.1280                 | 0.110                  | 0.00E+00           | 4.33E+02           | 6.86E-01           | 7.01E-01           |      |
| 8/19 23:00 |   | -1700                                   | 0.019                            | -                                | 0.1288                 | 0.110                  | 0.00E+00           | 3.35E+02           | 6.86E-01           | 6.96E-01           |      |
| 8/20 5:00  |   | -1700                                   | 0.018                            | -                                | 0.1284                 | 0.110                  | 0.00E+00           | 1.15E+02           | 6.86E-01           | 6.96E-01           |      |
| 8/20 11:00 |   | -1650                                   | 0.018                            | -                                | 0.1273                 | 0.105                  | 0.00E+00           | 2.46E+02           | 6.85E-01           | 6.96E-01           |      |
| 8/20 17:00 |   | -1700                                   | 0.017                            | -                                | 0.1283                 | 0.105                  | 0.00E+00           | 3.01E+02           | 6.85E-01           | 6.96E-01           |      |
| 8/20 23:00 |   | -1700                                   | 0.017                            | -                                | 0.1277                 | 0.105                  | 0.00E+00           | 2.71E+01           | 6.85E-01           | 6.96E-01           |      |
| 8/21 5:00  |   | -1700                                   | 0.017                            | -                                | 0.1273                 | 0.105                  | 0.00E+00           | 3.07E+01           | 6.83E-01           | 6.95E-01           |      |
| 8/21 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1270                 | 0.105                  | 0.00E+00           | 3.80E+01           | 6.84E-01           | 6.93E-01           |      |
| 8/21 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1260                 | 0.105                  | 0.00E+00           | 3.47E+01           | 6.83E-01           | 6.94E-01           |      |
| 8/21 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1263                 | 0.105                  | 0.00E+00           | 4.44E+01           | 6.83E-01           | 6.92E-01           |      |
| 8/22 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1268                 | 0.105                  | 0.00E+00           | 3.75E+02           | 6.83E-01           | 6.92E-01           |      |
| 8/22 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1258                 | 0.105                  | 0.00E+00           | 2.10E+02           | 6.82E-01           | 6.92E-01           |      |
| 8/22 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1260                 | 0.105                  | 0.00E+00           | 1.47E+02           | 6.81E-01           | 6.91E-01           |      |
| 8/22 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1268                 | 0.105                  | 0.00E+00           | 1.65E+02           | 6.82E-01           | 6.91E-01           |      |
| 8/23 5:00  |   | -1700                                   | 0.016                            | -                                | 0.1262                 | 0.105                  | 0.00E+00           | 9.00E+01           | 6.81E-01           | 6.93E-01           |      |
| 8/23 11:00 |   | -1700                                   | 0.016                            | -                                | 0.1262                 | 0.105                  | 0.00E+00           | 9.78E+01           | 6.80E-01           | 6.90E-01           |      |
| 8/23 17:00 |   | -1700                                   | 0.016                            | -                                | 0.1270                 | 0.105                  | 0.00E+00           | 9.07E+01           | 6.81E-01           | 6.91E-01           |      |
| 8/23 23:00 |   | -1700                                   | 0.016                            | -                                | 0.1266                 | 0.105                  | 0.00E+00           | 2.62E+01           | 6.81E-01           | 6.92E-01           |      |
| 8/24 5:00  |   | -1700                                   | 0.017                            | -                                | 0.1263                 | 0.105                  | 0.00E+00           | 2.53E+01           | 6.80E-01           | 6.91E-01           |      |
| 8/24 11:00 |   | -1700                                   | 0.017                            | -                                | 0.1275                 | 0.105                  | 0.00E+00           | 2.42E+01           | 6.81E-01           | 6.91E-01           |      |
| 8/24 17:00 |   | -1700                                   | 0.017                            | -                                | 0.1270                 | 0.105                  | 0.00E+00           | 3.70E+01           | 6.80E-01           | 6.92E-01           |      |
| 8/24 23:00 |   | -1650                                   | 0.017                            | -                                | 0.1267                 | 0.105                  | 0.00E+00           | 2.56E+01           | 6.80E-01           | 6.93E-01           |      |
| 8/25 5:00  |   | -1700                                   | 0.017                            | -                                | 0.1275                 | 0.105                  | 0.00E+00           | 3.38E+01           | 6.80E-01           | 6.91E-01           |      |
| 8/25 11:00 |   | -1700                                   | 0.017                            | -                                | 0.1271                 | 0.105                  | 0.00E+00           | 3.04E+01           | 6.79E-01           | 6.92E-01           |      |

DS

measurement instrument malfunction measurement instrument malfunction