


## Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Water level and Pressure

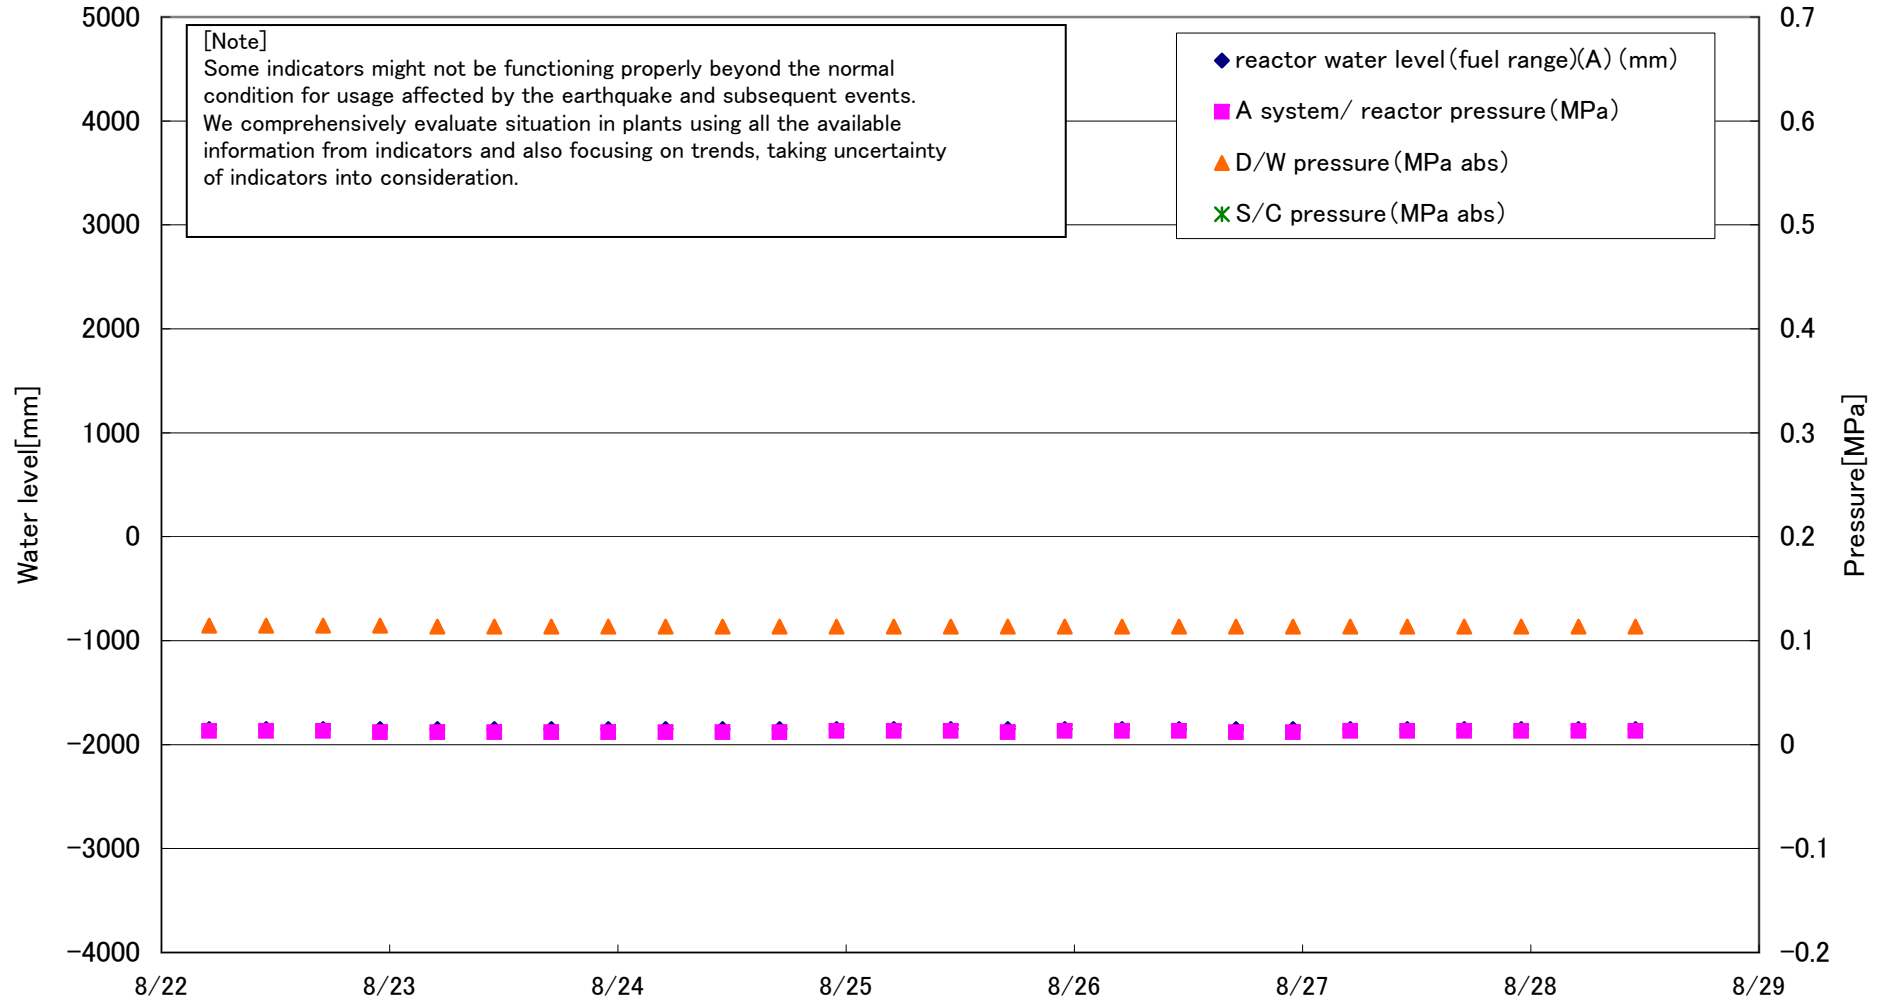

Fukushima Daiichi Nuclear Power Station Unit2 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date       | reactor water level (fuel range)(A) (mm) | reactor water level(fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | radiation dose in main control room (mSv/h) | note |
|------------|--|---|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|---|------|
| 8/22 5:00  | -1850                                    | -2200                                   | 0.013                            | -                                | 0.115                  |                        | 1.08E+01           | 5.57E+00           | 1.29E-01           | 5.49E+00           | 0.010                                       |      |
| 8/22 11:00 | -1850                                    | -2150                                   | 0.013                            | -                                | 0.115                  |                        | 1.07E+01           | 5.58E+00           | 1.29E-01           | 5.42E+00           | 0.011                                       |      |
| 8/22 17:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.115                  |                        | 1.07E+01           | 5.59E+00           | 1.28E-01           | 5.40E+00           | 0.010                                       |      |
| 8/22 23:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.115                  |                        | 1.07E+01           | 5.59E+00           | 1.28E-01           | 5.42E+00           | 0.011                                       |      |
| 8/23 5:00  | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.60E+00           | 1.27E-01           | 5.46E+00           | 0.011                                       |      |
| 8/23 11:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.60E+00           | 1.27E-01           | 5.47E+00           | 0.010                                       |      |
| 8/23 17:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.61E+00           | 1.26E-01           | 5.48E+00           | 0.011                                       |      |
| 8/23 23:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.62E+00           | 1.26E-01           | 5.49E+00           | 0.011                                       |      |
| 8/24 5:00  | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.62E+00           | 1.25E-01           | 5.51E+00           | 0.011                                       |      |
| 8/24 11:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.63E+00           | 1.25E-01           | 5.50E+00           | 0.011                                       |      |
| 8/24 17:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.07E+01           | 5.63E+00           | 1.25E-01           | 5.50E+00           | 0.010                                       |      |
| 8/24 23:00 | -1850                                    | -2150                                   | 0.013                            | -                                | 0.114                  |                        | 1.07E+01           | 5.63E+00           | 1.24E-01           | 5.50E+00           | 0.011                                       |      |
| 8/25 5:00  | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.07E+01           | 5.64E+00           | 1.24E-01           | 5.51E+00           | 0.011                                       |      |
| 8/25 11:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.07E+01           | 5.64E+00           | 1.24E-01           | 5.52E+00           | 0.010                                       |      |
| 8/25 17:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.24E-01           | 5.57E+00           | 0.010                                       |      |
| 8/25 23:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.23E-01           | 5.56E+00           | 0.010                                       |      |
| 8/26 5:00  | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.64E+00           | 1.23E-01           | 5.58E+00           | 0.013                                       |      |
| 8/26 11:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.23E-01           | 5.57E+00           | 0.010                                       |      |
| 8/26 17:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.22E-01           | 5.53E+00           | 0.013                                       |      |
| 8/26 23:00 | -1850                                    | -2200                                   | 0.012                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.22E-01           | 5.50E+00           | 0.010                                       |      |
| 8/27 5:00  | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.63E+00           | 1.22E-01           | 5.45E+00           | 0.009                                       |      |
| 8/27 11:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.68E+00           | 1.22E-01           | 5.40E+00           | 0.009                                       |      |
| 8/27 17:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.62E+00           | 1.21E-01           | 5.37E+00           | 0.011                                       |      |
| 8/27 23:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.62E+00           | 1.21E-01           | 5.37E+00           | 0.011                                       |      |
| 8/28 5:00  | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.62E+00           | 1.21E-01           | 5.33E+00           | 0.010                                       |      |
| 8/28 11:00 | -1850                                    | -2200                                   | 0.013                            | -                                | 0.114                  |                        | 1.06E+01           | 5.62E+00           | 1.21E-01           | 5.31E+00           | 0.009                                       |      |

measurement instrument malfunction

measurement instrument malfunction

measurement instrument malfunction