


## Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

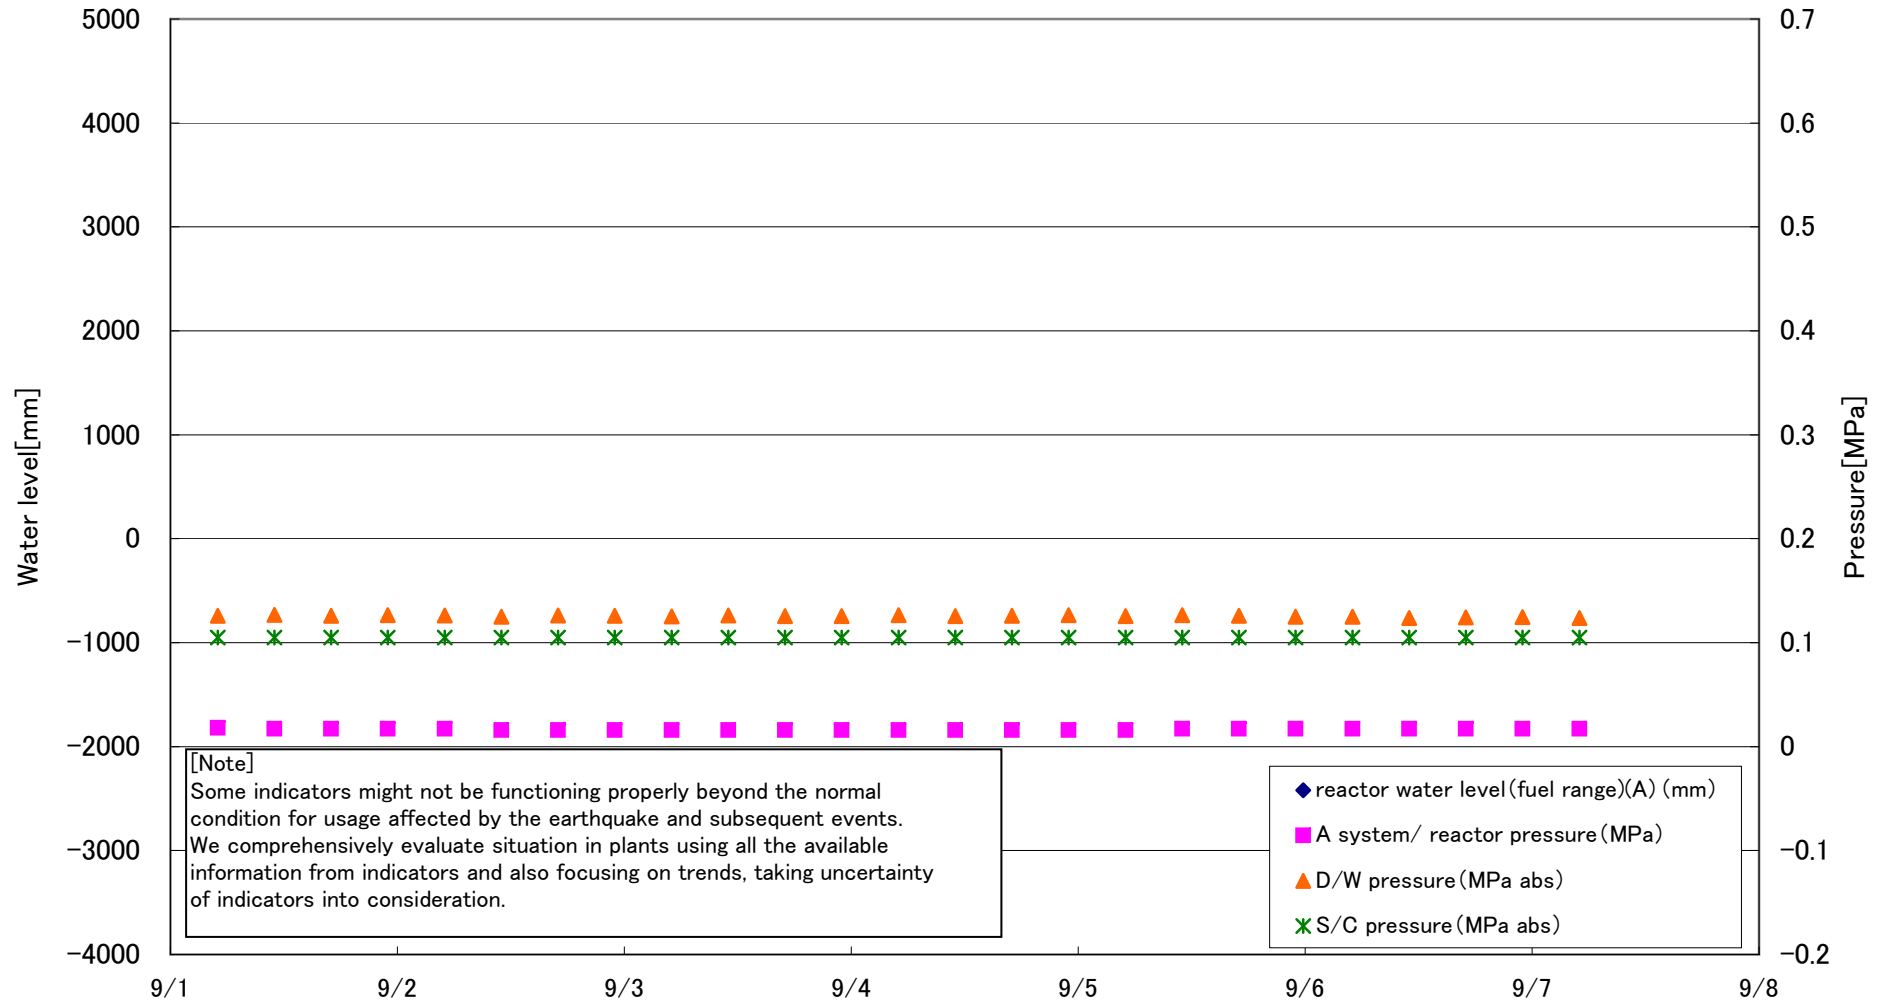

## Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date      | reactor water<br>level(fuel<br>range)(A)<br>(mm) | reactor water<br>level(fuel<br>range)(B)<br>(mm) | A system/<br>reactor<br>pressure<br>(MPa) | B system/<br>reactor<br>pressure<br>(MPa) | D/W<br>pressure<br>(MPa abs) | S/C<br>pressure<br>(MPa abs) | CAMS<br>D/W(A)<br>(Sv/h) | CAMS<br>D/W(B)<br>(Sv/h) | CAMS<br>S/C(A)<br>(Sv/h) | CAMS<br>S/C(B)<br>(Sv/h) | note |
|-----------|--|--|---|---|------------------------------|------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|------|
| 9/1 5:00  |  | -1700  | 0.018                                     | -   | 0.1260                       | 0.105                        | 0.00E+00                 | 3.35E+01                 | 6.76E-01                 | 6.91E-01                 |      |
| 9/1 11:00 |  | -1700  | 0.017                                     | -   | 0.1268                       | 0.105                        | 0.00E+00                 | 3.10E+01                 | 6.76E-01                 | 6.91E-01                 |      |
| 9/1 17:00 |  | -1700  | 0.017                                     | -   | 0.1260                       | 0.105                        | 0.00E+00                 | 2.80E+01                 | 6.75E-01                 | 6.91E-01                 |      |
| 9/1 23:00 |  | -1650  | 0.017                                     | -   | 0.1265                       | 0.105                        | 0.00E+00                 | 3.14E+01                 | 6.76E-01                 | 6.90E-01                 |      |
| 9/2 5:00  |  | -1650  | 0.017                                     | -   | 0.1263                       | 0.105                        | 0.00E+00                 | 3.38E+01                 | 6.75E-01                 | 6.90E-01                 |      |
| 9/2 11:00 |  | -1650  | 0.016                                     | -   | 0.1251                       | 0.105                        | 0.00E+00                 | 4.11E+01                 | 6.75E-01                 | 6.90E-01                 |      |
| 9/2 17:00 |  | -1650  | 0.016                                     | -   | 0.1262                       | 0.105                        | 0.00E+00                 | 1.10E+02                 | 6.75E-01                 | 6.91E-01                 |      |
| 9/2 23:00 |  | -1650  | 0.016                                     | -   | 0.1258                       | 0.105                        | 0.00E+00                 | 4.40E+01                 | 6.75E-01                 | 6.90E-01                 |      |
| 9/3 5:00  |  | -1700  | 0.016                                     | -   | 0.1253                       | 0.105                        | 0.00E+00                 | 3.07E+01                 | 6.75E-01                 | 6.90E-01                 |      |
| 9/3 11:00 |  | -1700  | 0.016                                     | -   | 0.1262                       | 0.105                        | 0.00E+00                 | 3.42E+02                 | 6.75E-01                 | 6.91E-01                 |      |
| 9/3 17:00 |  | -1700  | 0.016                                     | -   | 0.1257                       | 0.105                        | 0.00E+00                 | 3.44E+02                 | 6.74E-01                 | 6.91E-01                 |      |
| 9/3 23:00 |  | -1700  | 0.016                                     | -   | 0.1257                       | 0.105                        | 0.00E+00                 | 3.55E+02                 | 6.75E-01                 | 6.90E-01                 |      |
| 9/4 5:00  |  | -1650  | 0.016                                     | -   | 0.1265                       | 0.105                        | 0.00E+00                 | 3.46E+02                 | 6.74E-01                 | 6.90E-01                 |      |
| 9/4 11:00 |  | -1700  | 0.016                                     | -   | 0.1257                       | 0.105                        | 0.00E+00                 | 3.60E+02                 | 6.74E-01                 | 6.91E-01                 |      |
| 9/4 17:00 |  | -1700  | 0.016                                     | -   | 0.1258                       | 0.105                        | 0.00E+00                 | 3.89E+02                 | 6.74E-01                 | 6.89E-01                 |      |
| 9/4 23:00 |  | -1700  | 0.016                                     | -   | 0.1265                       | 0.105                        | 0.00E+00                 | 7.00E+01                 | 6.74E-01                 | 6.88E-01                 |      |
| 9/5 5:00  |  | -1700  | 0.016                                     | -   | 0.1256                       | 0.105                        | 0.00E+00                 | 8.00E+01                 | 6.74E-01                 | 6.89E-01                 |      |
| 9/5 11:00 |  | -1700  | 0.017                                     | -   | 0.1264                       | 0.105                        | 0.00E+00                 | 7.10E+01                 | 6.75E-01                 | 6.89E-01                 |      |
| 9/5 17:00 |  | -1700  | 0.017                                     | -   | 0.1260                       | 0.105                        | 0.00E+00                 | 6.80E+01                 | 6.74E-01                 | 6.88E-01                 |      |
| 9/5 23:00 |  | -1700  | 0.017                                     | -   | 0.1249                       | 0.105                        | 0.00E+00                 | 6.40E+01                 | 6.73E-01                 | 6.87E-01                 |      |
| 9/6 5:00  |  | -1700  | 0.017                                     | -   | 0.1250                       | 0.105                        | 0.00E+00                 | 5.25E+01                 | 6.74E-01                 | 6.87E-01                 |      |
| 9/6 11:00 |  | -1650  | 0.017                                     | -   | 0.1238                       | 0.105                        | 0.00E+00                 | 6.47E+01                 | 6.73E-01                 | 6.86E-01                 |      |
| 9/6 17:00 |  | -1650  | 0.017                                     | -   | 0.1245                       | 0.105                        | 0.00E+00                 | 6.76E+01                 | 6.73E-01                 | 6.85E-01                 |      |
| 9/6 23:00 |  | -1700  | 0.017                                     | -   | 0.1248                       | 0.105                        | 0.00E+00                 | 1.41E+02                 | 6.73E-01                 | 6.85E-01                 |      |
| 9/7 5:00  |  | -1700  | 0.017                                     | -   | 0.1237                       | 0.105                        | 0.00E+00                 | 2.85E+01                 | 6.74E-01                 | 6.86E-01                 |      |

DS

measurement measurement  
 instrument instrument  
 malfunction malfunction