


## Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Water level and Pressure

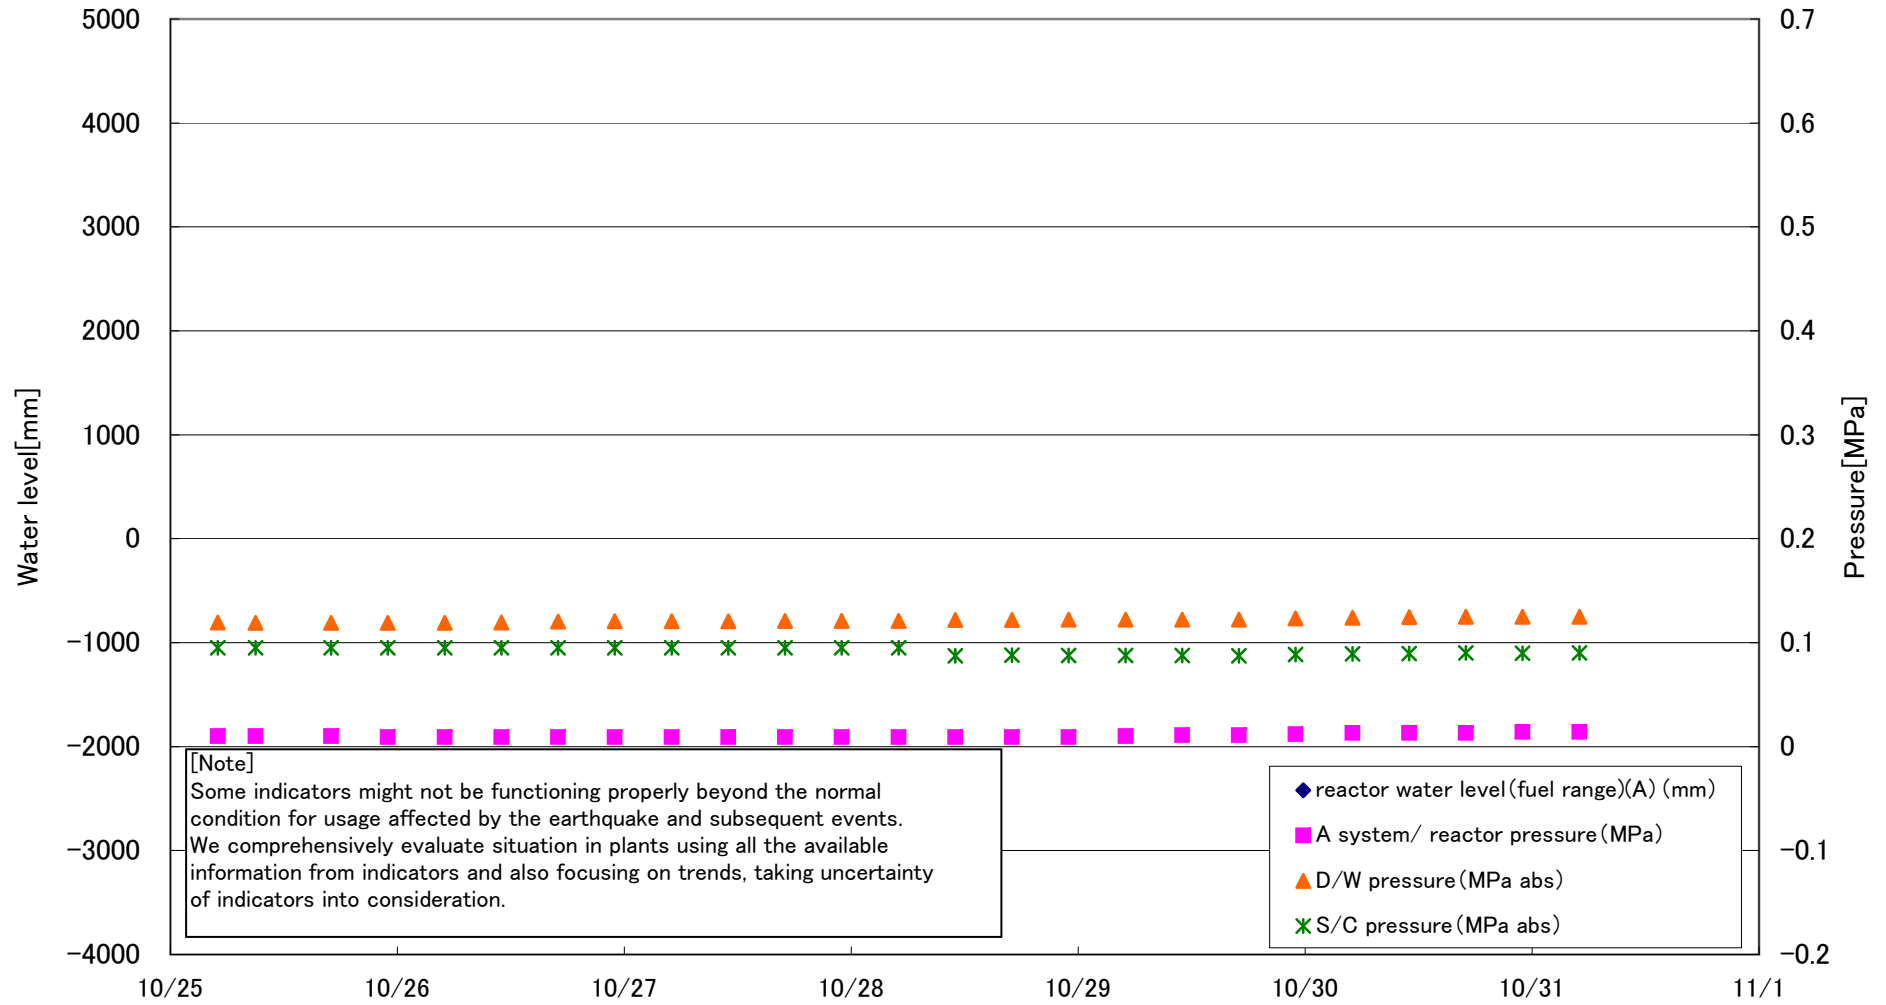

## Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Water level and Pressure

[Note]  
 Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.  
 We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty of indicators into consideration.

| Date        | reactor water level(fuel range)(A) (mm) | reactor water level(fuel range)(B) (mm) | A system/ reactor pressure (MPa) | B system/ reactor pressure (MPa) | D/W pressure (MPa abs) | S/C pressure (MPa abs) | CAMS D/W(A) (Sv/h) | CAMS D/W(B) (Sv/h) | CAMS S/C(A) (Sv/h) | CAMS S/C(B) (Sv/h) | note |
|-------------|---|---|----------------------------------|----------------------------------|------------------------|------------------------|--------------------|--------------------|--------------------|--------------------|------|
| 10/25 5:00  |   | -1750                                   | 0.010                            | -                                | 0.1193                 | 0.095                  | 0.00E+00           | 3.38E+01           | 6.62E-01           | 6.75E-01           |      |
| 10/25 9:00  |   | -1750                                   | 0.010                            | -                                | 0.1191                 | 0.095                  | 0.00E+00           | 3.35E+01           | 6.63E-01           | 6.75E-01           |      |
| 10/25 17:00 |   | -1700                                   | 0.010                            | -                                | 0.1190                 | 0.095                  | 0.00E+00           | 3.05E+01           | 6.05E-01           | 6.11E-01           |      |
| 10/25 23:00 |   | -1700                                   | 0.009                            | -                                | 0.1192                 | 0.095                  | 0.00E+00           | 3.07E+01           | 6.32E-01           | 6.36E-01           |      |
| 10/26 5:00  |   | -1750                                   | 0.009                            | -                                | 0.1192                 | 0.095                  | 0.00E+00           | 3.06E+01           | 6.41E-01           | 6.48E-01           |      |
| 10/26 11:00 |   | -1750                                   | 0.009                            | -                                | 0.1195                 | 0.095                  | 0.00E+00           | 2.98E+01           | 6.47E-01           | 6.53E-01           |      |
| 10/26 17:00 |   | -1750                                   | 0.009                            | -                                | 0.1204                 | 0.095                  | 0.00E+00           | 4.52E+01           | 6.51E-01           | 6.56E-01           |      |
| 10/26 23:00 |   | -1750                                   | 0.009                            | -                                | 0.1208                 | 0.095                  | 0.00E+00           | 4.95E+02           | 6.53E-01           | 6.60E-01           |      |
| 10/27 5:00  |   | -1800                                   | 0.009                            | -                                | 0.1205                 | 0.095                  | 0.00E+00           | 3.05E+01           | 6.55E-01           | 6.63E-01           |      |
| 10/27 11:00 |   | -1750                                   | 0.009                            | -                                | 0.1205                 | 0.095                  | 0.00E+00           | 4.07E+01           | 6.57E-01           | 6.65E-01           |      |
| 10/27 17:00 |   | -1700                                   | 0.009                            | -                                | 0.1211                 | 0.095                  | 0.00E+00           | 2.53E+01           | 6.59E-01           | 6.65E-01           |      |
| 10/27 23:00 |   | -1750                                   | 0.009                            | -                                | 0.1211                 | 0.095                  | 0.00E+00           | 4.11E+01           | 6.60E-01           | 6.66E-01           |      |
| 10/28 5:00  |   | -1750                                   | 0.009                            | -                                | 0.1210                 | 0.095                  | 0.00E+00           | 2.96E+02           | 6.60E-01           | 6.68E-01           |      |
| 10/28 11:00 |   | -1770                                   | 0.009                            | -                                | 0.1219                 | 0.087                  | 1.00E-02           | 2.78E+02           | 6.60E-01           | 6.70E-01           |      |
| 10/28 17:00 |   | -1760                                   | 0.009                            | -                                | 0.1220                 | 0.088                  | 1.00E-02           | 2.78E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/28 23:00 |   | -1790                                   | 0.009                            | -                                | 0.1222                 | 0.088                  | 1.00E-02           | 3.36E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/29 5:00  |   | -1790                                   | 0.010                            | -                                | 0.1222                 | 0.088                  | 1.00E-02           | 4.13E+02           | 6.60E-01           | 6.70E-01           |      |
| 10/29 11:00 |   | -1770                                   | 0.011                            | -                                | 0.1222                 | 0.088                  | 1.00E-02           | 2.96E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/29 17:00 |   | -1770                                   | 0.011                            | -                                | 0.1223                 | 0.087                  | 1.00E-02           | 2.19E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/29 23:00 |   | -1780                                   | 0.012                            | -                                | 0.1233                 | 0.089                  | 1.00E-02           | 3.31E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/30 5:00  |   | -1780                                   | 0.013                            | -                                | 0.1241                 | 0.089                  | 1.00E-02           | 3.97E+02           | 6.60E-01           | 6.70E-01           |      |
| 10/30 11:00 |   | -1770                                   | 0.013                            | -                                | 0.1246                 | 0.089                  | 1.00E-02           | 2.07E+01           | 6.60E-01           | 6.70E-01           |      |
| 10/30 17:00 |   | -1770                                   | 0.013                            | -                                | 0.1250                 | 0.090                  | 1.00E-02           | 3.09E+02           | 6.60E-01           | 6.70E-01           |      |
| 10/30 23:00 |   | -1770                                   | 0.014                            | -                                | 0.1250                 | 0.090                  | 1.00E-02           | 3.38E+02           | 6.60E-01           | 6.70E-01           |      |
| 10/31 5:00  |   | -1780                                   | 0.014                            | -                                | 0.1248                 | 0.090                  | 1.00E-02           | 2.14E+01           | 6.60E-01           | 6.70E-01           |      |

DS

measurement measurement  
 instrument instrument  
 malfunction malfunction