Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Temperature

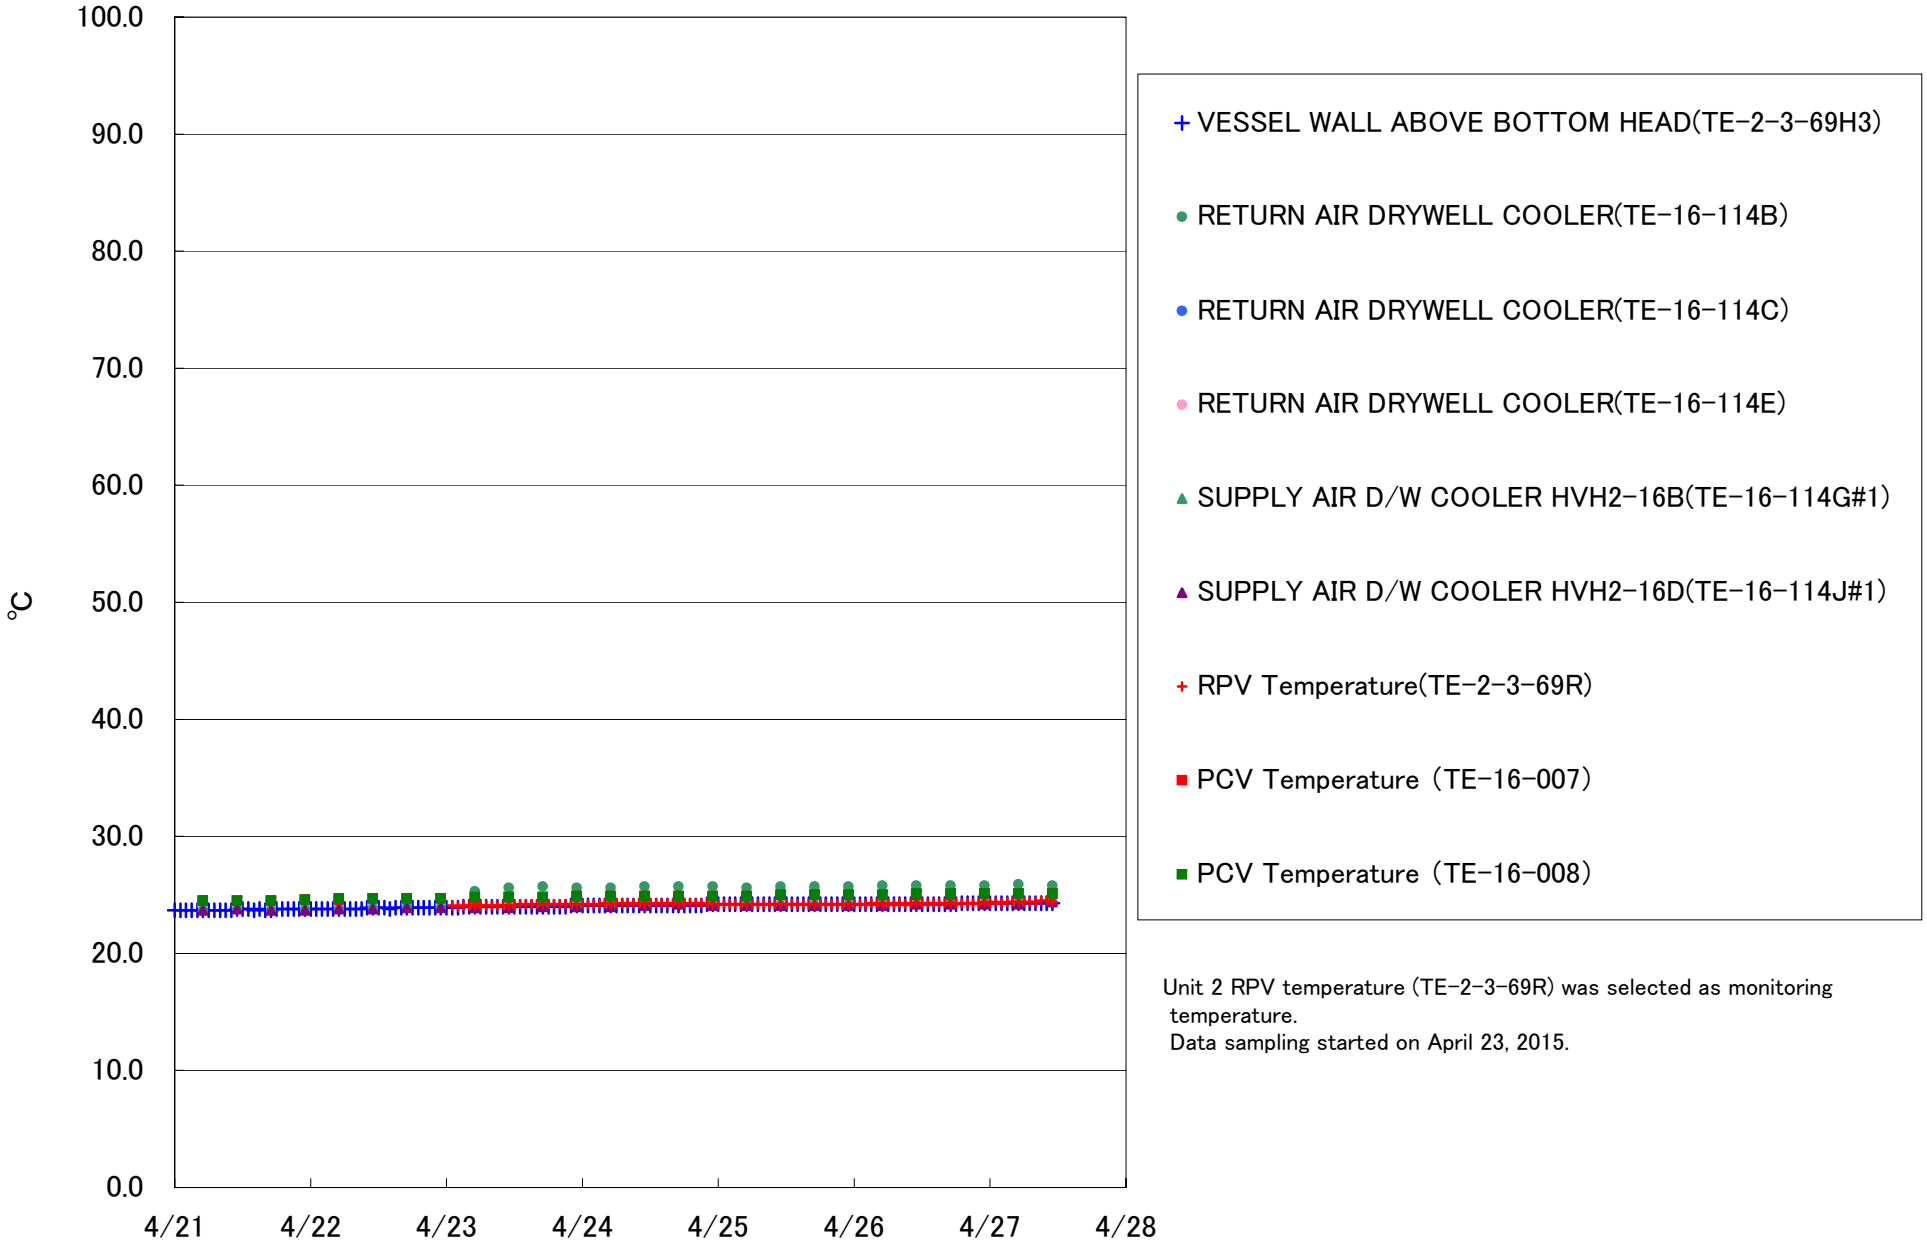

Unit 2 RPV temperature (TE-2-3-69R) was selected as monitoring temperature.
Data sampling started on April 23, 2015.