


### Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Temperature

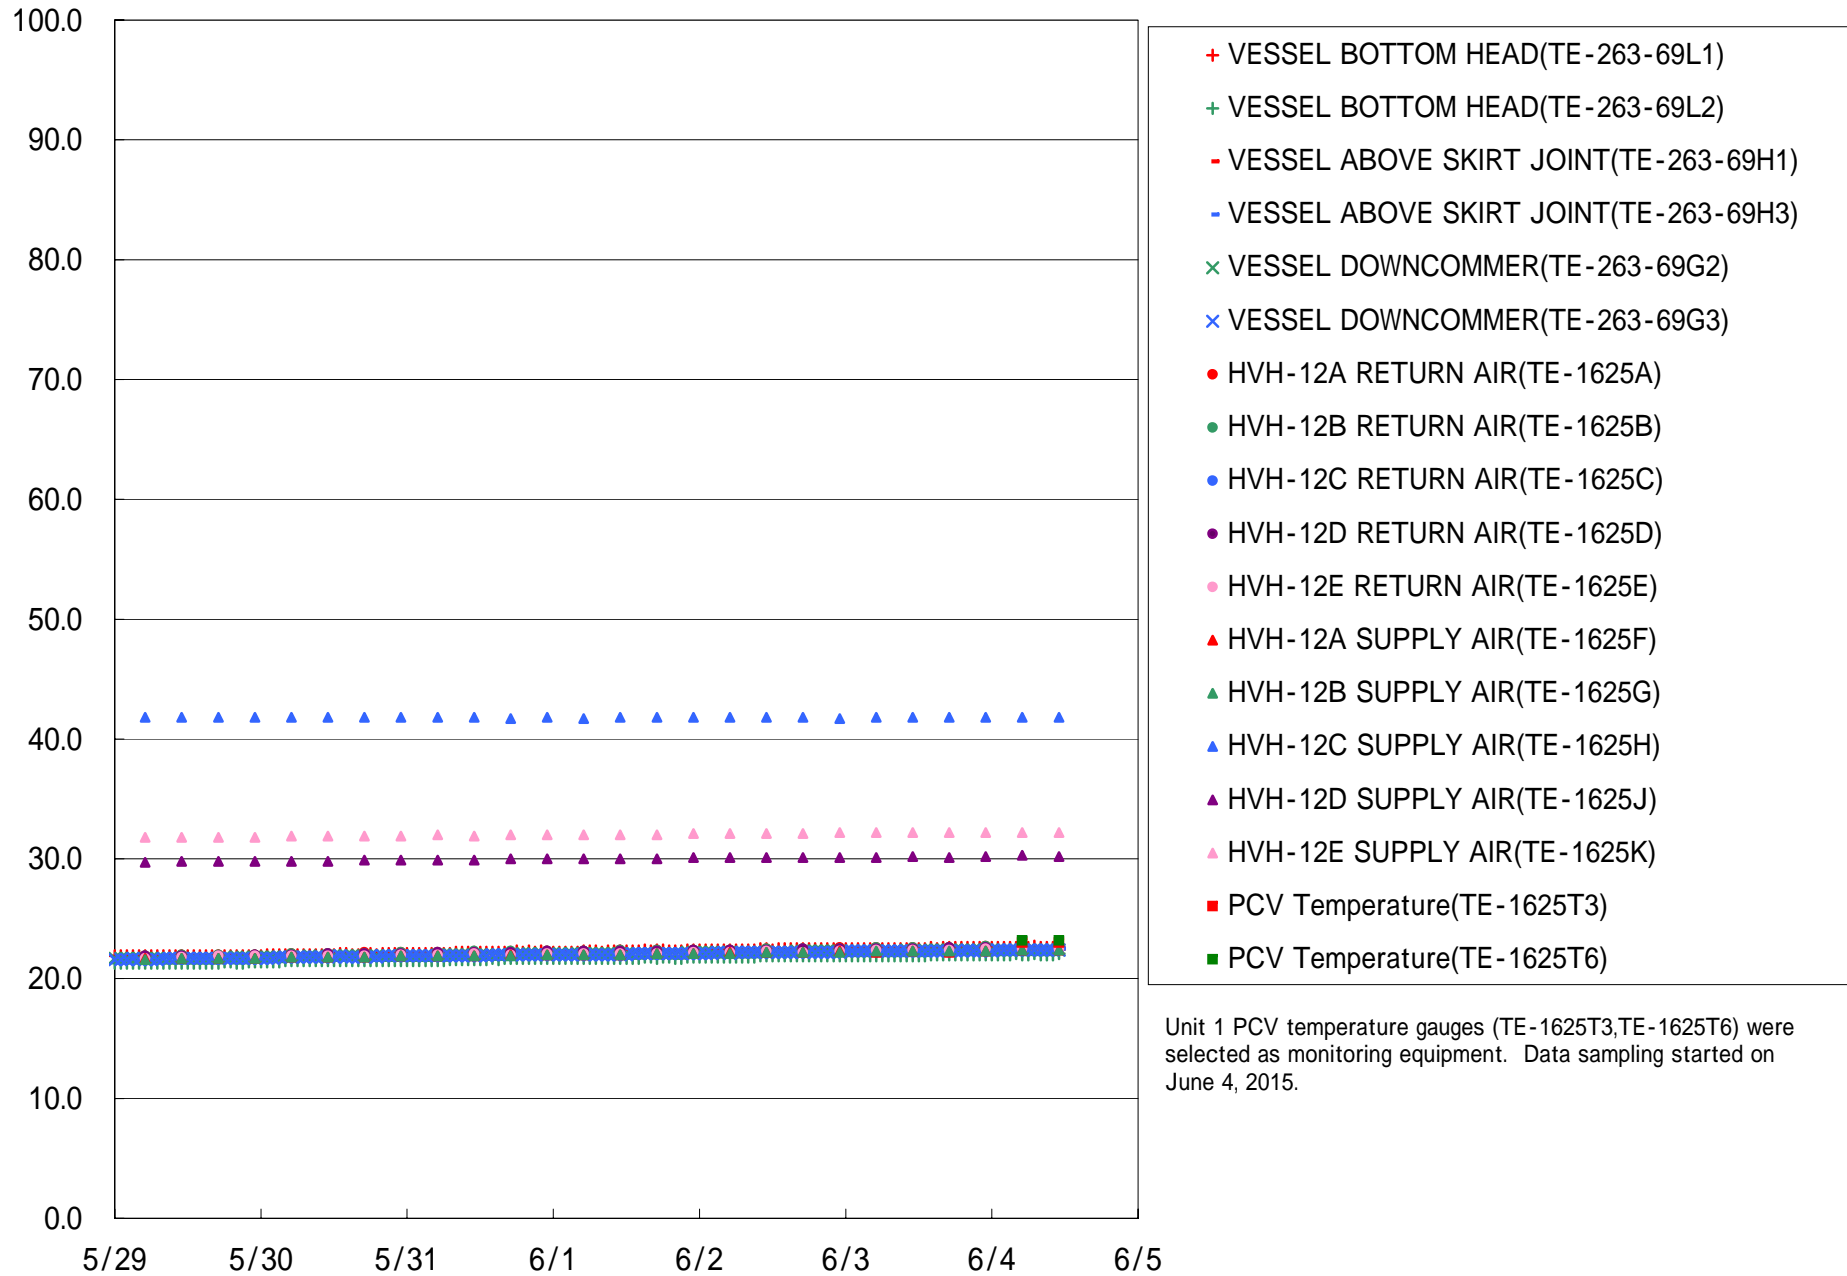

Unit 1 PCV temperature gauges (TE-1625T3, TE-1625T6) were selected as monitoring equipment. Data sampling started on June 4, 2015.