


Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Temperature

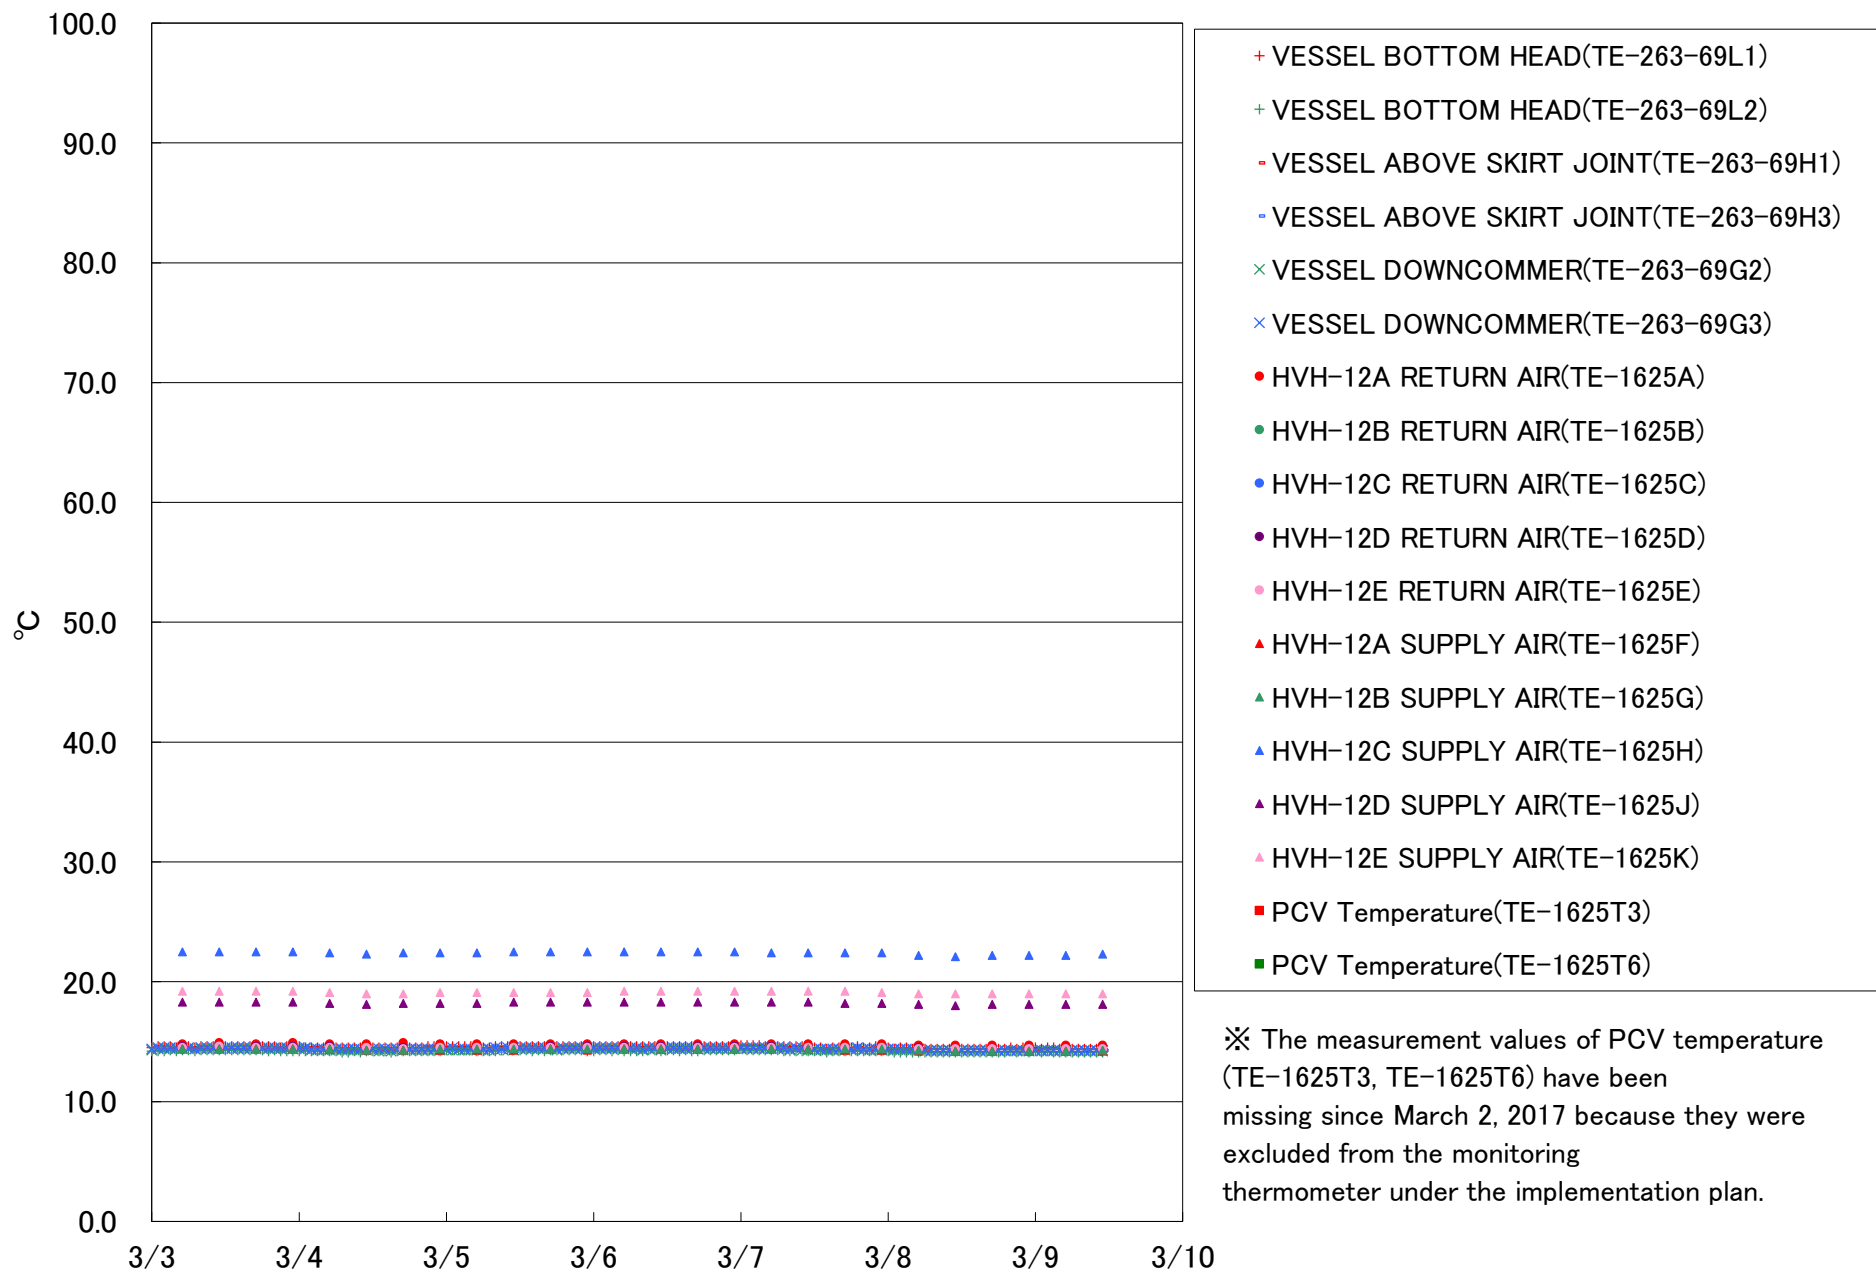

- + VESSEL BOTTOM HEAD(TE-263-69L1)
- + VESSEL BOTTOM HEAD(TE-263-69L2)
- VESSEL ABOVE SKIRT JOINT(TE-263-69H1)
- VESSEL ABOVE SKIRT JOINT(TE-263-69H3)
- × VESSEL DOWNCOMMER(TE-263-69G2)
- × VESSEL DOWNCOMMER(TE-263-69G3)
- HVH-12A RETURN AIR(TE-1625A)
- HVH-12B RETURN AIR(TE-1625B)
- HVH-12C RETURN AIR(TE-1625C)
- HVH-12D RETURN AIR(TE-1625D)
- HVH-12E RETURN AIR(TE-1625E)
- ▲ HVH-12A SUPPLY AIR(TE-1625F)
- ▲ HVH-12B SUPPLY AIR(TE-1625G)
- ▲ HVH-12C SUPPLY AIR(TE-1625H)
- ▲ HVH-12D SUPPLY AIR(TE-1625J)
- ▲ HVH-12E SUPPLY AIR(TE-1625K)
- PCV Temperature(TE-1625T3)
- PCV Temperature(TE-1625T6)

※ The measurement values of PCV temperature (TE-1625T3, TE-1625T6) have been missing since March 2, 2017 because they were excluded from the monitoring thermometer under the implementation plan.