


### Fukushima Daiichi Nuclear Power Station Unit 3 Parameters of Temperature

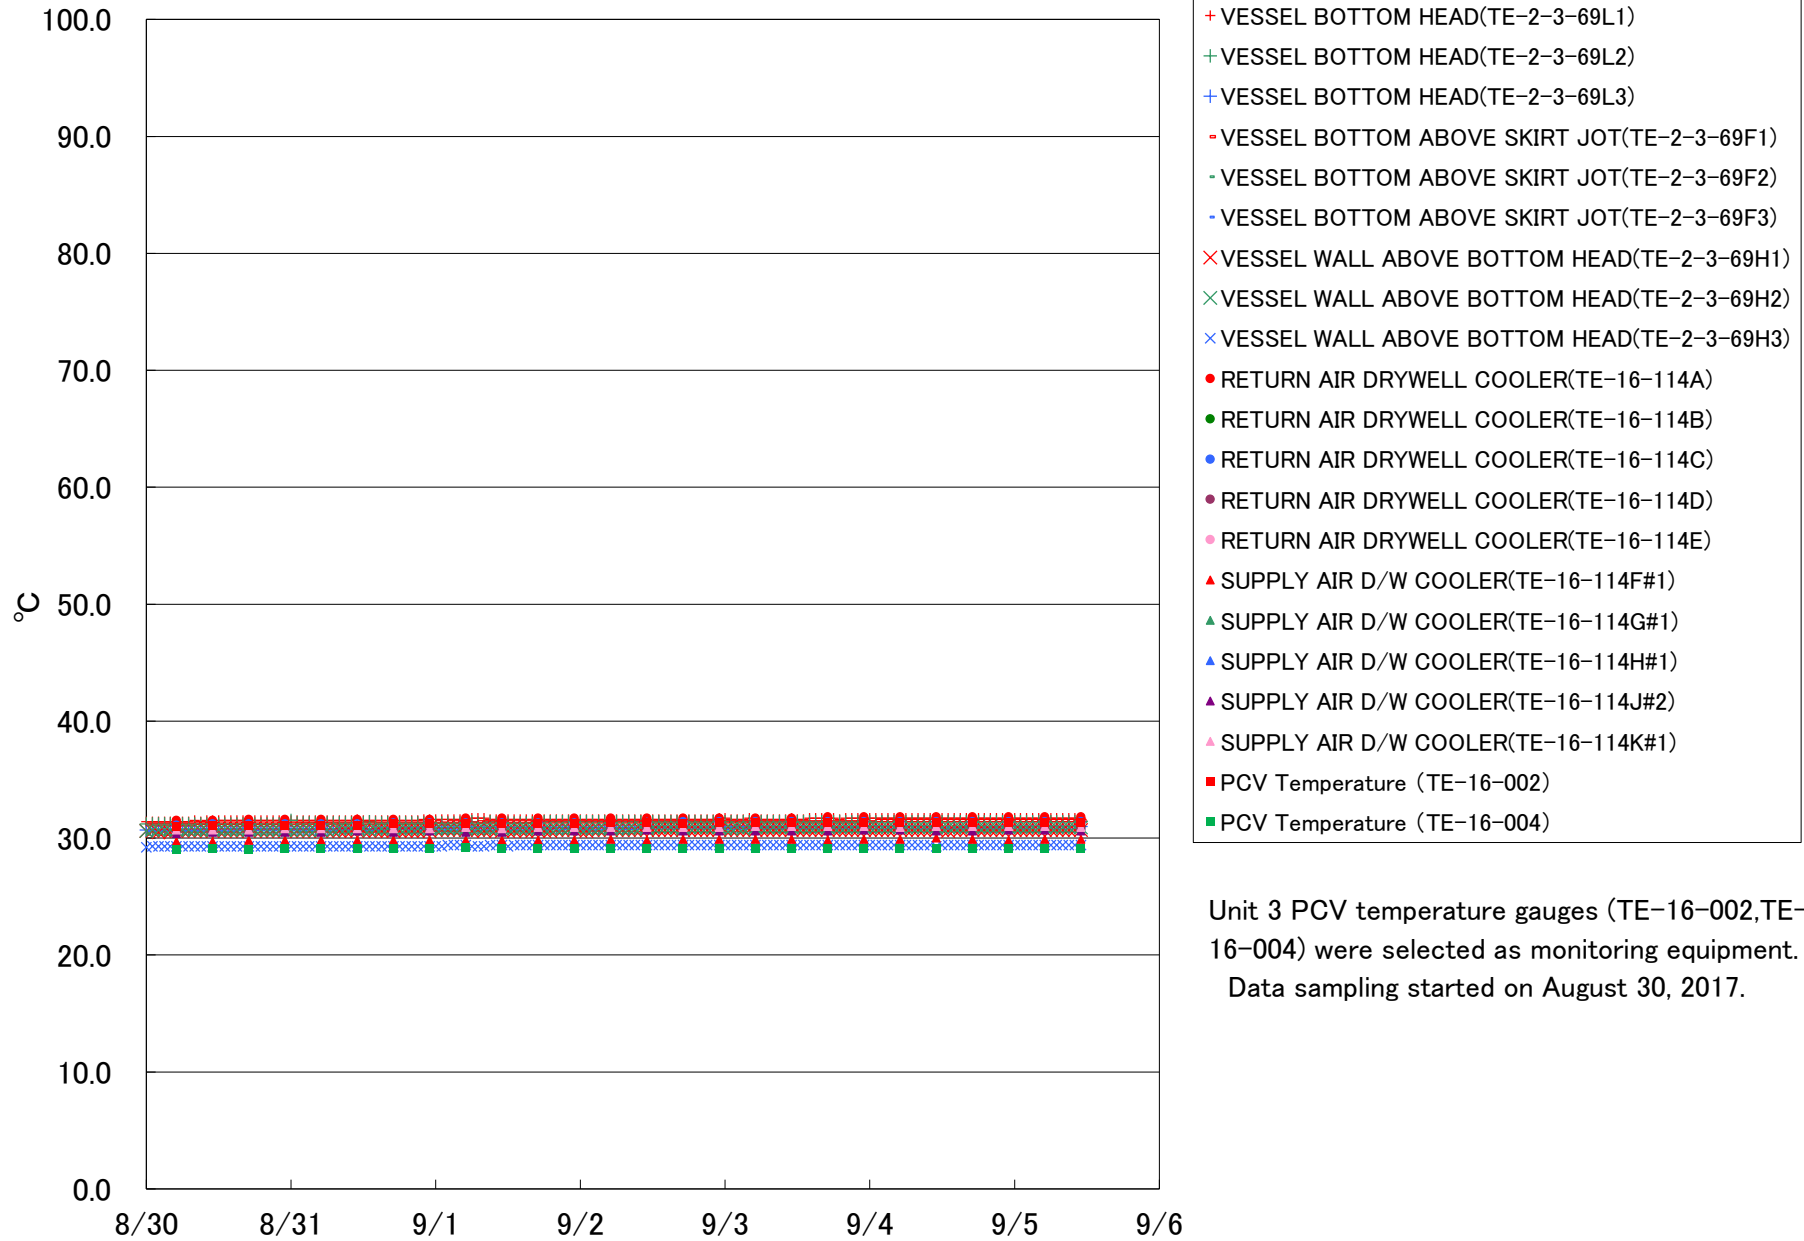

Unit 3 PCV temperature gauges (TE-16-002, TE-16-004) were selected as monitoring equipment. Data sampling started on August 30, 2017.