


Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

- Existing subdrain pit (the purification examination carried out in the past)
- Existing subdrain pit
- New subdrain pit
- Pit for the sampling

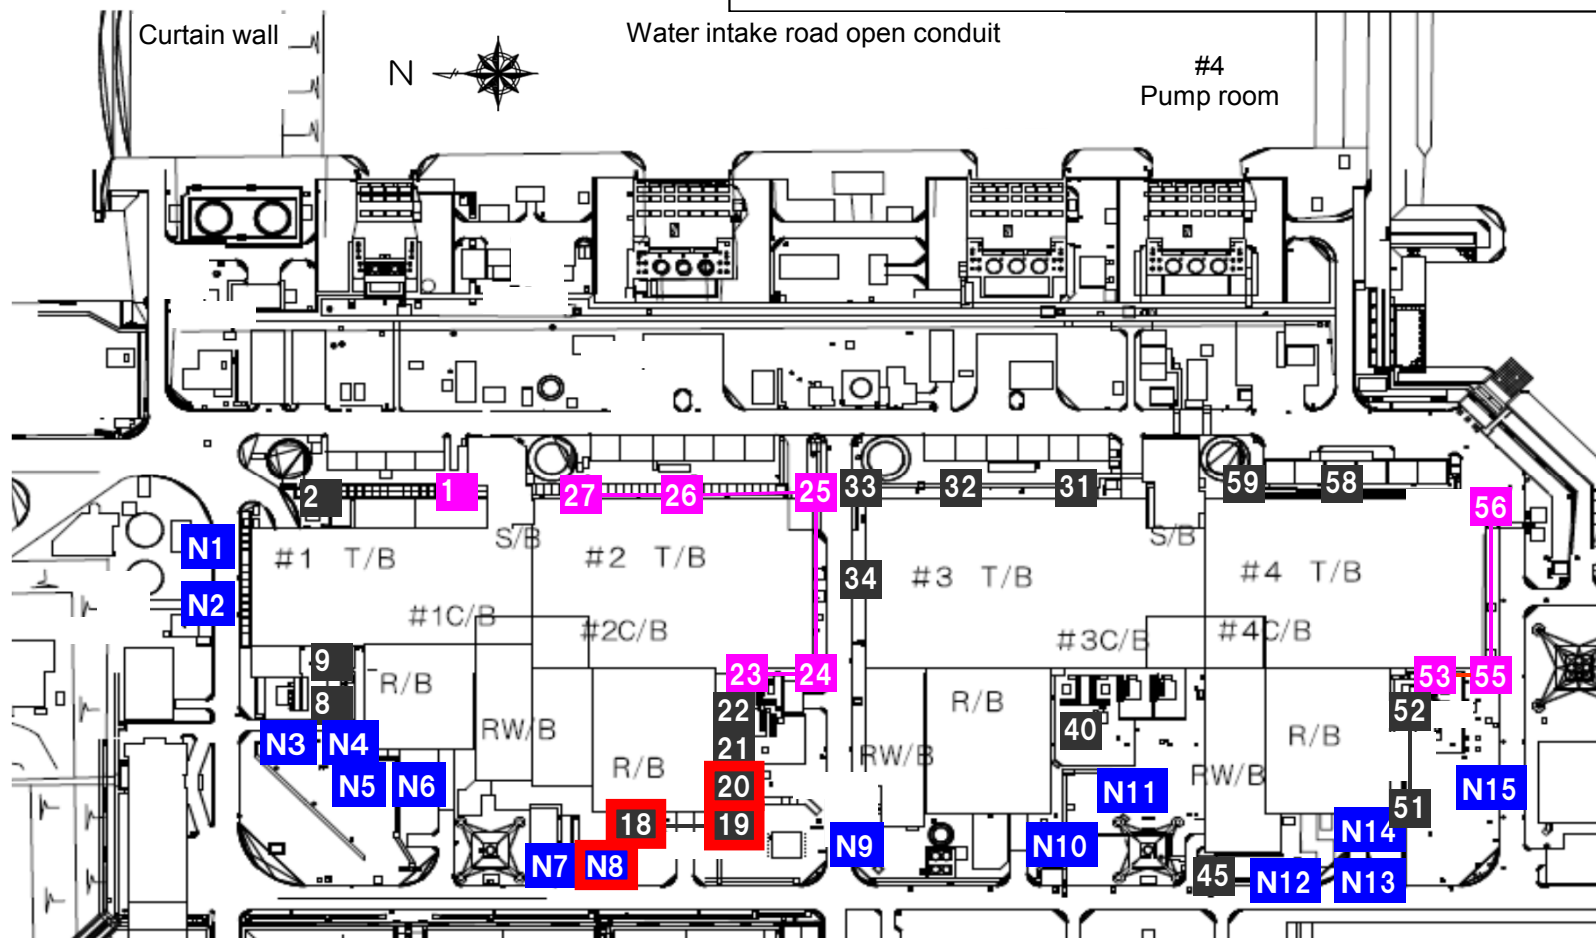

Analysis Results of Underground Water around Unit 2 Reactor Building in Fukushima Daiichi NPS

Unit: Bq/L

		Place of Sampling			
		N8	No.18	No.19	No.20
Date of Sampling (MM/DD)					
Time of sampling					
Cs-134(Approx. 2 years)					
Cs-137(Approx.30 years)					
The other γ					
All β					
H-3(Approx.12 years)					

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other γ".