


## 2. Analysis Results of Seawater Obtained around Fukushima Daiichi NPS (Inside of the Port of Fukushima Daiichi NPS)

Unit: Bq/L "ND"s below indicate that the measurement results are below the detection limits, and the detection limit of each radioactive material is provided in parentheses.

※The figures provided below for each point are the latest ones of "Detailed Analysis Results in the Port, around the Discharge Channel and the Bank Protection of Fukushima Daiichi NPS".

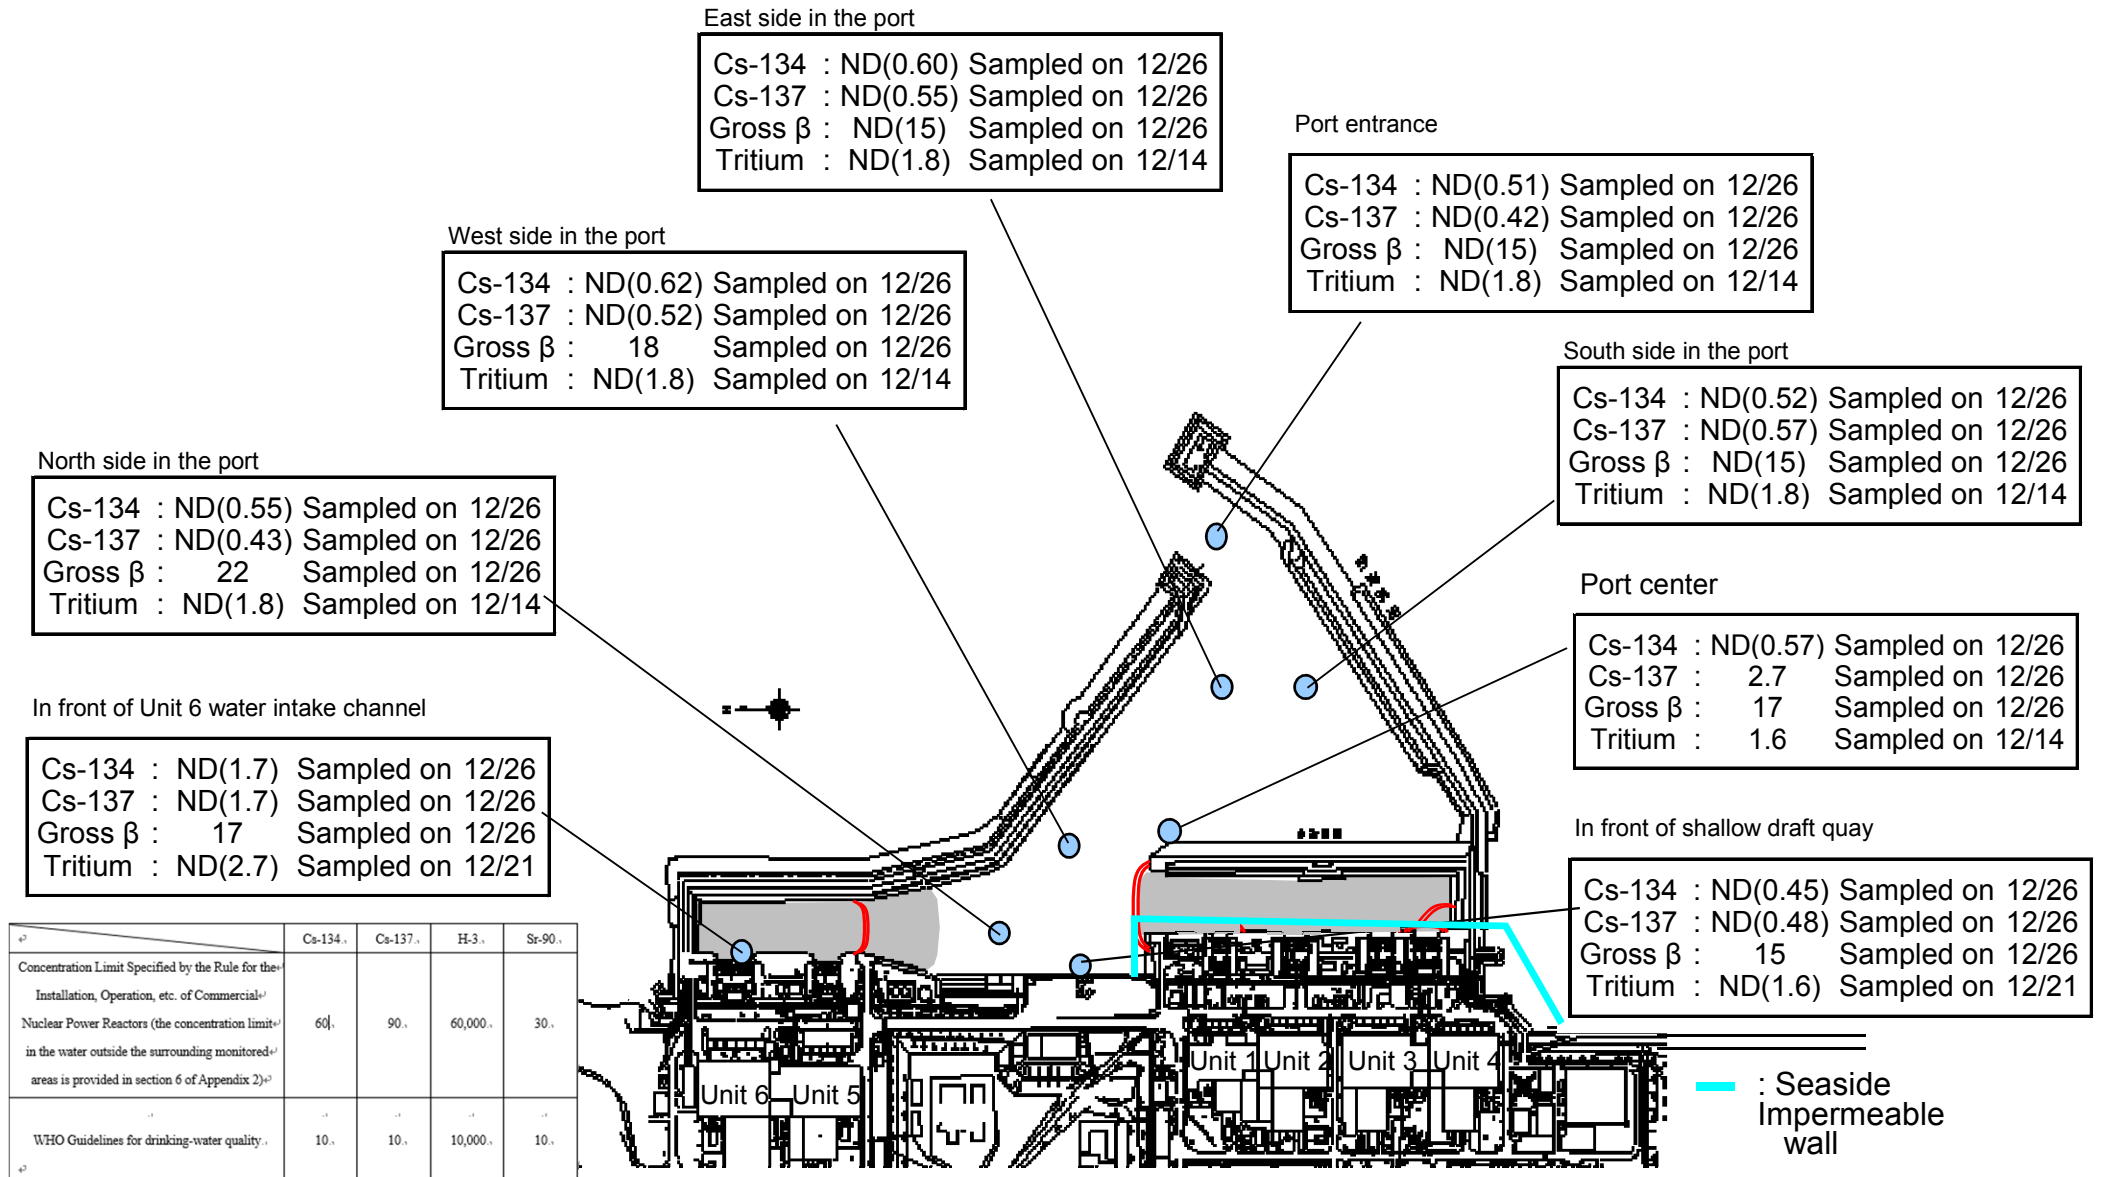

	Cs-134.	Cs-137.	H-3.	Sr-90.
Concentration Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the concentration limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2) <sup>①</sup>	60.	90.	60,000.	30.
WHO Guidelines for drinking-water quality. <sup>②</sup>	10.	10.	10,000.	10.