


6. Analysis Results Obtained in Drainage Channels around the H4 Area in Fukushima Daiichi Nuclear Power Station

- Unit: Bq/L "ND"s below indicate that the measurement results are below the detection limits, and the detection limit of each radioactive material is provided in parentheses.
- The latest figures from "Sampling Results Regarding the Water Leak at the Tanks in the H4 area in the Fukushima Daiichi Nuclear Power Station (South Water Outlet, Drainage Channel)" are provided in this report.

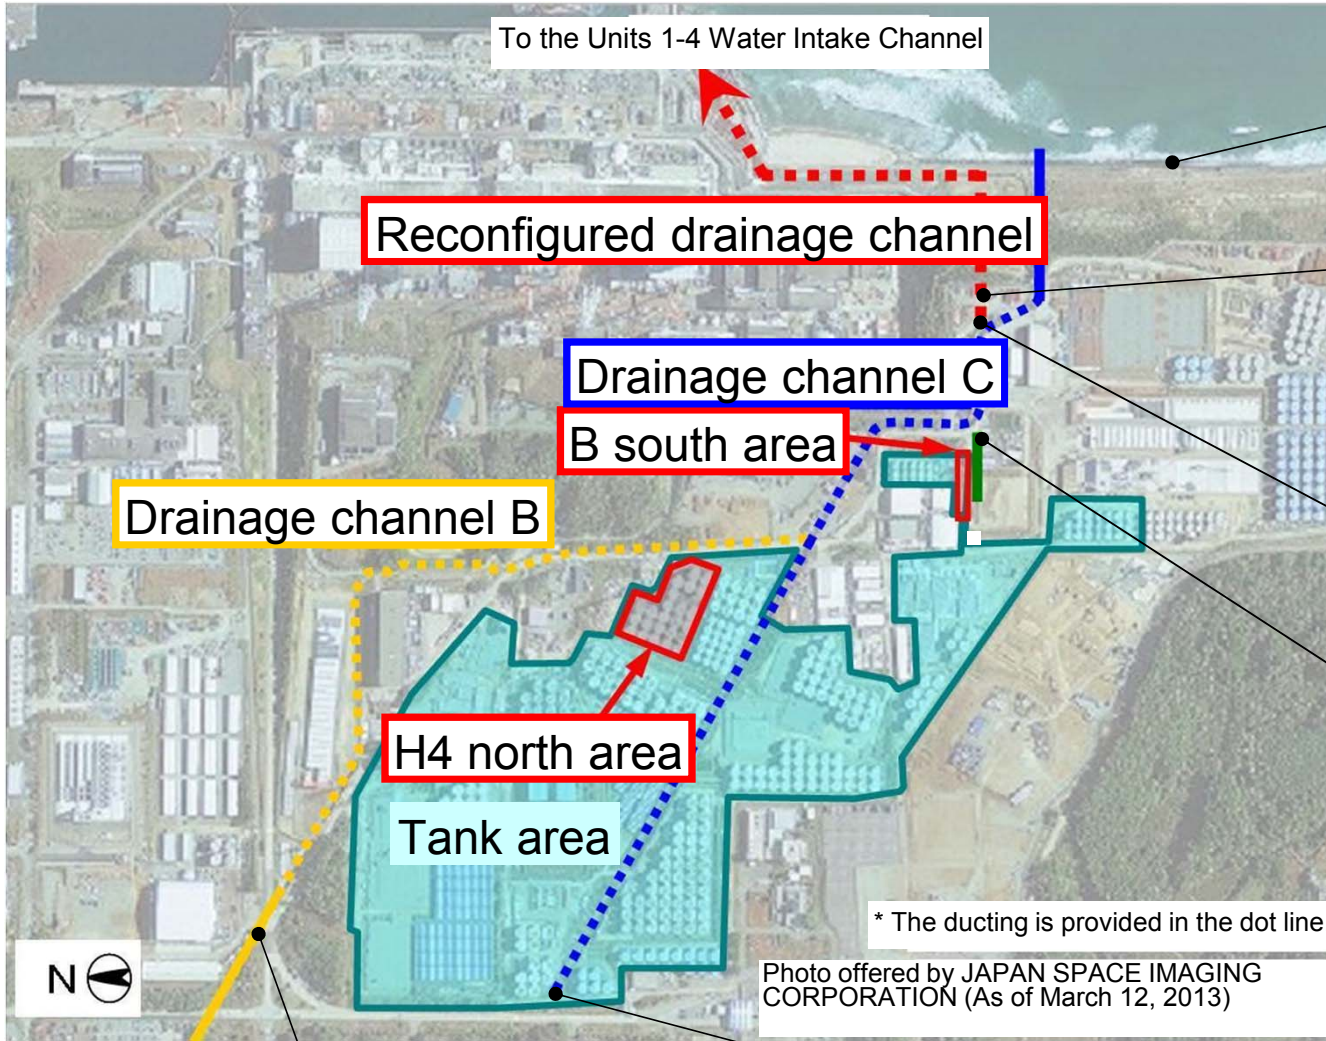

[T-2] Around the south water outlet

Cs-134	: ND(0.50)	Sampled on 12/26
Cs-137	: ND(0.63)	Sampled on 12/26
Gross β	: 10	Sampled on 12/26

[C-2-1] Switched drainage channel C OP.35 exit

Cs-134	: ND(2.2)	Sampled on 12/24
Cs-137	: ND(2.6)	Sampled on 12/24
Gross β	: ND(13)	Sampled on 12/24

•On December 26, the sampling could not be conducted because no water was left.

Around the side gutter drainage radiation monitor

Cs-134	: ND(2.7)	Sampled on 12/26
Cs-137	: ND(3.3)	Sampled on 12/26
Gross β	: 4.6	Sampled on 12/26

[X-1] Side ditch next to the tank (point immediately short of the junction with the drainage channel C)

Cs-134	: 7.8	Sampled on 11/11
Cs-137	: 57	Sampled on 11/11
Gross β	: 86	Sampled on 11/11

•On December 26, the sampling could not be conducted because no water was left.

* The ducting is provided in the dot line.
Photo offered by JAPAN SPACE IMAGING CORPORATION (As of March 12, 2013)

[B-0-1] Point near Fureai Intersection in the drainage channel B

Cs-134	: ND(8.5)	Sampled on 12/1
Cs-137	: 21	Sampled on 12/1
Gross β	: 30	Sampled on 12/1

•On December 22, the sampling could not be conducted because no water was left.

[C-0] Point near the main gate in the drainage channel C

Cs-134	: ND(7.6)	Sampled on 12/21
Cs-137	: ND(7.1)	Sampled on 12/21
Gross β	: ND(12)	Sampled on 12/21