

2. Analysis Results of Seawater Obtained around Fukushima Daiichi NPS (Inside of the Port of Fukushima Daiichi NPS)

Tokyo Electric Power Company Holdings, Incorporated
Fukushima Daiichi D & D Engineering Company

- Unit: Bq/L. "ND" below indicate that the measurement results are below the detection limits, and the detection limit of each radioactive material is provided in parentheses.
- The figures provided below for each point are the latest ones of "Detailed Analysis Results in the Port, around the Discharge Channel and the Bank Protection of Fukushima Daiichi NPS".

East side in the port

Cs-134 : ND(0.40) Sampled on 12/26
Cs-137 : 0.50 Sampled on 12/26
Gross β : ND(16) Sampled on 12/26
Tritium : 2.3 Sampled on 12/18

Port entrance

Cs-134 : ND(0.53) Sampled on 12/26
Cs-137 : ND(0.51) Sampled on 12/26
Gross β : ND(15) Sampled on 12/26
Tritium : ND(1.7) Sampled on 12/18

West side in the port

Cs-134 : ND(0.41) Sampled on 12/26
Cs-137 : 0.54 Sampled on 12/26
Gross β : ND(16) Sampled on 12/26
Tritium : 1.7 Sampled on 12/18

South side in the port

Cs-134 : ND(0.30) Sampled on 12/26
Cs-137 : ND(0.26) Sampled on 12/26
Gross β : ND(16) Sampled on 12/26
Tritium : ND(1.7) Sampled on 12/18

North side in the port

Cs-134 : ND(0.25) Sampled on 12/26
Cs-137 : ND(0.33) Sampled on 12/26
Gross β : ND(16) Sampled on 12/26
Tritium : ND(1.7) Sampled on 12/18

Port center

Cs-134 : ND(0.56) Sampled on 12/26
Cs-137 : 0.44 Sampled on 12/26
Gross β : ND(15) Sampled on 12/26
Tritium : ND(1.7) Sampled on 12/18


In front of Unit 6 water intake channel

Cs-134 : ND(0.57) Sampled on 12/26
Cs-137 : 0.55 Sampled on 12/26
Gross β : 20 Sampled on 12/26
Tritium : 3.7 Sampled on 12/18

In front of shallow draft quay

Cs-134 : ND(0.47) Sampled on 12/26
Cs-137 : 0.52 Sampled on 12/26
Gross β : ND(14) Sampled on 12/26
Tritium : ND(1.7) Sampled on 12/18

| | Cs-134.. | Cs-137.. | H-3.. | Sr-90.. |
|--|----------|----------|---------|---------|
| Concentration Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the concentration limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2) ⁴⁾ | 60. | 90. | 60,000. | 30. |
| WHO Guidelines for drinking-water quality. ⁵⁾ | 10. | 10. | 10,000. | 10. |

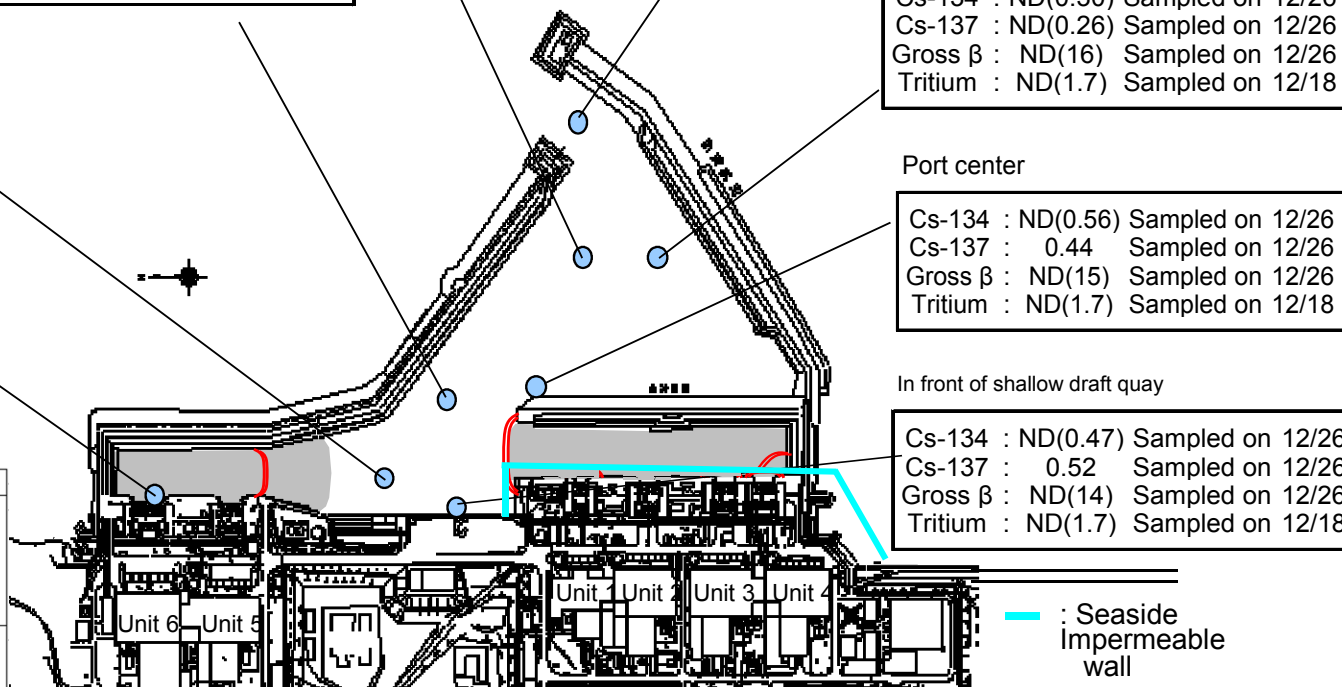

— : Seaside Impermeable wall

Concentration Limit Specified by the Rule: Concentration Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the concentration limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 3)