

March 31, 2016
Tokyo Electric Power Company

Air Dose Rates inside the Buildings


Sampling Period


Unit 2: from January 1, 2016 to January 31, 2016


Fukushima Daiichi NPS

Unit 2 Reactor Building Semi-Basement Floor

[mSv/h]

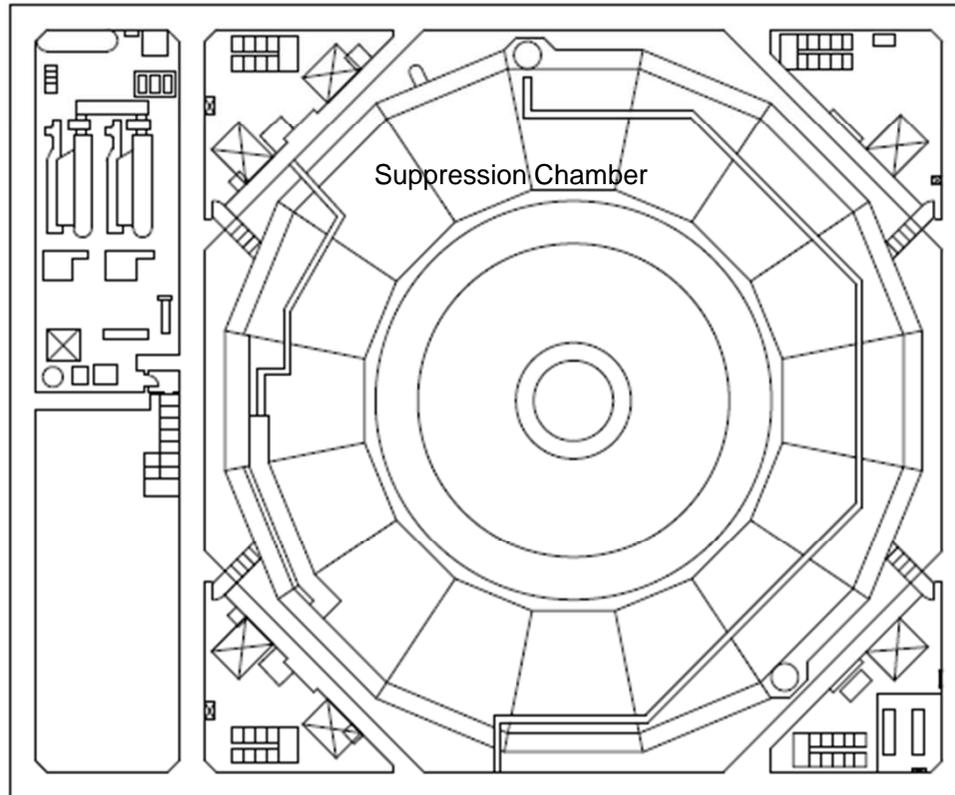

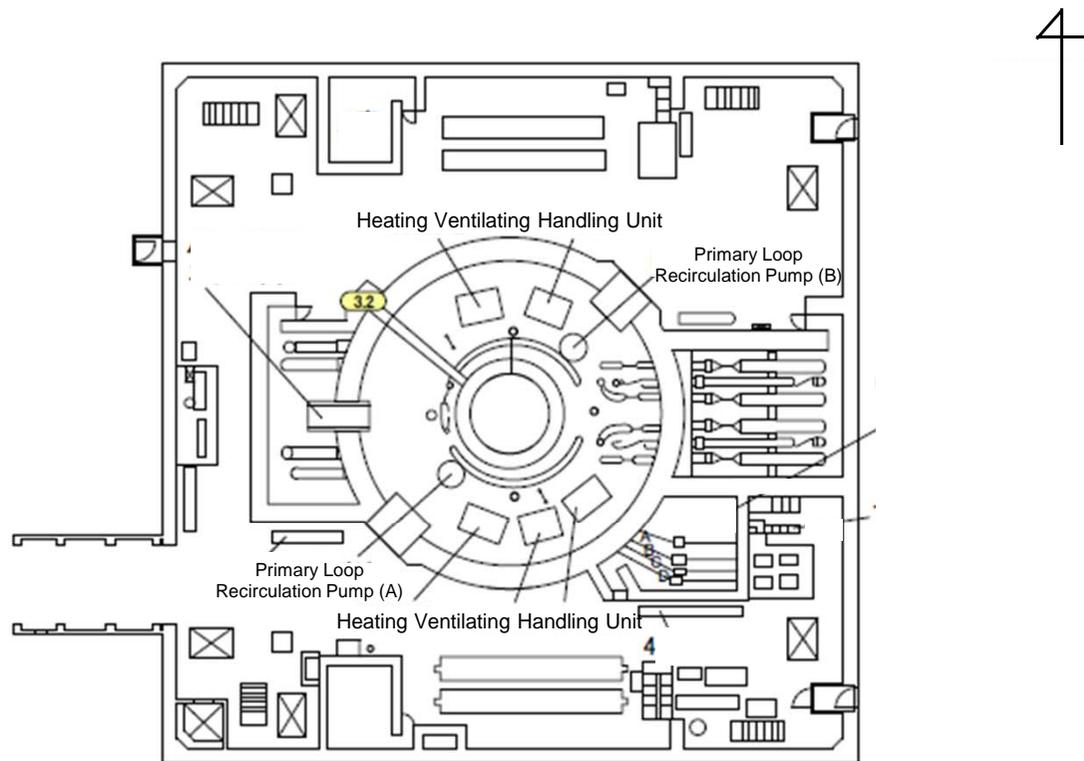


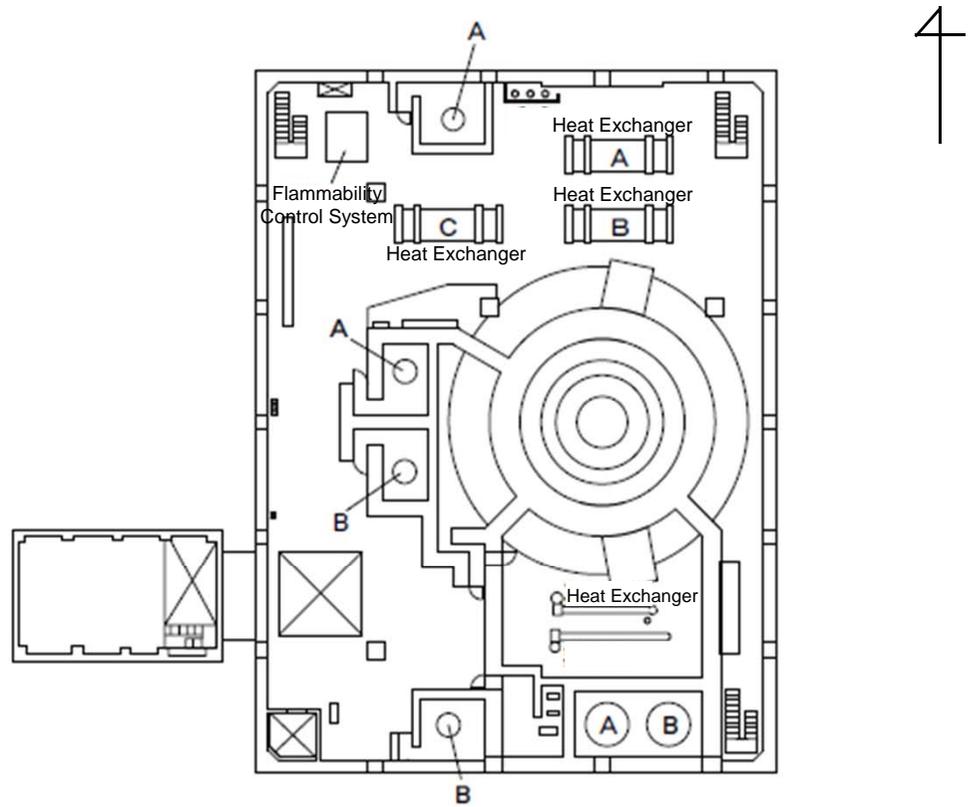


Fukushima Daiichi NPS

Unit 2 Reactor Building 3rd Floor

[mSv/h]

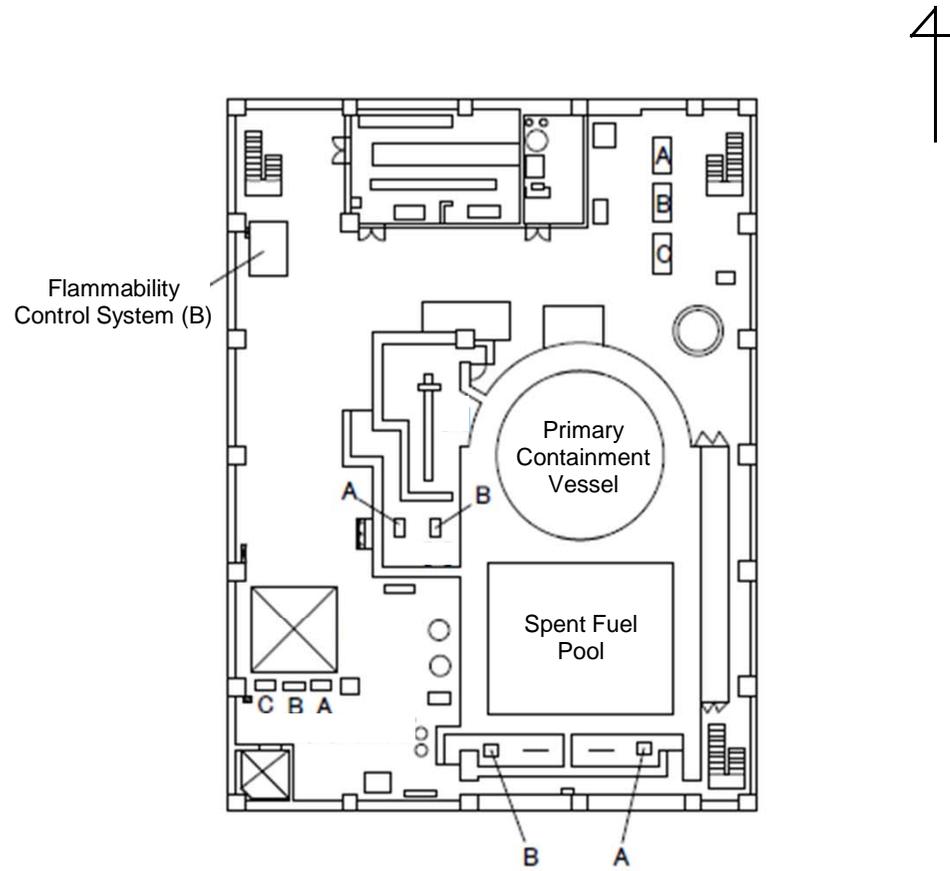

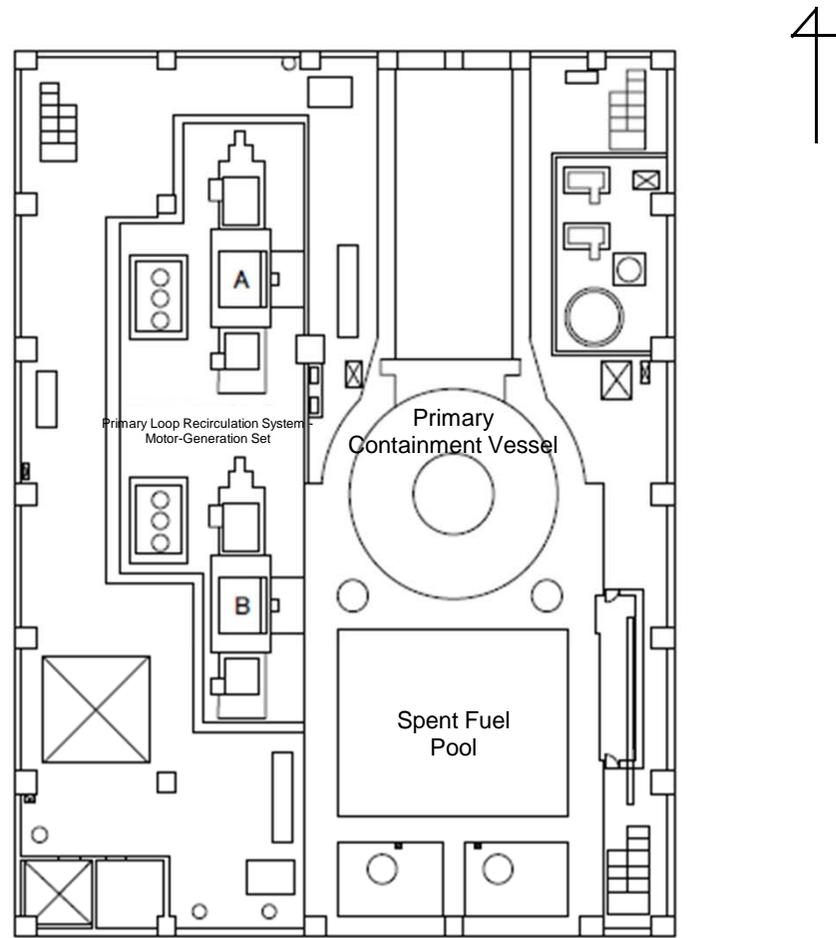

Fukushima Daiichi NPS

Unit 2 Reactor Building 5th Floor

[mSv/h]

