


### Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

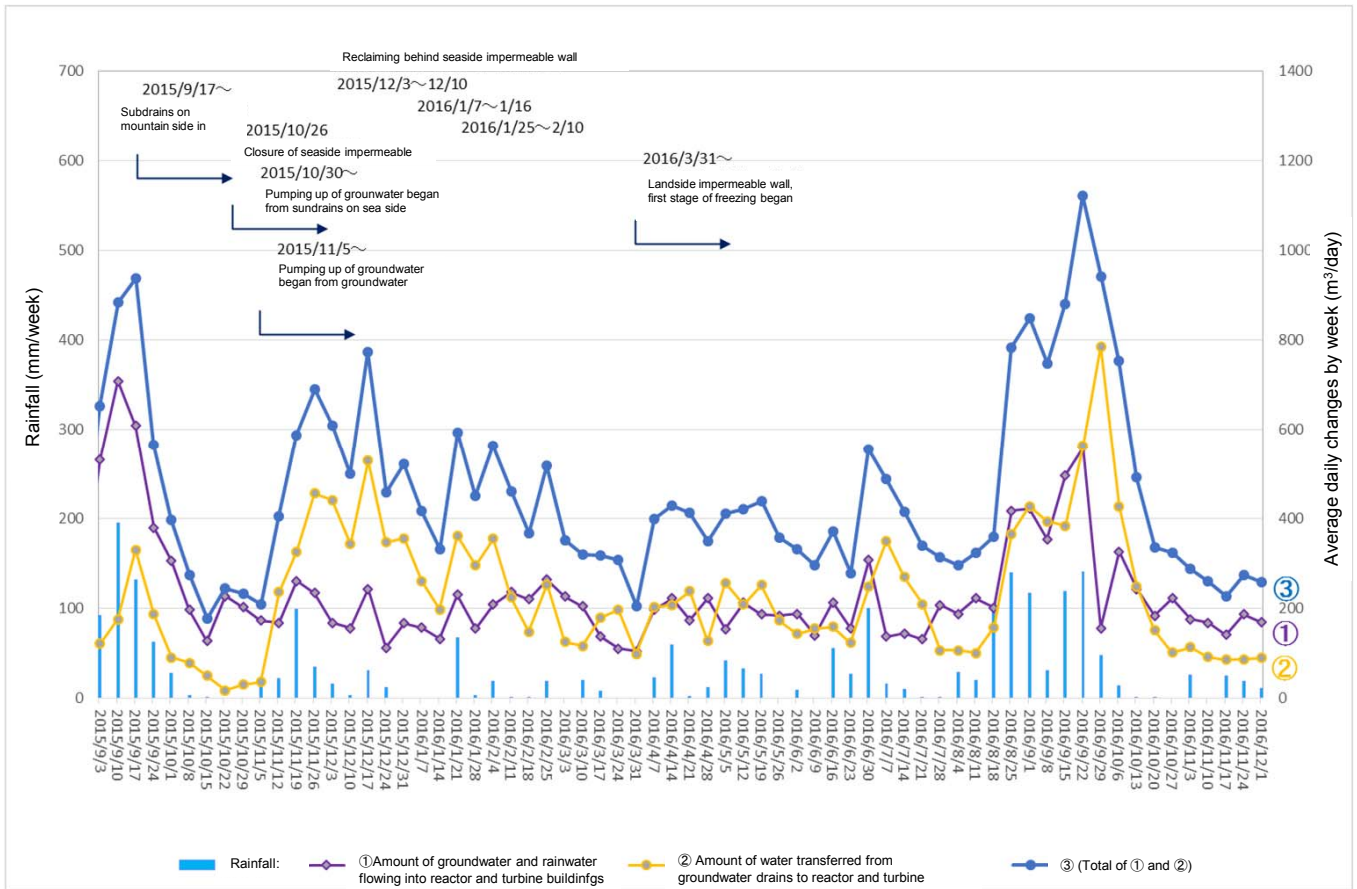

### Amount of water transferred from groundwater drains to reactor and turbine buildings (From November 24 to November 30, 2016/ 24 hours per day)

[m³/day]

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
Nov. 24	45	0	0	45	42	0	0	42	87
Nov. 25	45	0	0	45	42	0	0	42	87
Nov. 26	44	0	0	44	35	0	0	35	79
Nov. 27	42	0	0	42	39	0	0	39	81
Nov. 28	44	31	0	75	44	2	0	46	121
Nov. 29	45	2	0	47	42	4	0	46	93
Nov. 30	45	0	0	45	39	0	0	39	84

\* ①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 187m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 87m³/day, ③(Total of ① and ②): 274m³/day, Rainfall: 18.5mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.