


## Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

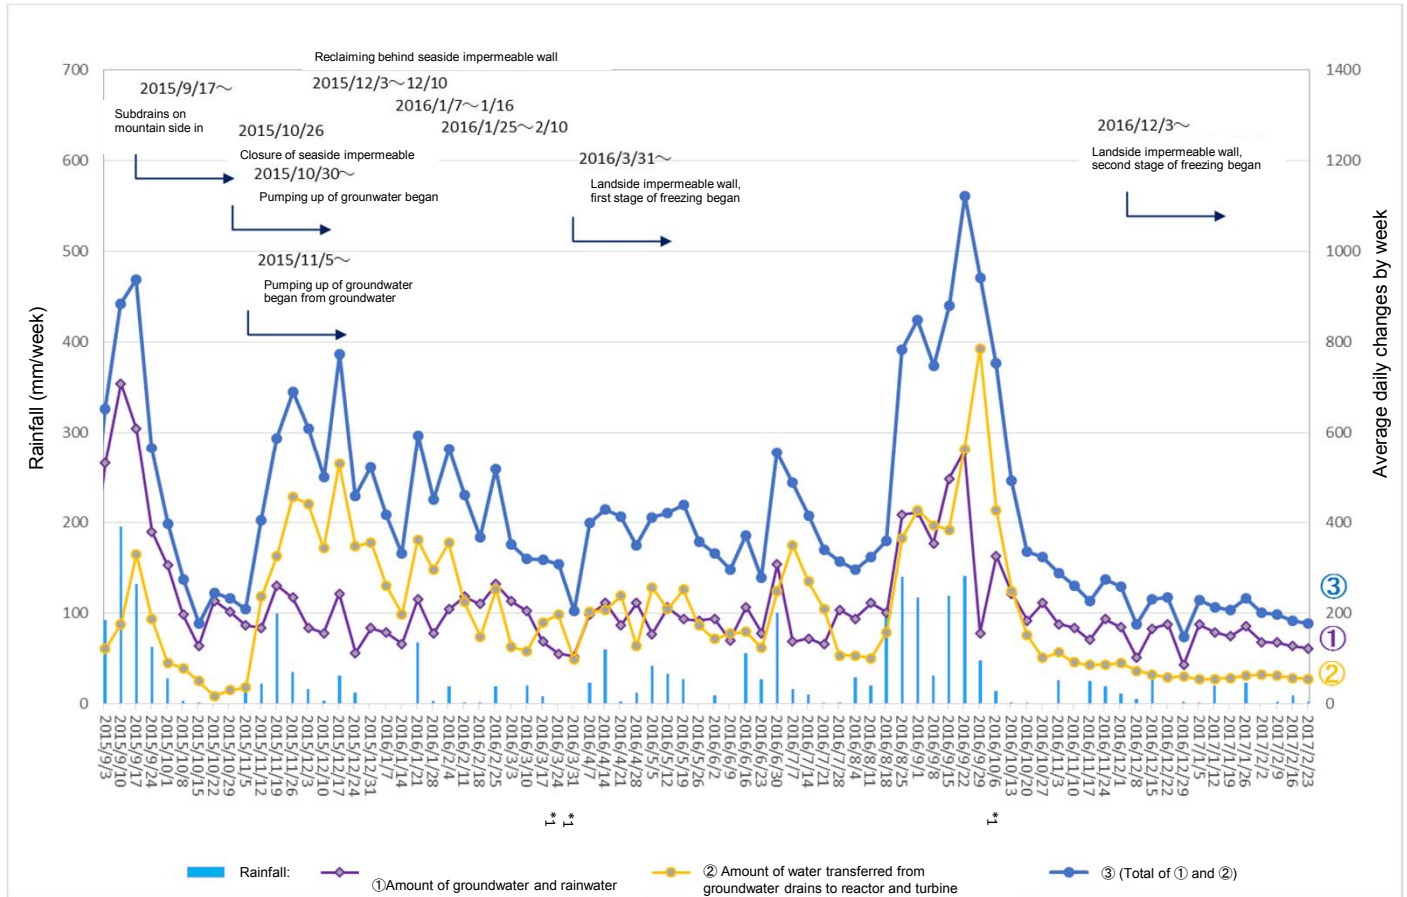

### Amount of water transferred from groundwater drains to reactor and turbine buildings

(From February 16, 2017 to February 22, 2017/ 24 hours per day)

[m<sup>3</sup>/day]

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
Feb. 16	25	0	0	25	31	0	0	31	56
Feb. 17	25	0	0	25	23	0	0	23	48
Feb. 18	28	0	0	28	36	0	0	36	64
Feb. 19	29	0	0	29	25	0	0	25	54
Feb. 20	25	0	0	25	36	0	0	36	61
Feb. 21	25	0	0	25	20	0	0	21	46
Feb. 22	25	0	0	25	32	0	0	32	57

\*①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 122m<sup>3</sup>/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 55m<sup>3</sup>/day, ③(Total of ① and ②): 177m<sup>3</sup>/day, Rainfall: 2.0mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.