


### Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

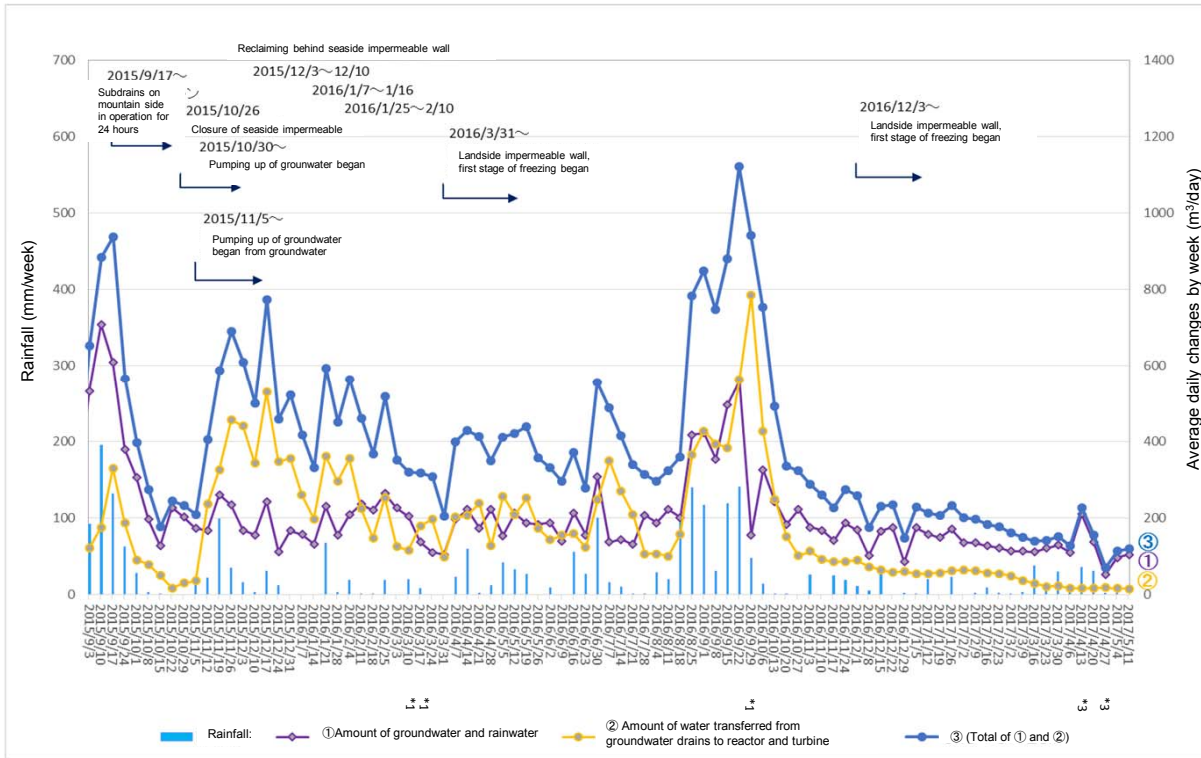

### Amount of water transferred from groundwater drains to reactor and turbine buildings (From May 4, 2017 to May 10, 2017/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
May.4	0	0	0	0	9	0	0	9	9
May.5	0	0	0	0	17	0	0	17	17
May.6	0	0	0	0	17	0	0	17	17
May.7	0	0	0	0	17	0	0	17	17
May.8	0	0	0	0	8	5	0	14	14
May.9	0	0	0	0	16	0	0	16	16
May.10	0	0	0	0	17	0	0	17	17

\*[From Apr 27,2017 to May 3,2017] ① Amount of groundwater and rainwater flowing into reactor and turbine buildings: 97m<sup>3</sup>/day, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: 16m<sup>3</sup>/day, ③ (Total of ① and ②): 113m<sup>3</sup>/day, Rainfall: 2.5mm/week

\*[From May 4,2017 to May 10,2017] ① Amount of groundwater and rainwater flowing into reactor and turbine buildings: 105m<sup>3</sup>/day, ② Amount of water transferred from groundwater drains to reactor and turbine buildings: 15m<sup>3</sup>/day, ③ (Total of ① and ②): 120m<sup>3</sup>/day, Rainfall: 0mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

\*3 The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.