


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

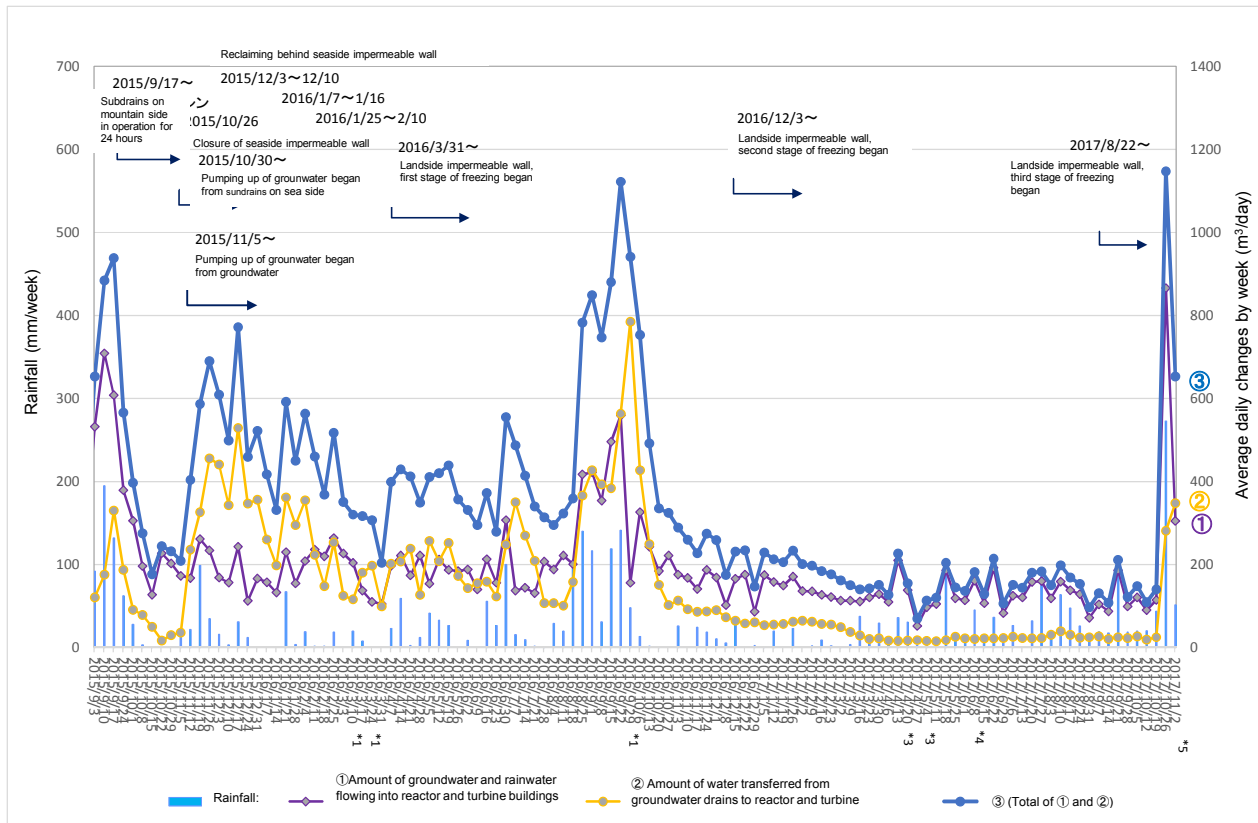

Amount of water transferred from groundwater drains to reactor and turbine buildings (From October 26, 2017 to November 1, 2017/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
Oct.26	151	225	0	376	58	58	7	124	500
Oct.27	128	192	0	320	51	58	25	134	454
Oct.28	143	233	0	376	50	0	7	58	434
Oct.29	137	227	0	364	42	0	9	51	415
Oct.30	109	89	0	198	43	0	14	57	255
Oct.31	156	5	0	161	35	0	7	42	203
Nov.1	124	0	0	124	44	0	7	51	175

*①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 305m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 348m³/day, ③(Total of ① and ②): 653m³/day, Rainfall: 51.5mm/week

*1 Water gauges in reactor and turbine buildings were calibrated.

*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

*3 The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.

*4 The amount of water levels was revision the cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility from June 1, 2017 on.

*5 "①Amount of groundwater and rainwater flowing into reactor and turbine buildings" data of November 2, 2017, was revised.
(The correct data: 305m³/day, The incorrect data: 309m³/day,)