


Water Treatment System Diagram

August 16, 2011
Tokyo Electric Power Company

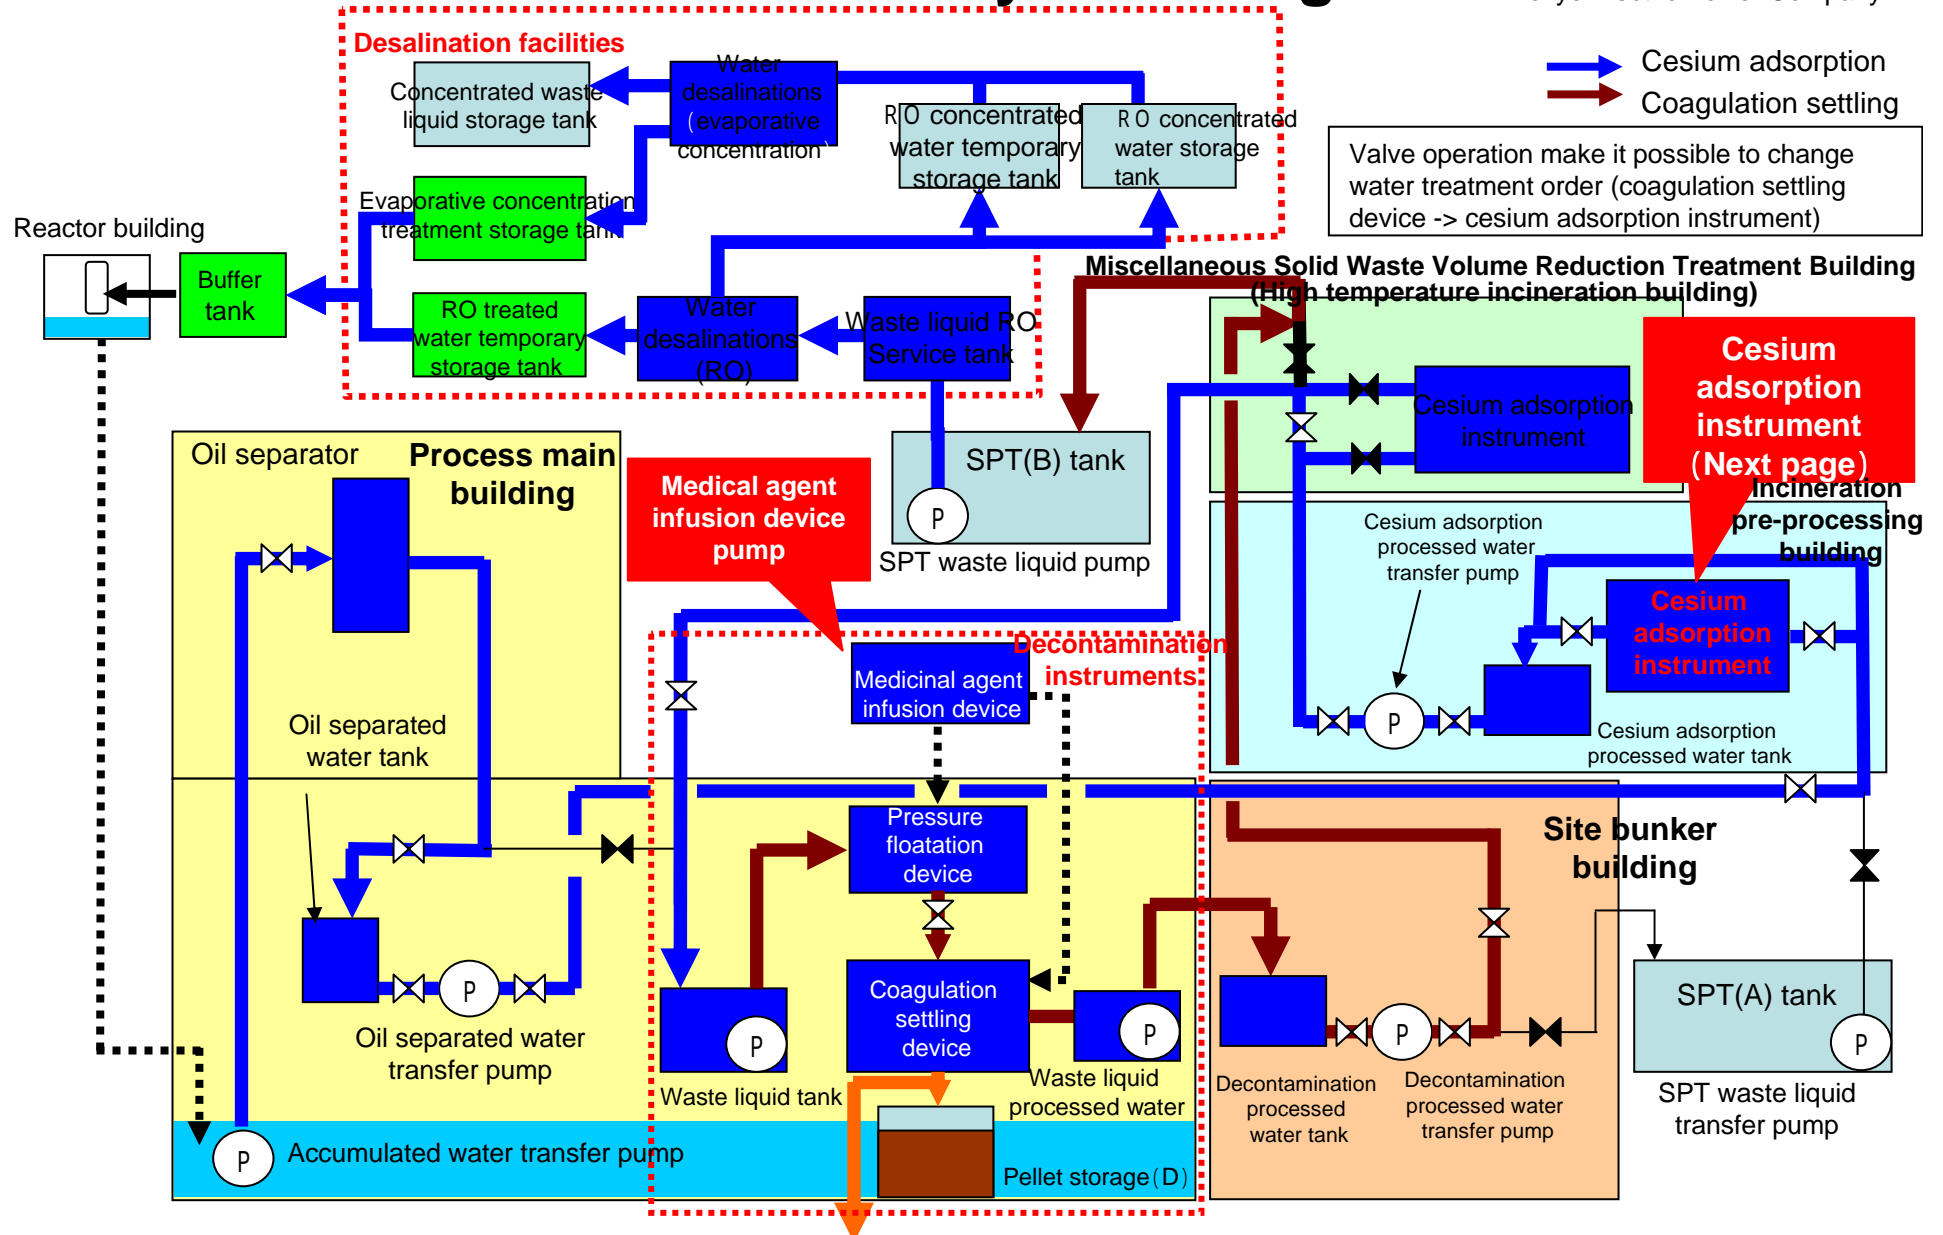

Valve operation make it possible to change water treatment order (coagulation settling device -> cesium adsorption instrument)

Waste sludge storage (Under installation)

Water flow: Process main building → Oil separator → Cesium adsorption instrument (2nd Cesium adsorption instrument) → Coagulation settling device → Water desalinations

Cesium Adsorption Instrument Diagram

August 16, 2011
Tokyo Electric Power Company

