


Survey Status of Trenches etc. at Fukushima Daiichi Nuclear Power Station (Preliminary Report on February 14, 2012)

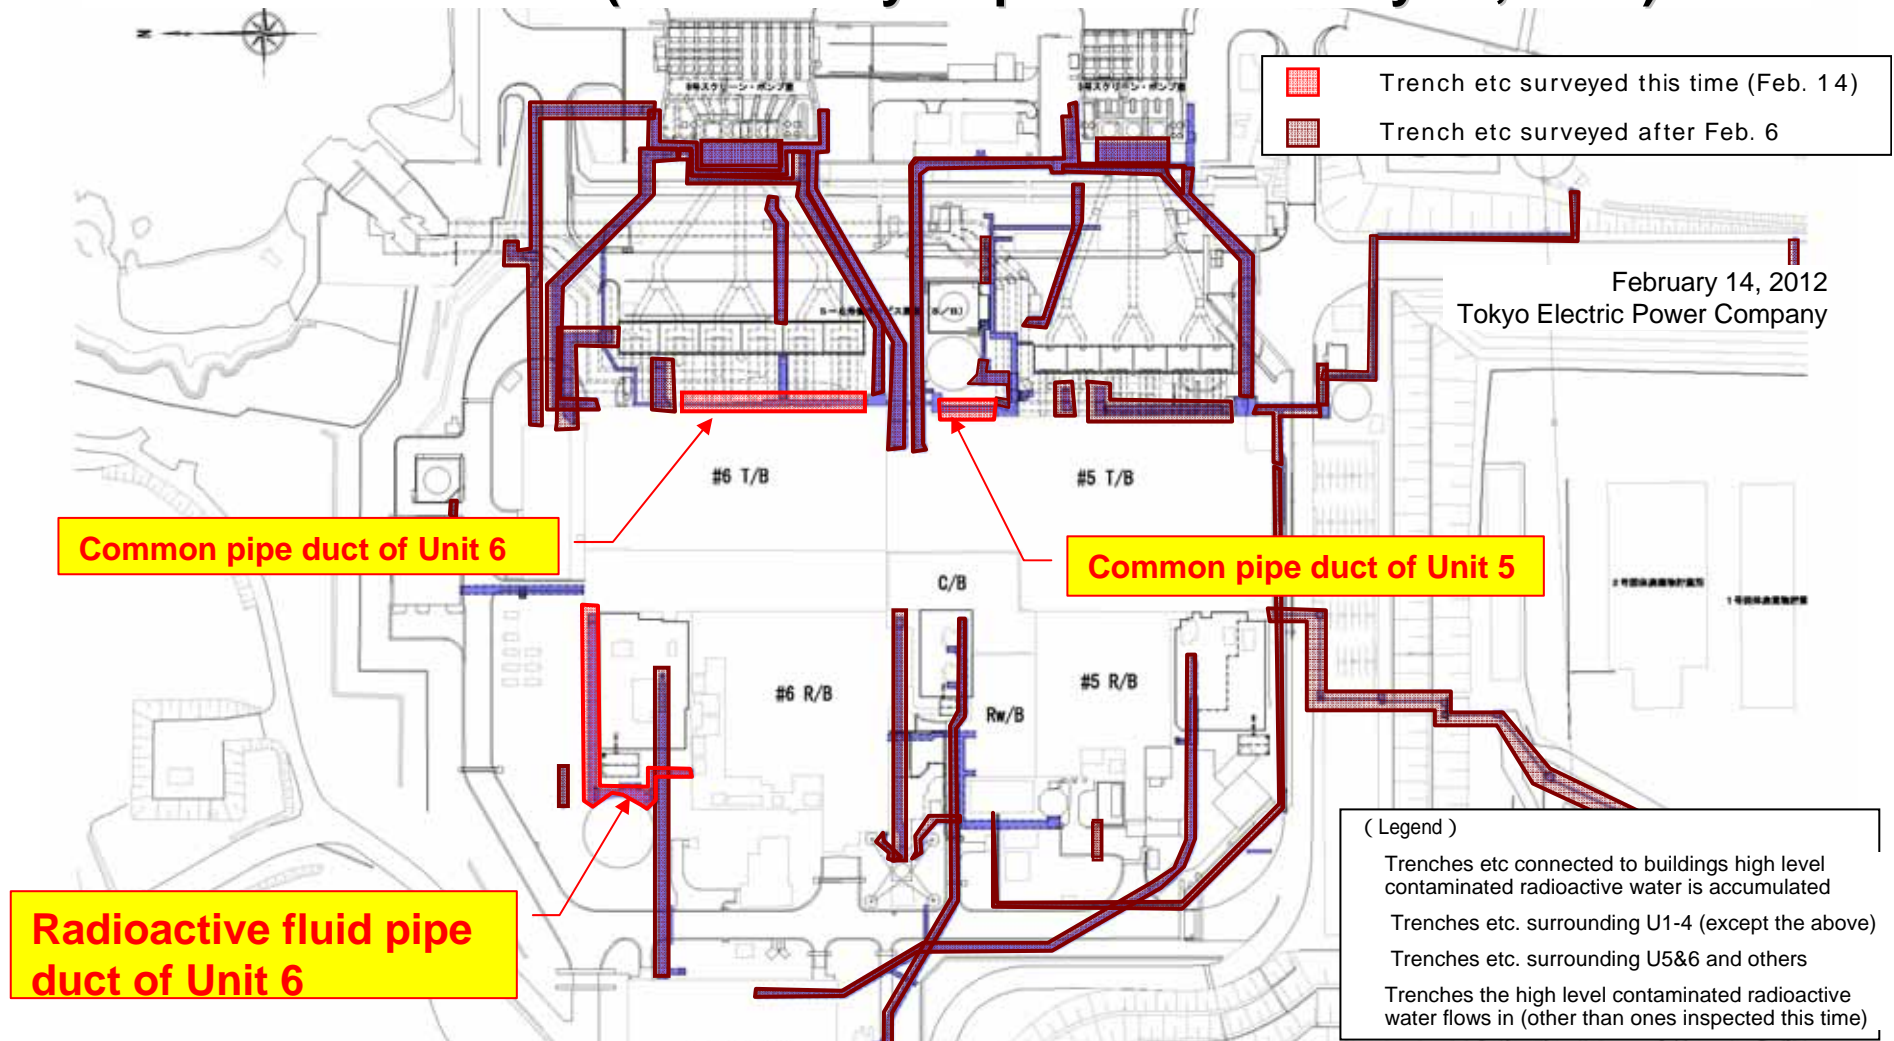

Surveyed on	Place	Accumulated water	Dose rate at the surface of vessels containing samples	Nuclide analysis results (Bq/cm ³)		
				I - 131	C s - 134	C s - 137
2 / 14	Common pipe duct of Unit 6	No	-	-	-	-
	Common pipe duct of Unit 6	No	-	-	-	-
	Radioactive fluid pipe duct of Unit 6	Yes	Approx. 2.0 μSv/h	ND	2.2 × 10 ⁻¹	2.8 × 10 ⁻¹

Fukushima Daiichi Nuclear Power Station: List of result of survey on trenches etc.

February 14, 2012
Tokyo Electric Power Company

【Survey area 】 Trenches connected to Buildings of U1-4, Centralized Radioactive Waste Treatment Facilities

【Survey area 】 Trenches etc. surrounding U1-4 (except trenches etc in area)

Surveyed on	Place	Accumulated water	Dose rate at the surface of vessels containing samples (μ Sv/h)	Nuclide analysis results (Bq/cm ³)			Surveyed on	Place	Accumulated water	Dose rate at the surface of vessels containing samples (μ Sv/h)	Nuclide analysis results (Bq/cm ³)		
				I-131	Cs-134	Cs-137					I-131	Cs-134	Cs-137
1 / 11	In duct connecting U2 to 4 DG	Yes	9.0	ND	1.9×10^0	2.6×10^0	1 / 24	In trench connecting U1 boiler room and electricity room	Yes	1.0	ND	7.9×10^{-1}	1.0×10^0
	In duct connecting water treatment building to U1 T/B	Yes	1.5	ND	8.8×10^{-1}	1.3×10^0		In trench U3&4 Oil pipes	No	-	-	-	-
1 / 12	In U1 chemical tank connection duct	Yes	1.2	ND	2.4×10^0	3.5×10^0	1 / 25	In duct for U4 main transformer cables	Yes	1.0	ND	7.5×10^{-1}	1.0×10^0
	In duct for U3 start-up transformer cables	Yes	1.6	ND	4.9×10^1	6.9×10^1		In connection duct for U1 water surge tank	Yes	2.0	ND	1.2×10^1	1.5×10^1
	In duct for U3 radioactive liquid pipes	No	-	-	-	-		In duct for U1 main transformer cables	Yes	2.0	ND	1.5×10^0	2.3×10^0
1 / 13	In duct for U1 radioactive liquid pipes	Yes	9.0	ND	1.4×10^0	1.9×10^0	1 / 26	In trench for fire extinction pipes	Yes	4.0	ND	ND	1.0×10^{-1}
	In duct for U4 radioactive liquid pipes	Yes	2.5	ND	2.2×10^1	2.8×10^1		In duct for U1 off gas pipes	Yes	3.0	ND	5.5×10^{-1}	8.9×10^{-1}
1 / 16	In duct for U1 intake power cables	Yes	5.5	ND	2.3×10^0	3.2×10^0	1 / 26	In duct for holding up activated charcoal, U1	Yes	1.8	ND	1.6×10^{-1}	2.7×10^{-1}
1 / 17	In duct for U1 backup power cables	Yes	10	ND	5.4×10^{-1}	8.0×10^{-1}		In duct for U2 main transformer cables	Yes	1.2	ND	8.1×10^{-1}	1.1×10^0
	In duct for U2 radioactive liquid pipes	No	-	-	-	-		In connection duct for U2 water surge tank	No	-	-	-	-
	In U3 chemical tank connection duct	No	-	-	-	-		In trench for in house common boiler for U2&3	No	-	-	-	-
	In U4 chemical tank connection duct	Yes	3.0	ND	1.3×10^0	1.7×10^0	In duct for U3 main transformer cables	Yes	1.8	ND	1.4×10^0	1.8×10^0	
1 / 18	In tunnel for U1 seawater pipes	Yes	1.3	ND	2.9×10^{-1}	4.4×10^{-1}	1 / 30	In trench for U2 transformer fire prevention	Yes	9.5	ND	2.1×10^0	3.0×10^0
	In duct for U1 common piles	Yes	1.0	ND	1.0×10^1	1.5×10^1	1 / 31	In duct for U1 start-up transformer cables	Yes	1.3	ND	2.2×10^0	3.0×10^0
	In duct for U1 control cables	Yes	4.5	ND	4.8×10^{-1}	7.1×10^{-1}		In trench to the north of former admin. building	No	-	-	-	-
	In tunnel for U4 seawater pipes	No	-	-	-	-	1 / 19	In tunnel for U2 seawater pipes	No	-	-	-	-
1 / 19	In circular pump discharge valve pit for in U2 pump room	Yes	45	ND	7.1×10^3	9.1×10^3		In circular pump discharge valve pit for in U3 pump room	Yes	21	ND	3.8×10^2	4.8×10^2
	In circular pump discharge valve pit for in U3 pump room	Yes	21	ND	3.8×10^2	4.8×10^2		In duct for common pipes for wastes of Centralized environment Facilities	Yes	5.0	ND	7.3×10^{-1}	9.4×10^{-1}
	In duct for common pipes for wastes of Centralized environment Facilities	Yes	5.0	ND	7.3×10^{-1}	9.4×10^{-1}	1 / 20	In duct for U3 off gas pipes	Yes	4.0	ND	3.1×10^1	4.1×10^1
1 / 20	In duct for U3 off gas pipes	Yes	4.0	ND	3.1×10^1	4.1×10^1	1 / 31	In circular pump discharge valve pit for in U4 pump room*	Yes	1.3	ND	4.5×10^0	6.3×10^0

* Surveyed again since the sampling spot was not correct.

Fukushima Daiichi Nuclear Power Station: List of result of survey on trenches etc.

【Survey area 】 Trenches etc. surrounding U5&6 and others

February 14, 2012
Tokyo Electric Power Company

Surveyed on	Place	Accumulated water	Dose rate at the surface of vessels containing samples	Nuclide analysis results (Bq/cm ³)		
				I-131	Cs-134	Cs-137
2/6	In circular pump discharge valve pit for in U5 pump room	Yes	5.0	ND	1.0 × 10 ⁻¹	1.6 × 10 ⁻¹
	In circular pump discharge valve pit for in U6 pump room	Yes	4.0	ND	1.1 × 10 ⁻¹	1.4 × 10 ⁻¹
	In duct for U5 off gas pipes	No	-	-	-	-
	In duct for U6 off gas pipes	Yes	1.0	ND	1.2 × 10 ⁻¹	1.9 × 10 ⁻¹
	In oil pipe trench (southeast of U5)	No	-	-	-	-
2/7	In duct for U5 intake power cables	Yes	8.0	ND	1.4 × 10 ⁻¹	2.0 × 10 ⁻¹
	In tunnel for U5 seawater pipes	Yes	8.0	ND	8.2 × 10 ⁻²	1.1 × 10 ⁻¹
	In duct for U5 main transformer cables	Yes	10	ND	7.3 × 10 ⁻²	1.3 × 10 ⁻¹
	In duct for U5 start-up transformer cables	Yes	8.0	ND	2.0 × 10 ⁻¹	2.9 × 10 ⁻¹
2/8	In duct for U6 intake power cables	Yes	3.0	ND	1.0 × 10 ⁻¹	8.3 × 10 ⁻²
	In trench for U5&6 storm drain pipes	Yes	4.0	ND	1.7 × 10 ⁻¹	2.5 × 10 ⁻¹
	In duct for U5 radioactive liquid pipes	Yes	3.0	ND	8.0 × 10 ⁻²	1.3 × 10 ⁻¹
	In trench for east of U5 heavy oil pipes	Yes	4.0	ND	2.0 × 10 ⁻¹	2.8 × 10 ⁻¹
2/9	In duct for U6 main transformer cables	Yes	3.0	ND	2.8 × 10 ⁻¹	4.3 × 10 ⁻¹
	In communication cables of U5&6	Yes	4.0	ND	ND	7.2 × 10 ⁻²
	Duct for emergency gas processing pipes	Yes	1.0	ND	4.6 × 10 ⁻¹	6.7 × 10 ⁻¹
	Duct for U5 chemical tank connection	No	-	-	-	-
	In suppression pool water pipe trenches	No	-	-	-	-
	In common suppression pool water surge pipe duct	No	-	-	-	-
	In trench for fire extinction pipes (west to Unit 5)	No	-	-	-	-
2/10	In trench for fire extinction pipes (west to Unit)	No	-	-	-	-
	In trench for fire extinction pipes (south to Unit 5)	No	-	-	-	-
	In seawater pipe duct of U6 (SW system)	Yes	2.0	ND	2.1 × 10 ⁻¹	3.4 × 10 ⁻¹
	In seawater pipe duct of U5 (SW system)	Yes	2.0	ND	1.4 × 10 ⁻¹	1.5 × 10 ⁻¹
	In light oil pipe trenches, No.6	Yes	1.6	ND	2.5 × 10 ⁻¹	3.7 × 10 ⁻¹
	In pipe duct of U6 (pump room ~ MG set building)	Yes	1.6	ND	1.1 × 10 ⁻¹	2.0 × 10 ⁻¹
2/13	In seawater pipe duct of U6 (for north emergency system)	Yes	1.6	ND	ND	1.2 × 10 ⁻¹
	In seawater pipe duct of U6 (for south emergency system)	Yes	1.2	ND	1.4 × 10 ⁻¹	2.0 × 10 ⁻¹
2/13	In water treatment pipe trenches (east to Administration Office Building)	Yes	6.0	ND	2.2 × 10 ⁰	3.3 × 10 ⁰
	In water treatment pipe trenches (east to filtered water tank)	No	-	-	-	-