


Storage amounts of ALPS-treated water\* broken down by the sums of ratios of concentrations required by law (estimate) : Increase from past data (September 30, 2020)/Breakdown of the amount of water stored in repurposed tanks and estimate of the sum of ratios of concentrations required by law

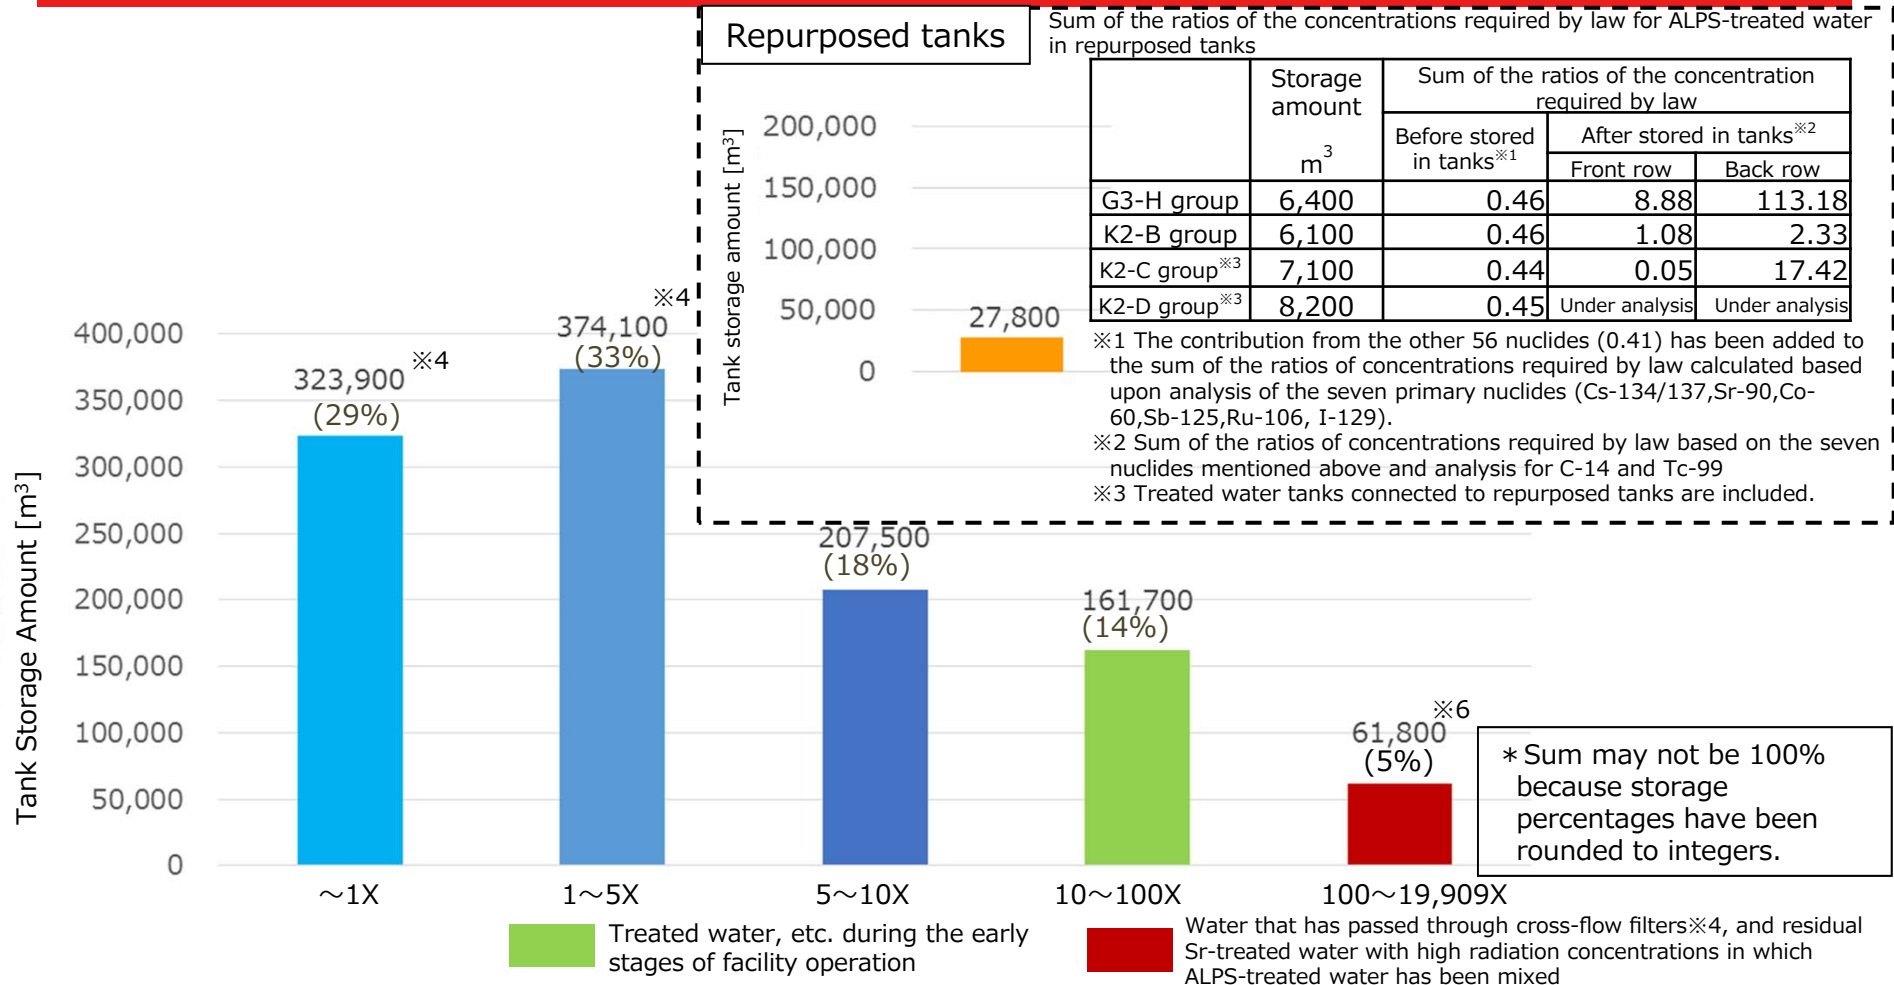

- ※4 Includes ALPS treated water that was additionally transferred (after October, 2018) after measuring radiation concentrations. Since only a small amount of water was additionally transferred the estimated sum of the ratios of concentrations required by law for the 62 nuclides in the relevant tank groups has been deemed to be the same as the value calculated from actual measurement results.
- ※5 In FY2013, slurry treated to remove carbonate precipitation treatment was accidentally allowed to flow out of the facility outlet due to a nonconformance with the existing ALPS cross-flow filter.
- ※6 Reflects 1,400 m3 decrease in storage amounts from the end of September in conjunction with secondary treatment performance confirmation tests.