

Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Temperature (Typical Points)

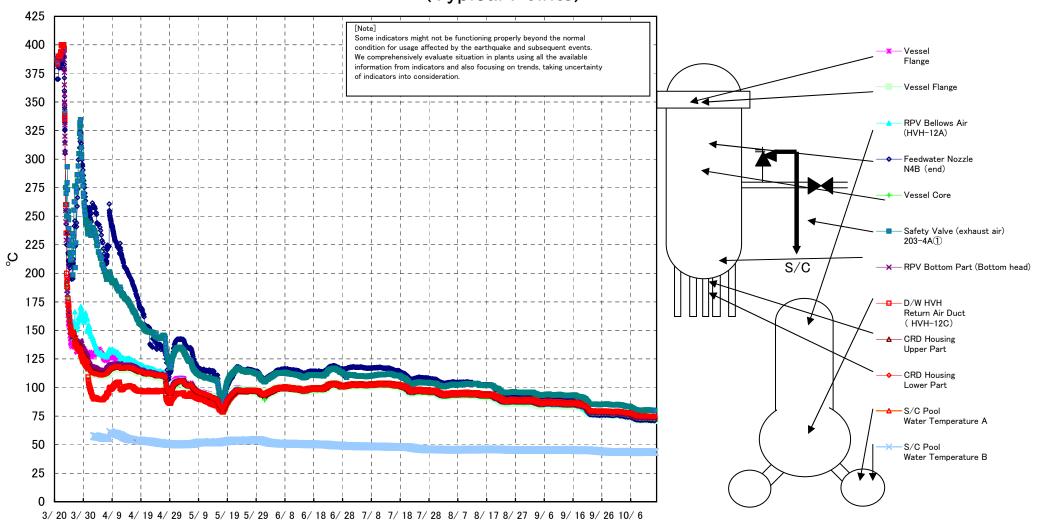

Fukushima Daiichi Nuclear Power Station Unit 1 Parameters of Temperature (Feedwater Nozzle and Safety Valve (Exhaust Air)) Some indicators might not be functioning properly beyond the normal Continuously measured temperatures of

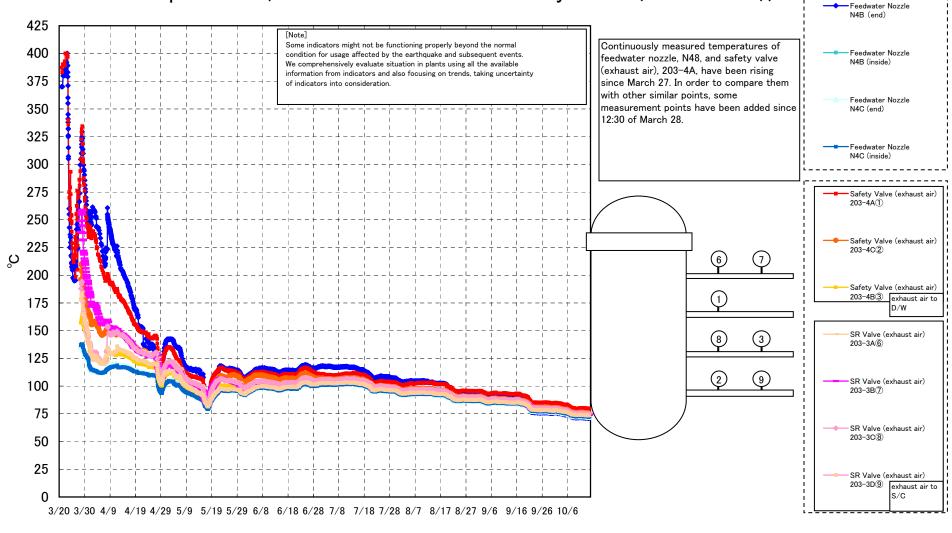

Fukushima Daiichi Nuclear Power Station Unit1 Parameters of Temperature

[Note]
Some indicators might not be functioning properly beyond the normal condition for usage affected by the earthquake and subsequent events.
We comprehensively evaluate situation in plants using all the available information from indicators and also focusing on trends, taking uncertainty

			unot amy																			
Date	Vessel Flange	Flange	Feedwater Nozzle N4B (end)	Feedwater Nozzle N4B (inside)	Feedwater Nozzle N4C (end)	Feedwater Nozzle N4C (inside)	Vessel Core	Part (Bottom head)	Upper Part	CRD Housing Lower Part	Safety Valve (exhaust air) 203-4A(1)	Safety Valve (exhaust air) 203-4C(2)	Safety Valve (exhaust air 203-48(3)			(exhaust air) 203-3C(8)		(HVH-12C)	RPV Bellows Air (HVH-12A)	re A	S/C Pool Water Temperatu re B	note
10/8 5:00	72.2	72.1	71.6	73.6	72.6	72.9	73.3	73.7	75.0	75.0		76.1	74.8		74.6	75.5	74.0	75.0	72.4	43.5	43.3	<u> </u>
10/8 11:00	72.4	72.3	71.8	73.6	72.8	73.0		73.8	75.0	75.1	80.2	76.2	74.9	75.1	74.8	75.7	74.1	75.1	72.6	43.5	43.3	
10/8 17:00	72.5	72.4	72.0	73.8	73.0	73.2	73.6	73.9	75.2	75.2		76.3	75.0	75.2	74.9	75.7	74.3	75.1	72.8	43.5	43.3	<u> </u>
10/8 23:00	72.2	72.1	71.6	73.5	72.7	72.9	73.2	73.6	75.5	75.0		76.1	74.7	74.8	74.5	75.4	74.0	74.9		43.5	43.5	<u> </u>
10/9 5:00	72.0	71.9	71.4	73.3	72.4	72.6	73.0	73.5	74.7	74.8		75.8	74.5	74.6	74.3	75.2	73.7	74.7		43.5	43.3	
10/9 11:00	72.1	72.0	71.5	73.3	72.5	72.8	73.1	73.5	74.8	74.8	79.8	76.0	74.6	74.8	74.5	75.3	73.9	74.8		43.5	43.4	
10/9 17:00	72.3	72.2	71.7	73.5	72.7	73.0		73.8	74.9	75.0		76.1	74.8	75.0		75.5	74.0	74.9		43.6	43.4	
10/9 23:00	72.1	72.0	71.5	73.3	72.5	72.8	73.1	73.6	74.8	74.9		76.0	74.6	74.8	74.5	75.4	73.9	75.0		43.6	43.4	
10/10 5:00	72.1	72.0	71.5	73.4	72.5	72.7	73.1	73.6	74.8	74.9		75.9	74.6	74.8	74.5	75.4	73.8	74.8		43.6	43.4	
10/10 11:00	72.1	72.1	71.6	73.3	72.6	72.8	73.2	73.6	74.8	74.9		76.0	74.7	74.8	74.6	75.4	73.9	74.8		43.6	43.4	
10/10 17:00	72.4	72.4	71.9	73.6	72.8	73.1	73.4	73.9	75.0	75.1	80.3	76.3	74.9	75.2		75.7	74.1	75.0	72.8	43.6	43.4	
10/10 23:00	72.2	72.2	71.7	73.4	72.7	72.9	73.2	73.7 73.7	74.9	75.0		76.2 76.1	74.8	75.0		75.6	74.0	75.0		43.6	43.4 43.4	
10/11 5:00	72.1 72.2	72.1 72.1	71.6	73.4 73.3	72.6 72.6	72.8 72.9	73.2 73.2	73.7	74.8 74.8	74.9 74.9		76.1 76.1	74.7 74.7	74.9 74.9	74.6 74.7	75.5 75.5	73.9 73.9	74.9 74.9		43.6 43.6	43.4	
10/11 11:00 10/11 17:00	72.4	72.3	71.6 71.8	73.6	72.8	73.1	73.4	73.8	75.0	75.0		76.3	74.7	74.9	74.7	75.7	74.1	75.0		43.6	43.4	
10/11 17:00	72.4	72.2	71.7	73.5	72.7	73.1	73.4	73.8	74.9	75.0		76.3	74.9	75.0		75.6	74.1	74.9		43.6	43.4	
10/11 23:00	71.9	71.9	71.7	73.2	72.4	72.9	73.0	73.4	74.9	74.8		75.9	74.6	74.7		75.3	73.7	74.9		43.6	43.4	
10/12 5:00	72.0	71.9	71.4	73.2	72.4	72.6	73.0	73.4	74.7	74.8		76.0	74.5	74.7		75.3	73.7	74.7		43.6	43.4	
10/12 17:00	72.2	72.1	71.4	73.4	72.6	72.9	73.2	73.7	74.7	74.0	80.3	76.1	74.7	74.7	74.7	75.5	73.7	74.7	72.6	43.6	43.4	
10/12 17:00	71.8	71.8	71.0	73.1	72.3	72.5	72.9	73.4	74.6	74.7	80.1	75.8	74.4	74.6	74.3	75.2	73.6	74.6		43.6	43.5	
10/12/23.00	71.0	71.7	71.2	73.0	72.2	72.4	72.8	73.2	74.5	74.6		75.8	74.4	74.5	74.2	75.1	73.5	74.5		43.7	43.4	
10/13 11:00	72.0	71.9	71.4	73.2	72.4	72.7	73.0	73.4	74.6	74.7	80.1	75.9	74.5	74.7		75.3	73.7	74.6		43.6	43.4	
10/13 17:00	72.0	72.0	71.5	73.3	72.5	72.7	73.1	73.5	74.7	74.8		76.0	74.6	74.9	74.6	75.4	73.8	74.7		43.6	43.5	
10/13 23:00	71.7	71.7	71.2	73.0	72.2	72.4	72.8	73.3	74.5	74.6	79.9	75.8	74.3	74.5	74.2	75.0	73.5	74.5		43.6	43.4	
10/14 5:00	71.5	71.4	70.9	72.8	71.9	72.2	72.6	73.1	74.3	74.4		75.5	74.1	74.2		74.8	73.3	74.3		43.6	43.4	
10/14 11:00	71.8	71.7	71.2	73.0	72.2	72.4	72.8	73.2	74.4	74.5		75.7	74.3	74.5	74.2	75.0	73.5	74.4		43.6	43.4	