Fukushima Daiichi Nuclear Power Station Unit 2 Parameters of Temperature

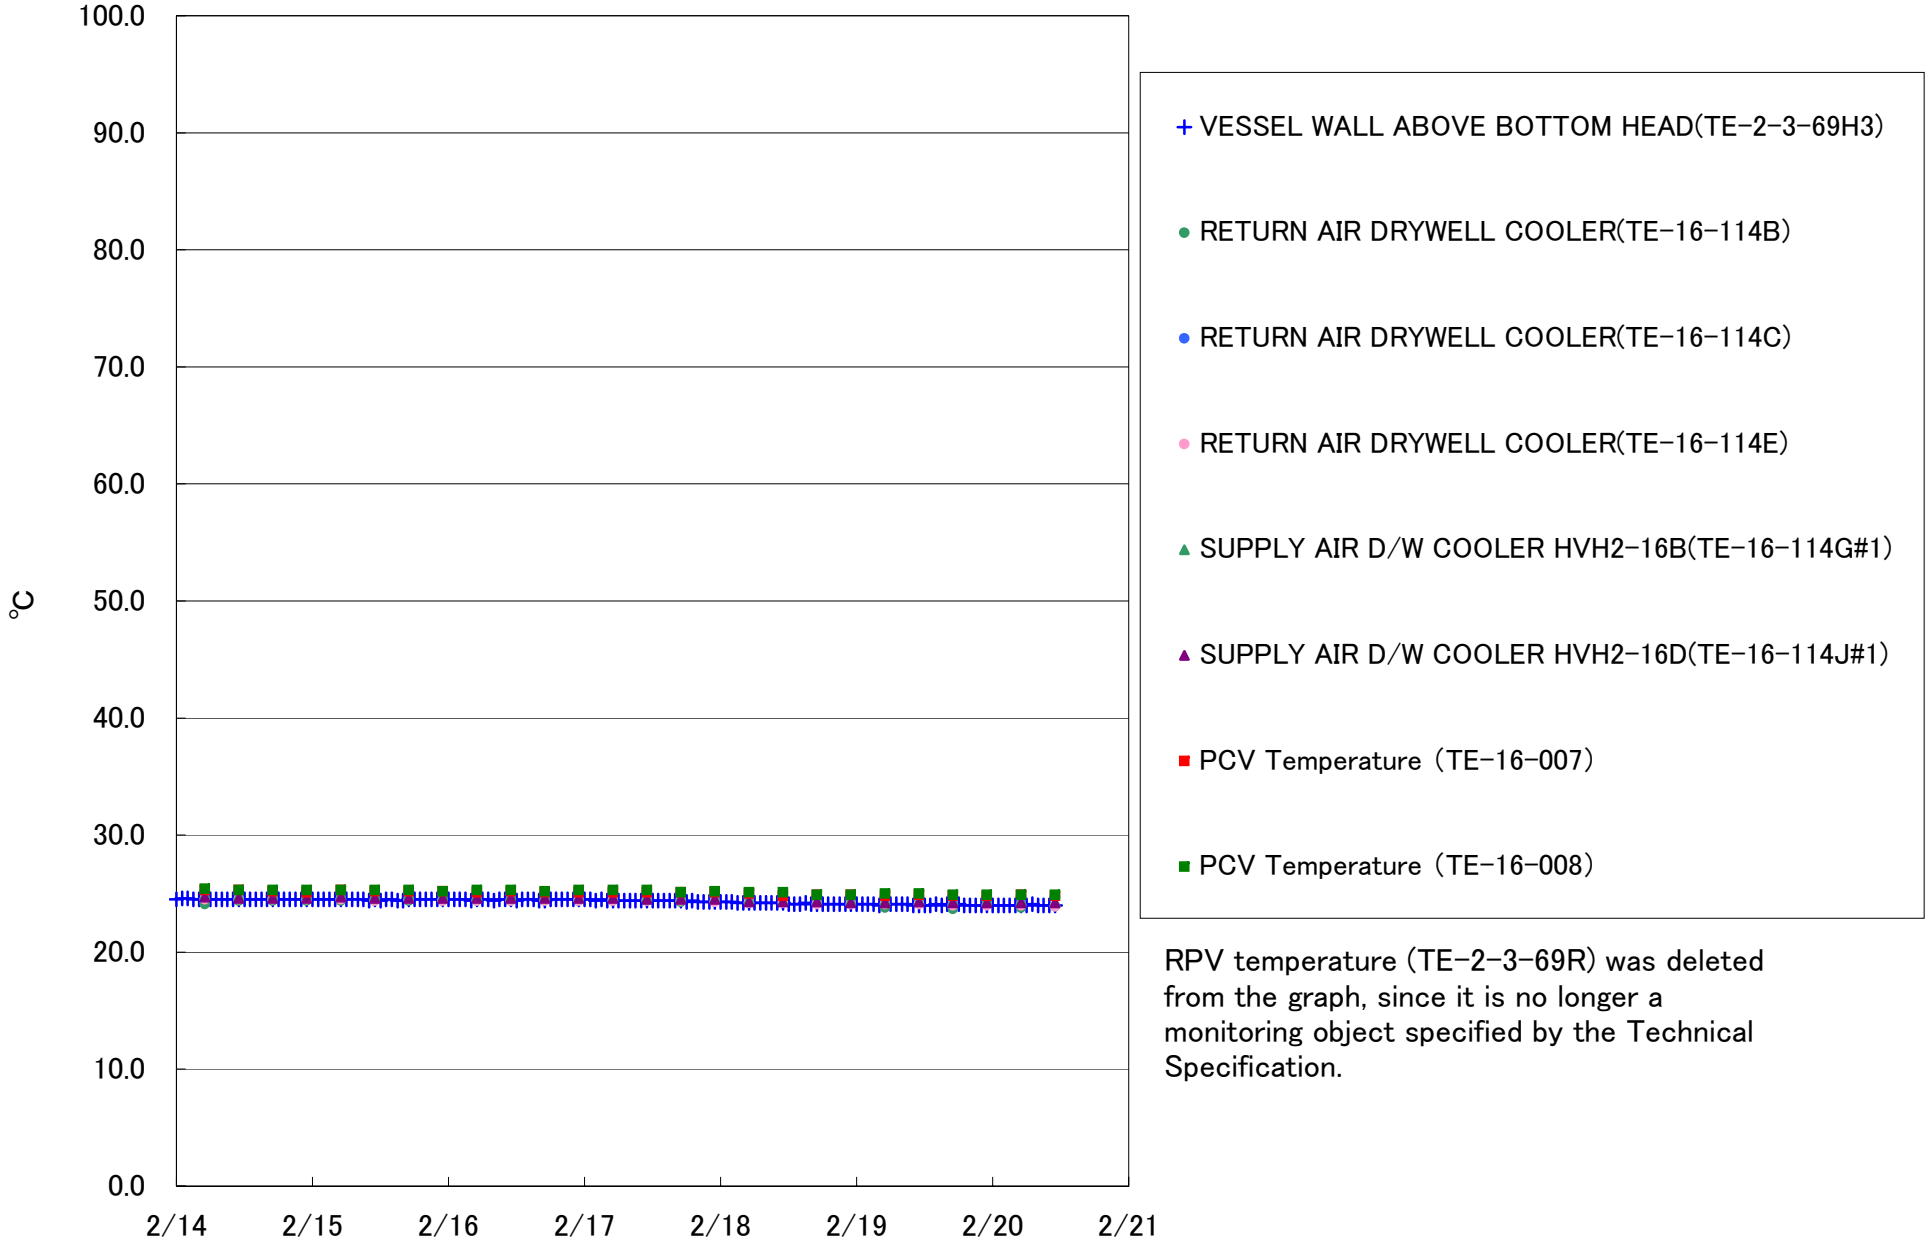

RPV temperature (TE-2-3-69R) was deleted from the graph, since it is no longer a monitoring object specified by the Technical Specification.