

Reference

Nuclide Analysis Results of Radioactive Materials in the Air at the Sites of Fukushima Nuclear Power Stations

(Data summarized on March 6)

Place of Sampling	West Gate of Fukushima Daiichi NPS		MP-1 of Fukushima Daini (Reference)				Density limit by the announcement of Reactor Regulation (Bq/cm ³) (Density limit in the air to which radiation workers breathe in the section 4 of the appendix 2)
Time of Sampling	Mar.05, 2012 7:00 am ~ 12:00 pm		Mar.05, 2012 9:50 am ~ 10:00 am				
Detected Nuclides (Half-life)	density of sample (Bq/cm ³)	Scaling Factor (/)	density of sample (Bq/cm ³)	Scaling Factor (/)	density of sample (Bq/cm ³)	Scaling Factor (/)	
I-131 (about 8 days)	ND	-	ND	-	/	/	1E-03
Cs-134 (about 2 years)	ND	-	ND	-	/	/	2E-03
Cs-137 (about 30 years)	ND	-	ND	-	/	/	3E-03

* The value of radioactivity density is the sum of the value of volatile nuclide's density and the value of particulate nuclide's density.

O.OE - O means O.O x 10-O

Data of other nuclides are under examination.

* In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

* "ND" means the sampled data is below measurable limit.

Detection limits at the West Gate of Fukushima Daiichi are as follows:

Volatile: I-131: approx. 1E-7Bq/cm³, Cs-134: approx. 3E-7Bq/cm³, Cs-137: approx. 3E-7Bq/cm³
 approx. 2E-7Bq/cm³, Cs-137: approx. 2E-7Bq/cm³

 Particulate: I-131: approx. 6E-8Bq/cm³, Cs-134: approx. 2E-7Bq/cm³, Cs-137: approx. 2E-7Bq/cm³

Detection limits at MP-1 of Fukushima Daini are as follows:

Volatile: I-131: approx. 2E-6Bq/cm³, Cs-134: approx. 3E-6Bq/cm³, Cs-137: approx. 3E-6Bq/cm³
 134: approx. 2E-6Bq/cm³, Cs-137: approx. 1E-6Bq/cm³

 Particulate: I-131: approx. 8E-7Bq/cm³, Cs-134: approx. 2E-6Bq/cm³, Cs-137: approx. 1E-6Bq/cm³

Result of the Pu analysis in the atmosphere at Fukushima Daiichi Nuclear Power Station

1. Sampling location: West gate, Fukushima Daiichi NPS
2. Institution conducting the analysis : Japan Chemical Analysis Center
3. Result of the analysis :

(Unit : Bq/cm³)

Samples	Date of sampling	Pu-238	Pu-239+Pu-240
Volatile	February 13	N.D. [$<6.6 \times 10^{-10}$]	N.D. [$<6.9 \times 10^{-10}$]
Particulate		N.D. [$<9.5 \times 10^{-10}$]	N.D. [$<8.2 \times 10^{-10}$]


[] indicates the detection limit

4. Evaluation:

No Pu-238, Pu-239+Pu-240 was detected from samples this time.

End

West Gate of Fukushima Daiichi Nuclear Power Station
Results of Dust Nuclide Analysis (Bq/cm³)

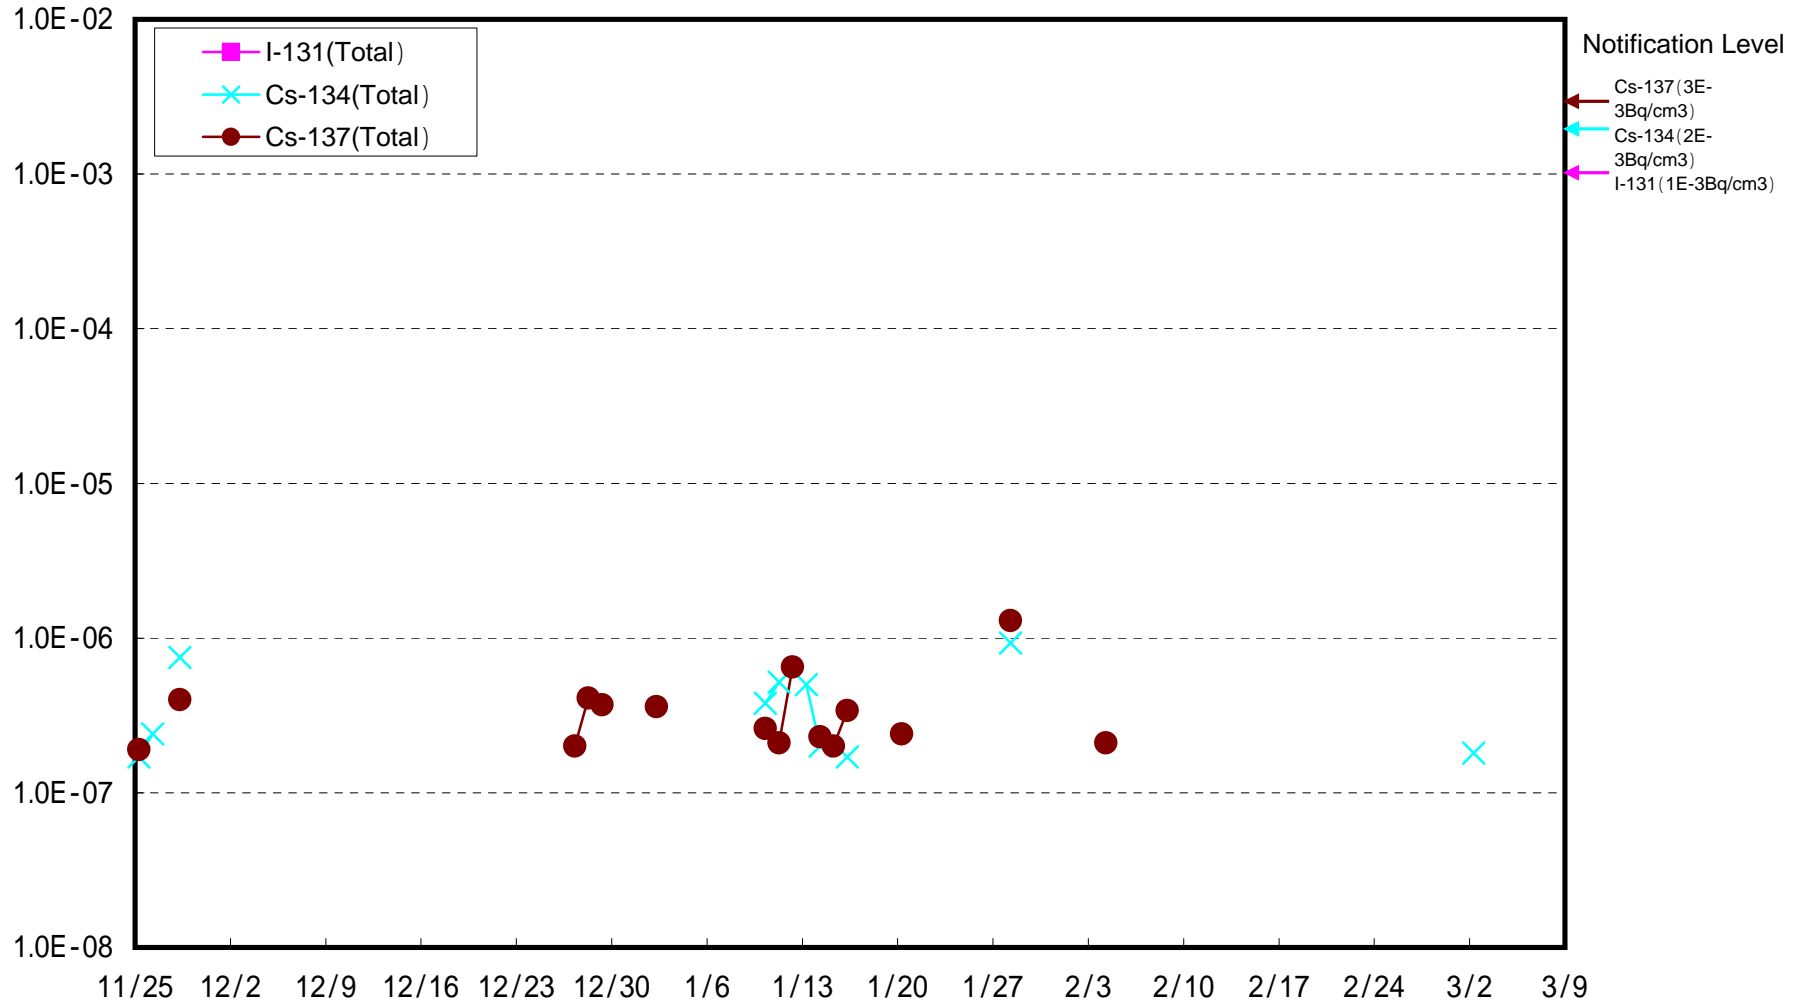

(Reference) Fukushima Daini MP-1
Results of Dust Nuclide Analysis (Bq/cm³)

