

## Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Pumped Water Obtained from Bank Protection)


Unit: Bq/L

		Pumped water from groundwater observation hole No.0-3-2	Pumped water from groundwater observation hole No.1-16
Date of Sampling		Dec 13, 2013	12月13日
Time of sampling		12:00 PM	12:00 PM
Cs-134 (Approx. 2 years)		ND(0.41)	3.1
Cs-137 (Approx.30 years)		ND(0.47)	1.3
The other γ	Co-60 (Approx. 5 years)	ND	0.86
	Sb-125 (Approx. 3 years)	ND	5.5
Gross β		ND(18)	1,400,000
H-3 (Approx. 12 years)		68,000	41,000

\* Data announced this time is provided in a thick-frame. The other data was announced on December 14.

\* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

\* "-" indicates that the measurement was out of range.

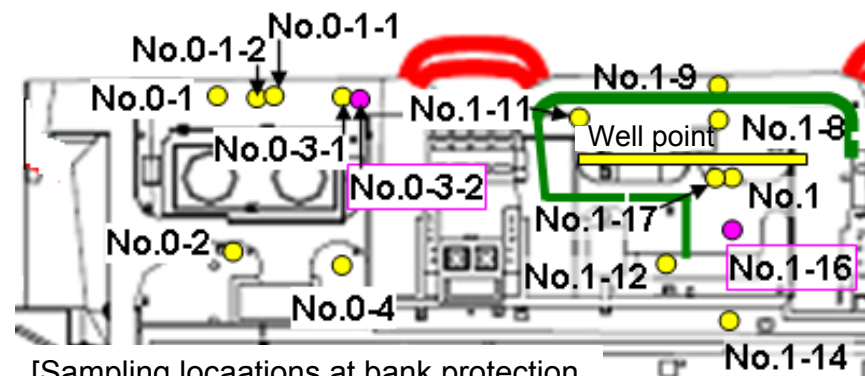

[Sampling locations at bank protection]