


2. Analysis Results of Seawater Obtained around Fukushima Daiichi NPS (Inside of the Port of Fukushima Daiichi NPS)

Unit: Bq/L, "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* The amounts provided at each point are the latest results of "Detailed Analysis Results in the Port, around Discharge Channel and Bank Protection of Fukushima Daiichi NPS".

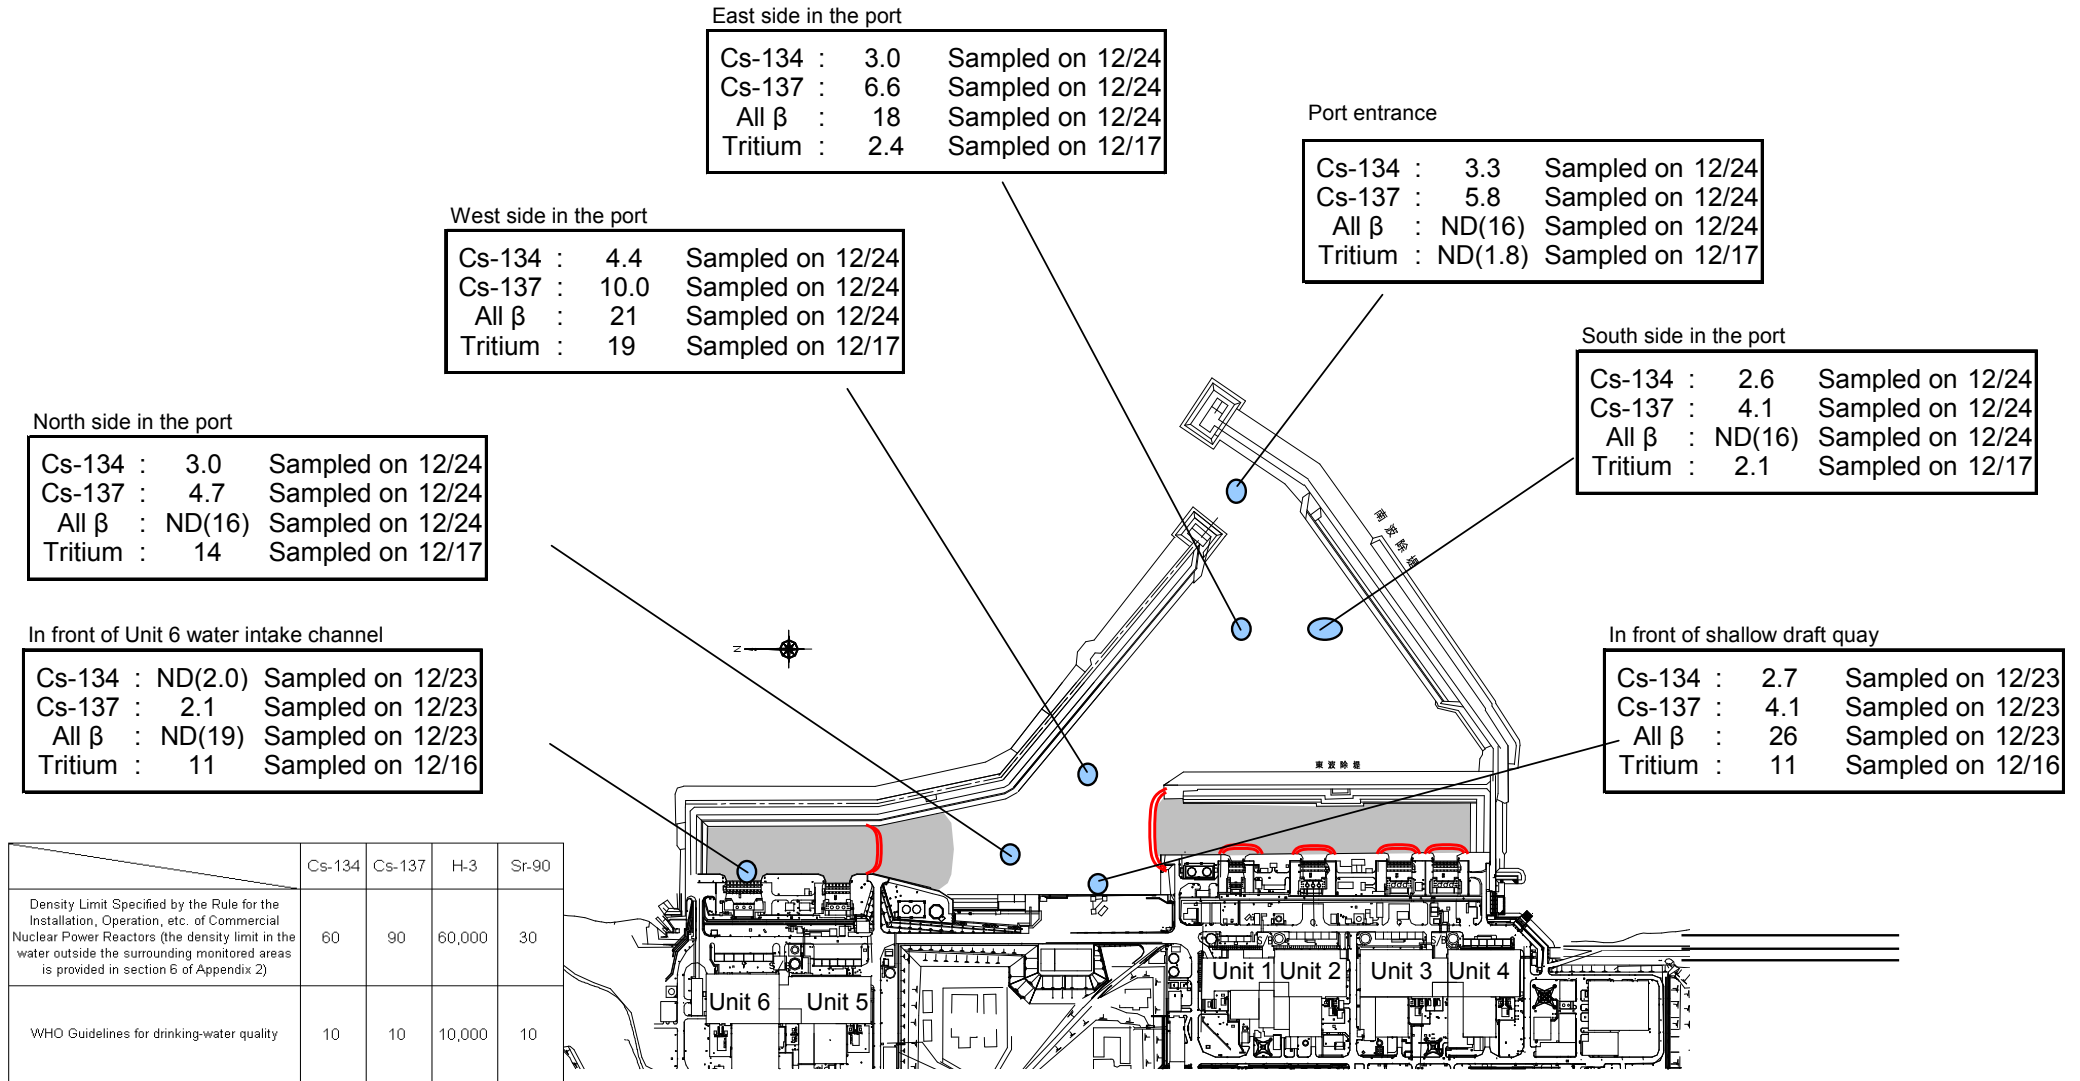

Density Limit Specified by the Rule: Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)