


4. Analysis Results of Groundwater Obtained around Fukushima Daiichi NPS (Unit 1-4 Bank Protection) (1/2)

Unit: Bq/L, "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.



4. Analysis Results of Groundwater Obtained around Fukushima Daiichi NPS (Unit 1-4 Bank Protection) (2/2)

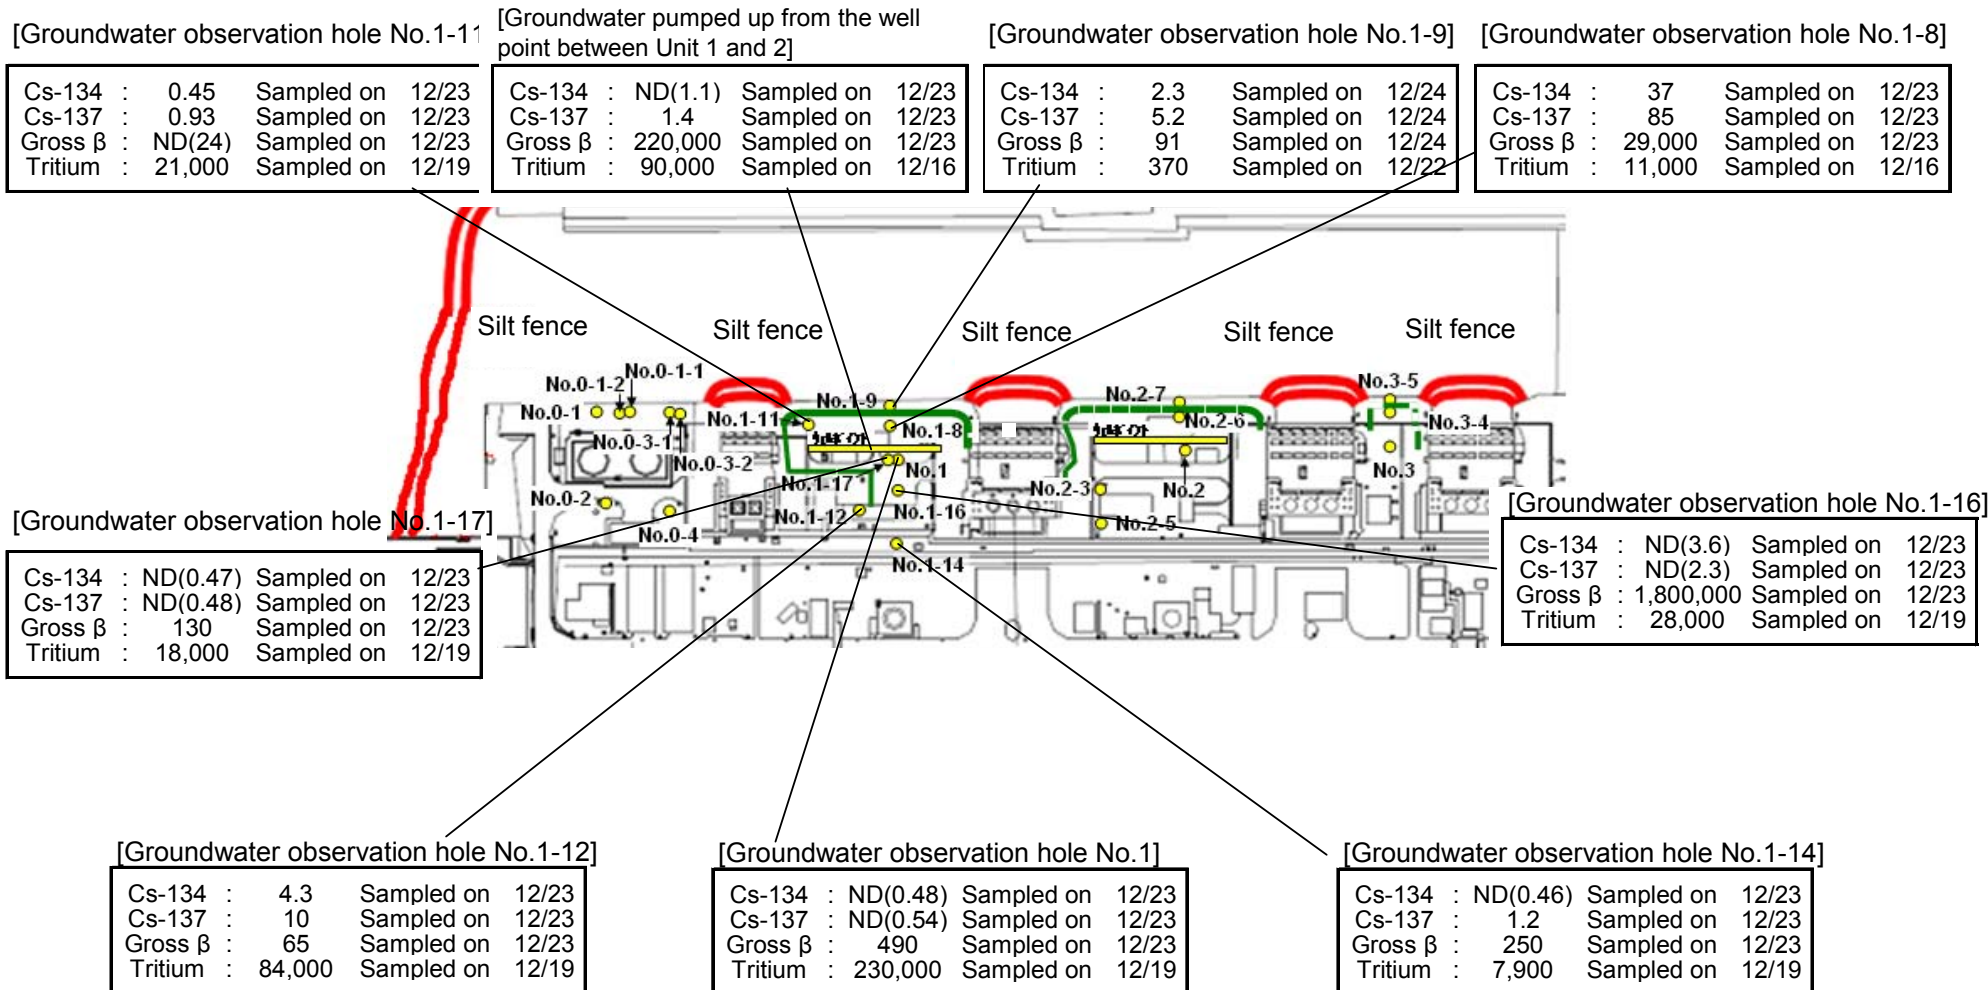

Unit: Bq/L, "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

