

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station >

(Data summarized on January 15)

| Place of Sampling | North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel) | | Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel) | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|----------------------------------|---|-------------------------|--|-------------------------|--|
| Time of Sampling | Jan 14, 2014 7:20 AM | | Jan 14, 2014 5:40 AM | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| I-131 (Approx. 8 days) | ND | - | ND | - | 40 |
| Cs-134 (Approx. 2 years) | ND | - | ND | - | 60 |
| Cs-137 (Approx. 30 years) | 0.79 | 0.01 | ND | - | 90 |

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* Data of other nuclides is under evaluation.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* "ND" indicates that the measurement result is below the detection limit.

I-131: Approx. 0.68Bq/L, Cs-134: Approx. 0.74Bq/L, Cs-137: Approx. 0.75Bq/L

As the detection limit may vary depending on the detectors and sample properties, there are cases where nuclides below the detection limit are detected.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >

(Data summarized on January 15)

| Place of Sampling | North of Unit 5-6 Discharge Channel at Fukushima Daiichi NPS (Approx. 30m North of Unit 5-6 Discharge Channel) | | | | Around South Discharge Channel of Fukushima Daiichi NPS (Approx. 1.3km South of Unit 1-4 Discharge Channel) | | | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|-------------------------------|---|----------------------|---------------------------|----------------------|--|----------------------|---------------------------|----------------------|--|
| | Dec 2, 2013 6:40 AM | | Dec 9, 2013 6:50 AM | | Dec 2, 2013 5:50 AM | | Dec 9, 2013 5:50 AM | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| Cs-134 (Approx. 2 years) | 0.26 | 0.00 | 1.3 | 0.02 | 0.16 | 0.00 | 0.15 | 0.00 | 60 |
| Cs-137 (Approx. 30 years) | 0.63 | 0.01 | 3.0 | 0.03 | 0.40 | 0.00 | 0.36 | 0.00 | 90 |

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by: Tokyo Power Tecnology Ltd.

Nuclides Analysis Result of the Radioactive Materials in the Seawater < Coast, Fukushima Daiichi Nuclear Power Station, Remeasurement >

(Data summarized on January 15)

| Place of Sampling | 2F Around the North Discharge Channel (Around Unit 3-4 Discharge Channel) (Approx. 10km from 1F) | | | | Around Iwasawa Shore of 2F (Approx. 7km South of Unit 1 & 2 Discharge Channel) (Approx. 16km from 1F) | | | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|----------------------------------|--|----------------------|---------------------------|----------------------|---|----------------------|---------------------------|----------------------|--|
| | Dec 3, 2013 10:00 AM | | Dec 11, 2013 3:30 PM | | Dec 3, 2013 7:20 AM | | Dec 10, 2013 7:20 AM | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| Cs-134 (Approx. 2 years) | 0.062 | 0.00 | 0.082 | 0.00 | 0.047 | 0.00 | 0.081 | 0.00 | 60 |
| Cs-137 (Approx. 30 years) | 0.12 | 0.00 | 0.19 | 0.00 | 0.11 | 0.00 | 0.18 | 0.00 | 90 |

* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.

* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by: Tokyo Power Tecnology Ltd.

Nuclides Analysis Result of the Radioactive Materials in the Seawater
< Coast, Fukushima Daiichi Nuclear Power Station, Within 20km Radius >

(Data summarized on January 15)

| Place of Sampling | South side of the Ukedo Port (Approx. 5.5km north of Unit 5-6 Discharge Channel) | | | | ② Density Limit Specified by the Reactor Regulation (Bq/L) (The density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2.) |
|----------------------------------|---|-------------------------|------------------------------|-------------------------|--|
| | Dec 3, 2013 8:55 AM | | Dec 10, 2013 8:45 AM | | |
| Detected Nuclides (Half-life) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | ①Density of Sample (Bq/L) | Scaling Factor (①/②) | |
| Cs-134 (Approx. 2 years) | 0.038 | 0.00 | 0.090 | 0.00 | 60 |
| Cs-137 (Approx. 30 years) | 0.095 | 0.00 | 0.21 | 0.00 | 90 |


* The density specified by the Reactor Regulation is converted from Bq/cm³ to Bq/L.

* In the case of more than 2 nuclides, the sum of scaling factors to density limits is compared to 1.


* Analysis results by detail analysis (Phosphomolybdic acid ammonium adsorption sampling method) are noted.

* Analyzed by: Tokyo Power Tecnology Ltd.


Radioactivity Density of the Seawater at 1F Units 5-6 North Discharge Channel (Bq/L)

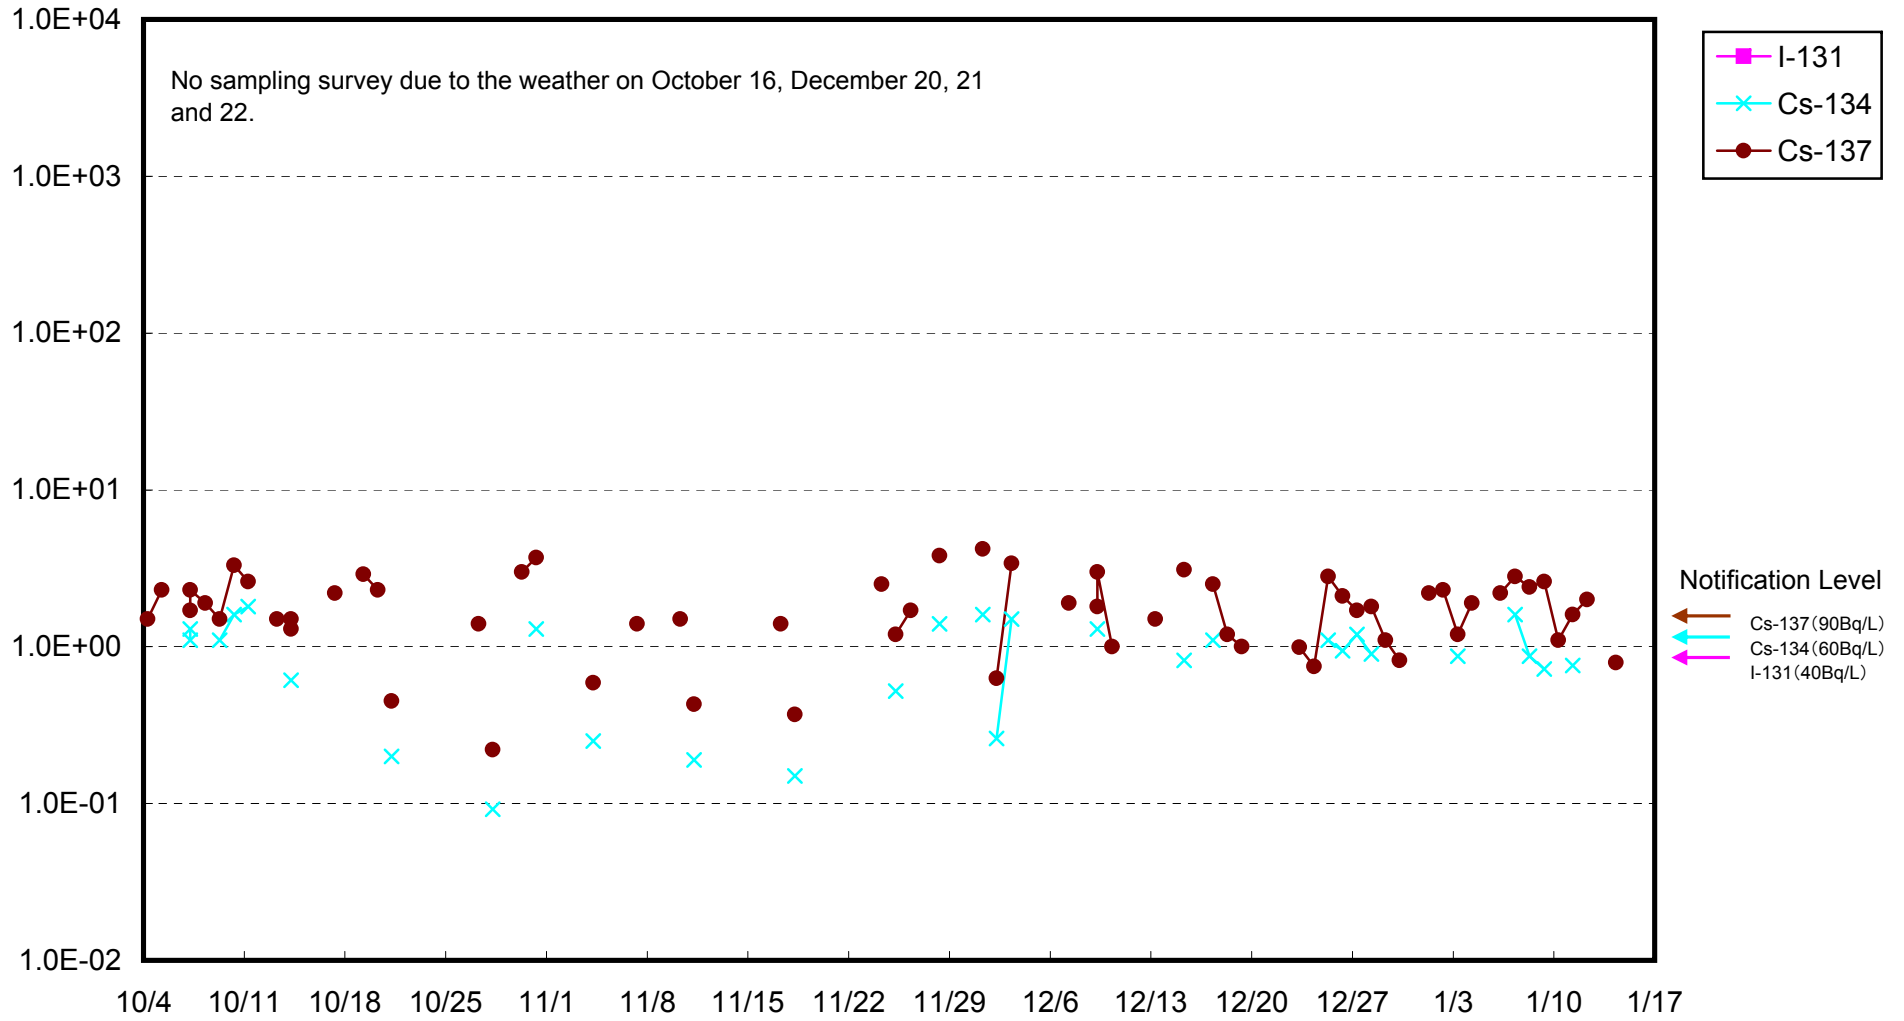


Radioactivity Density of the Seawater at 1F South Discharge Channel (Bq/L)

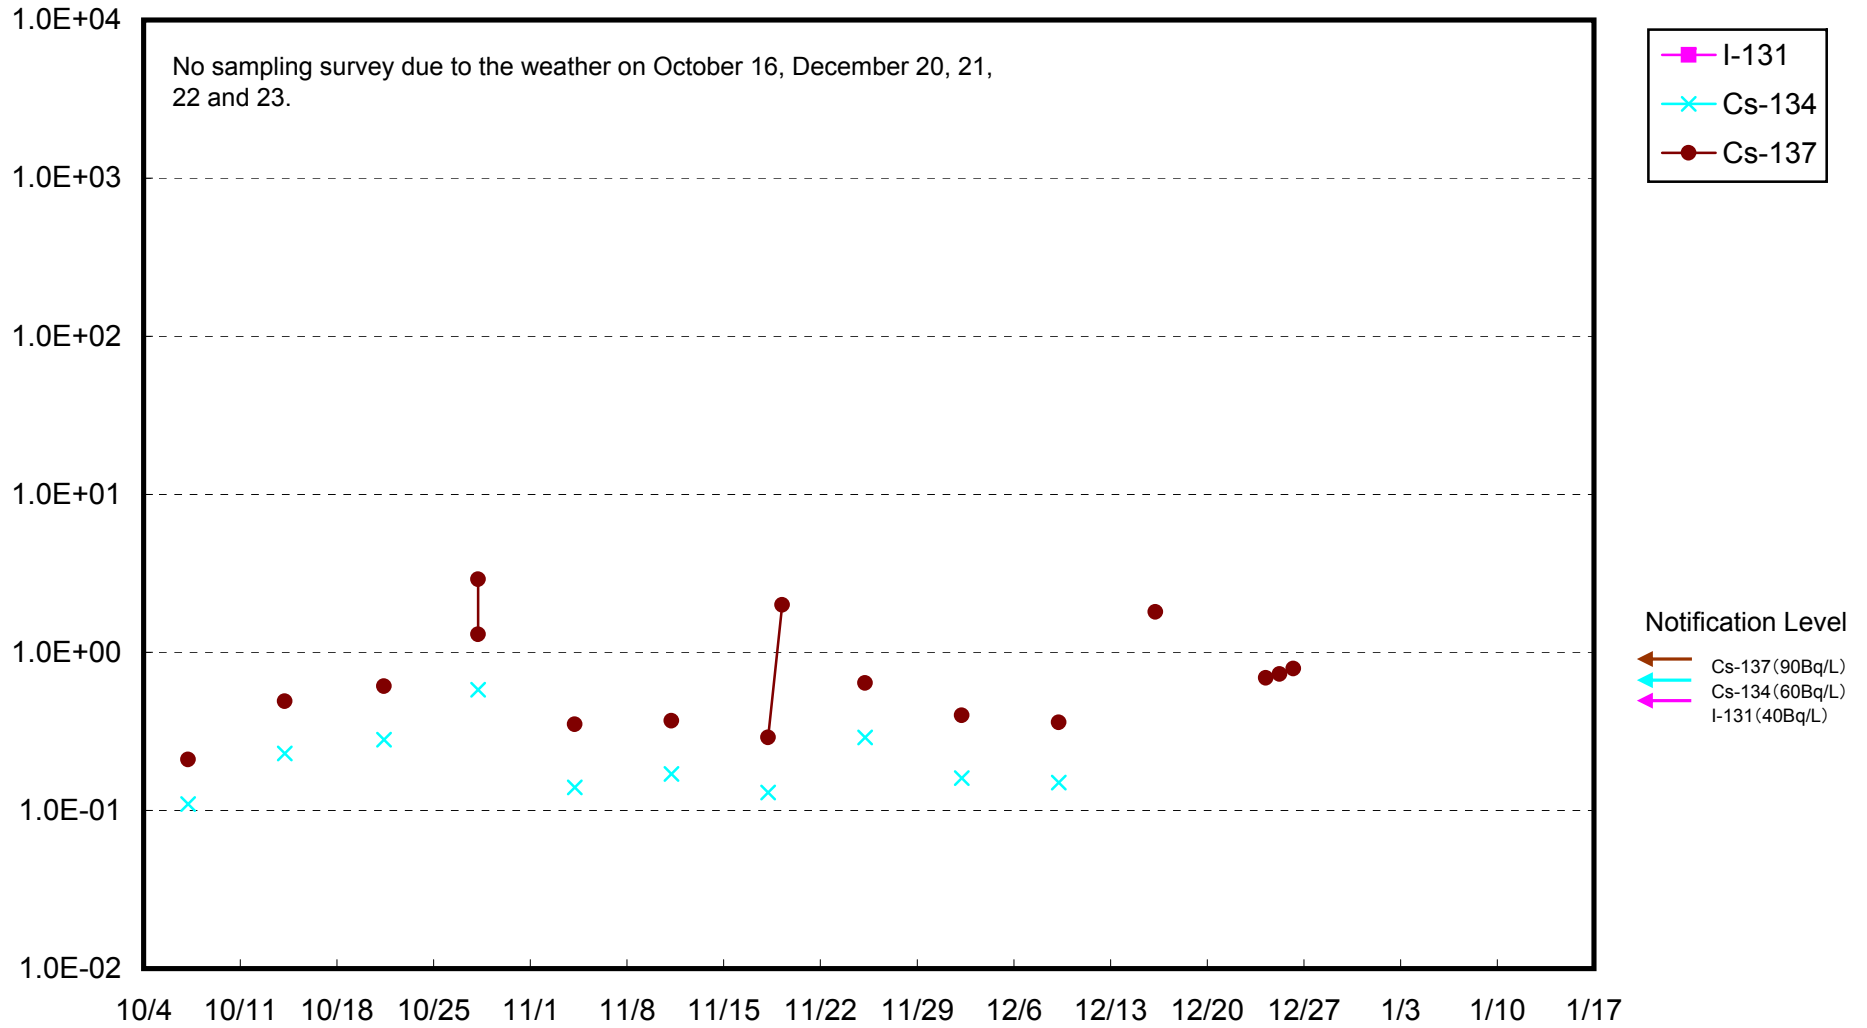

Radioactivity Density of the Seawater at 2F North Discharge Channel (Bq/L)

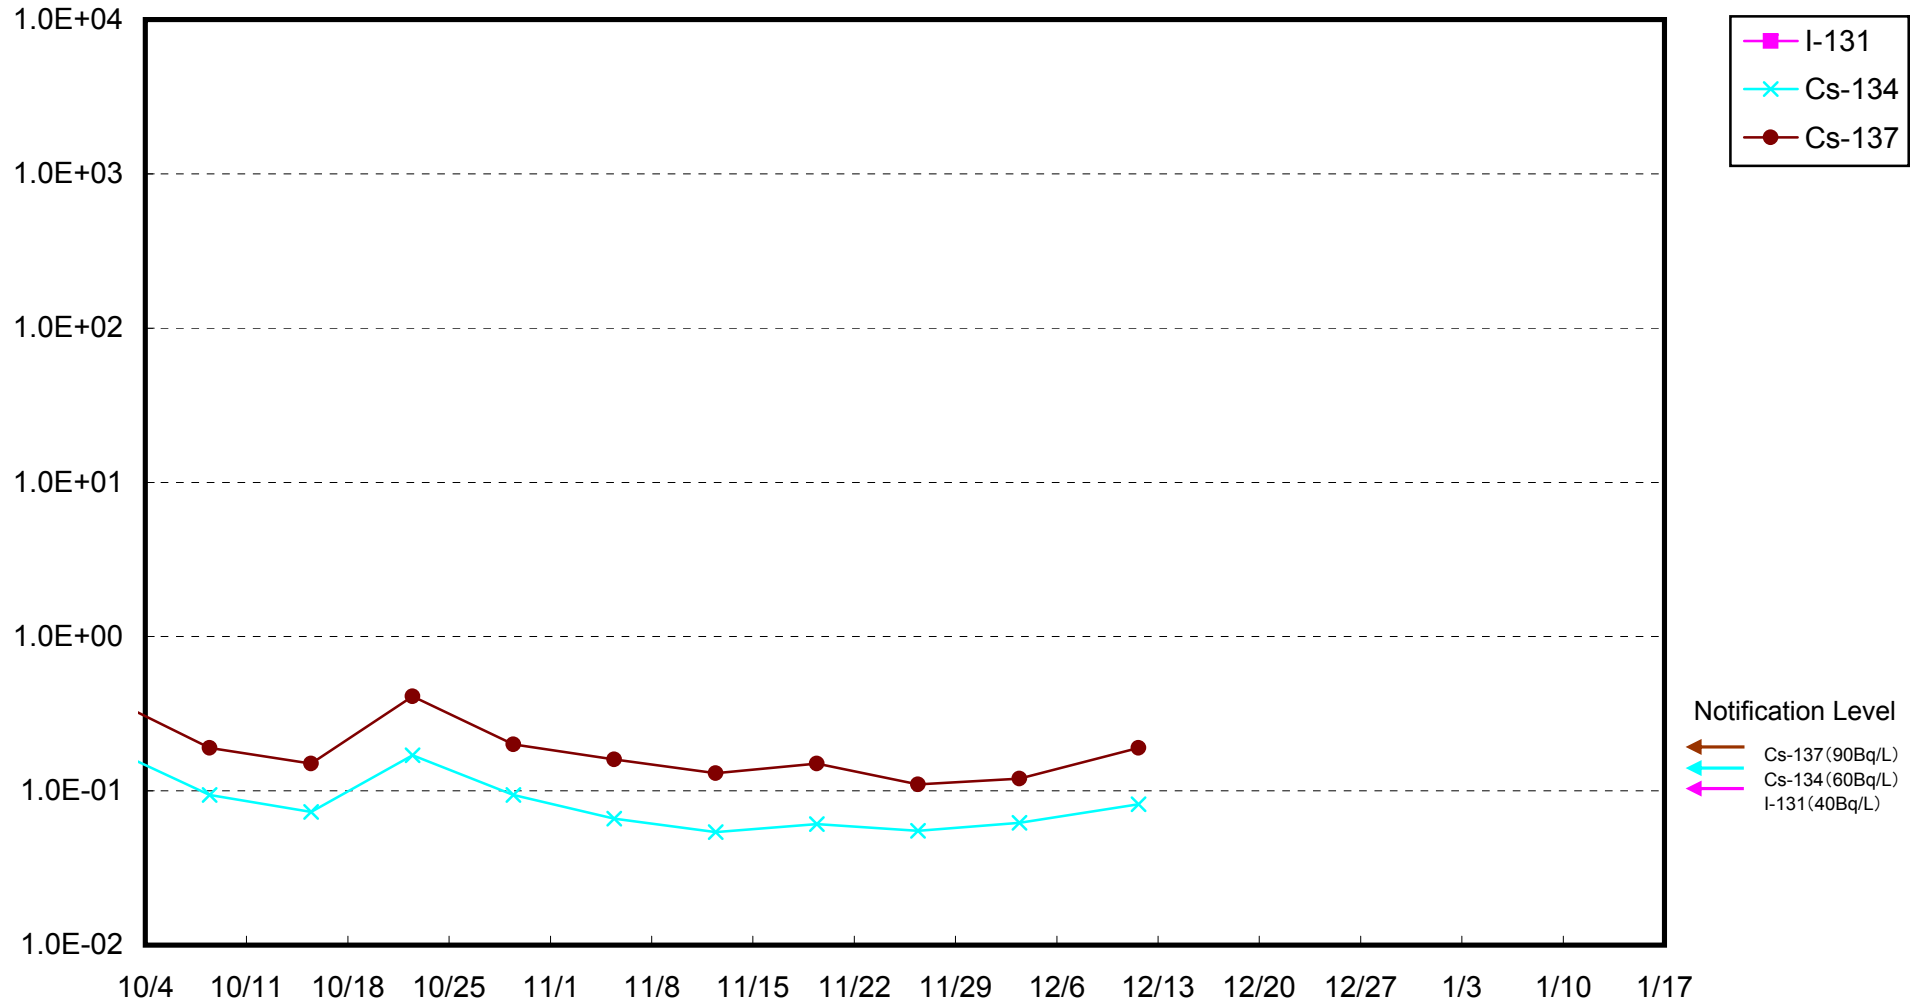

Radioactivity Density of the Seawater Around the Iwasawa Shore of 2F (Bq/L)

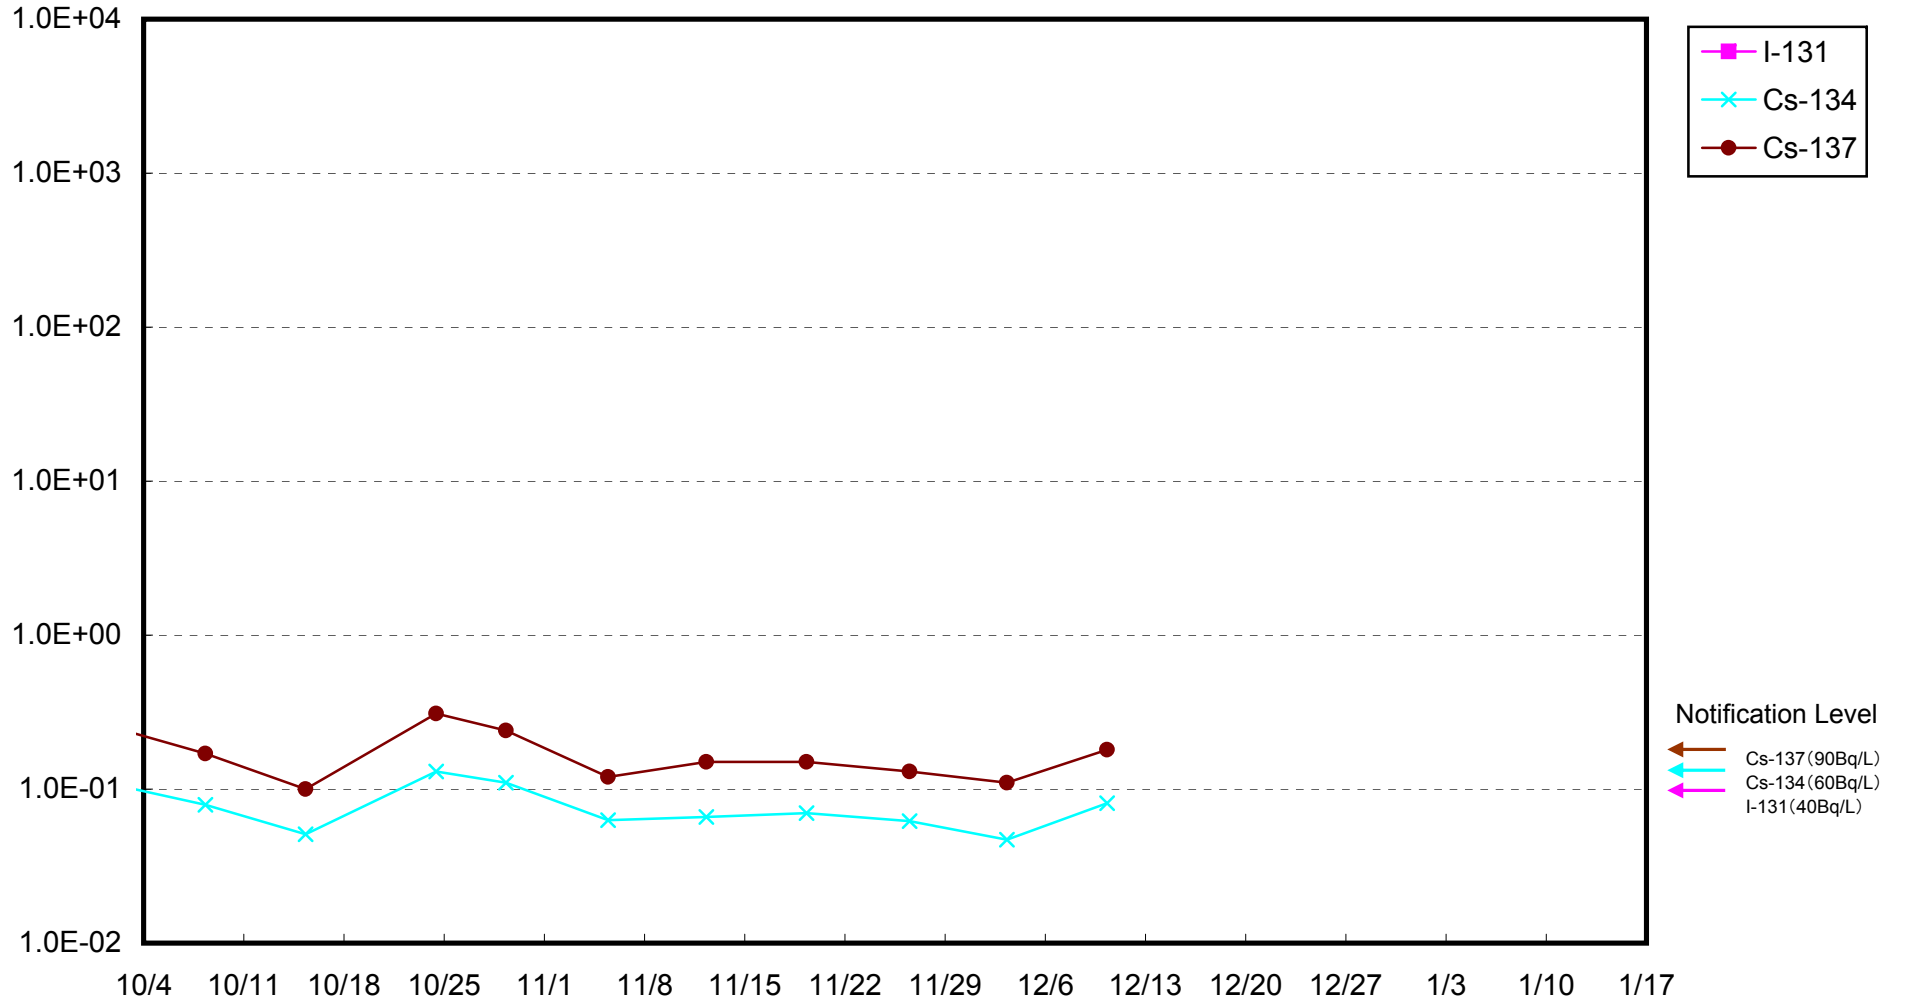

Sampling had been performed around the south side of Kitasakogawa since Octob

Radioactivity Density of the South Side of the Ukedo Port (Bq/L)

