

April 28, 2016


Tokyo Electric Power Company Holdings, Inc.

# Air Dose Rates inside the Buildings

Sampling Period

Unit 3: from February 1, 2016 to February 29, 2016


Fukushima Daiichi NPS	Unit 3 Reactor Building Semi-Basement Floor	[mSv/h]
-----------------------	---	---------

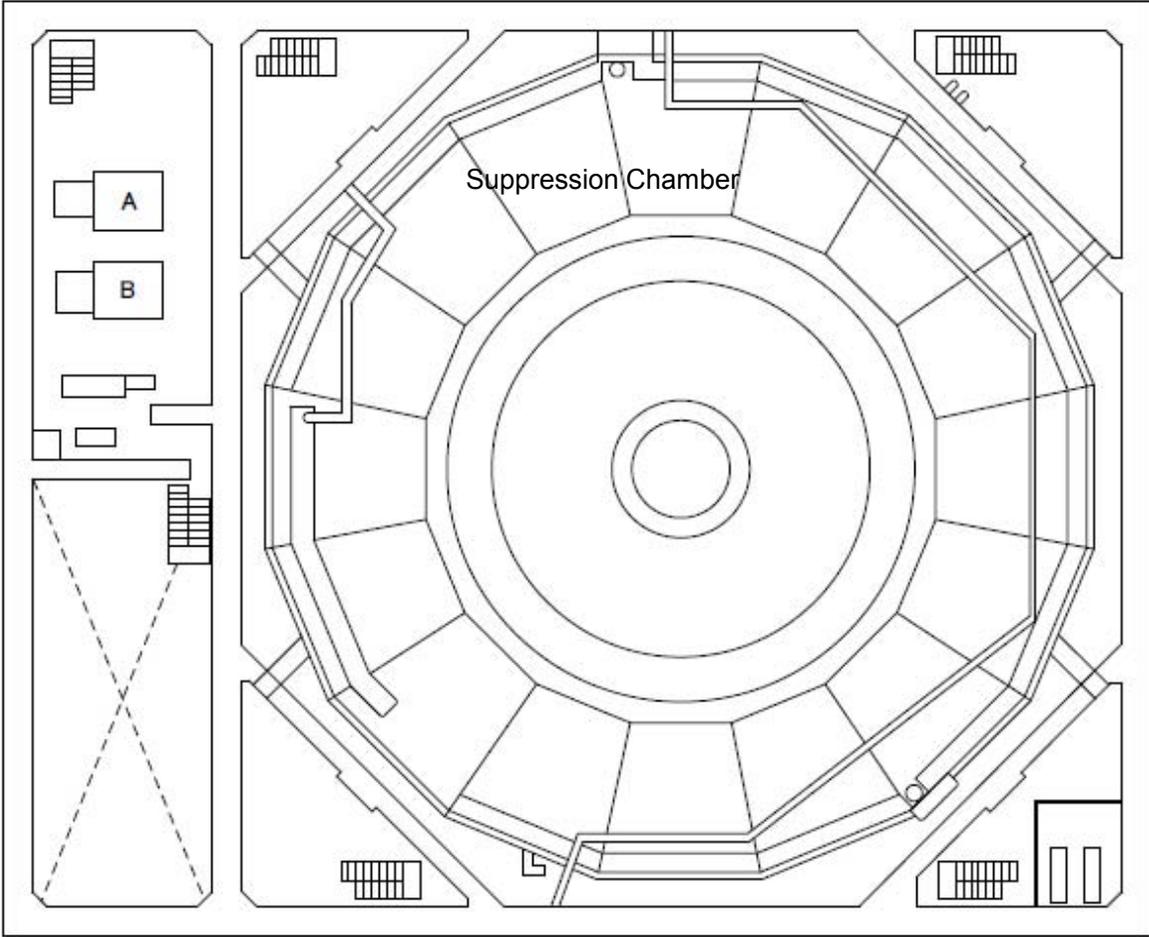



Fukushima Daiichi NPS


Unit 3 Reactor Building 1st Floor



[mSv/h]


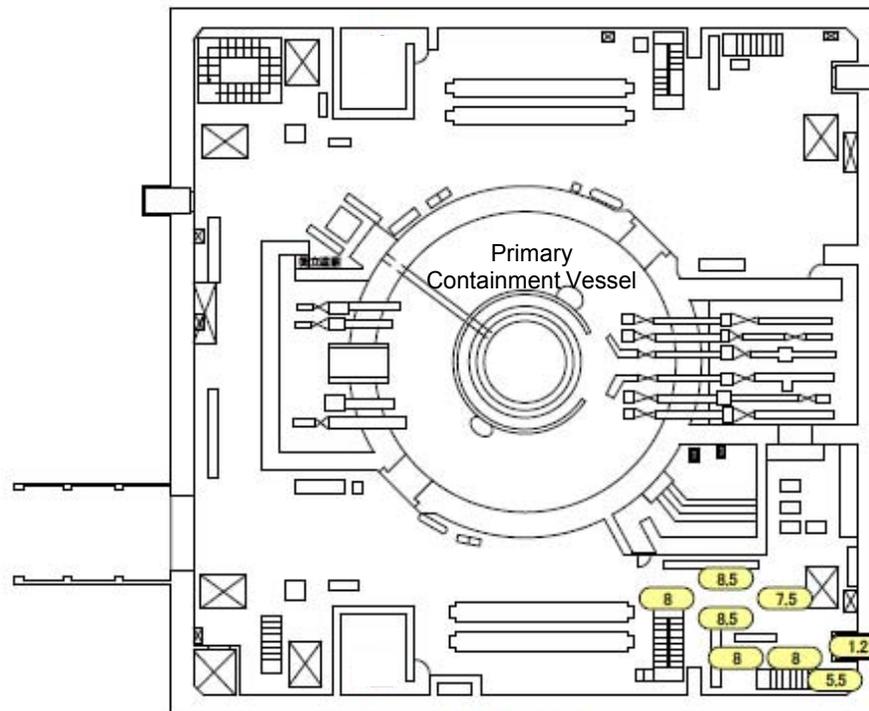



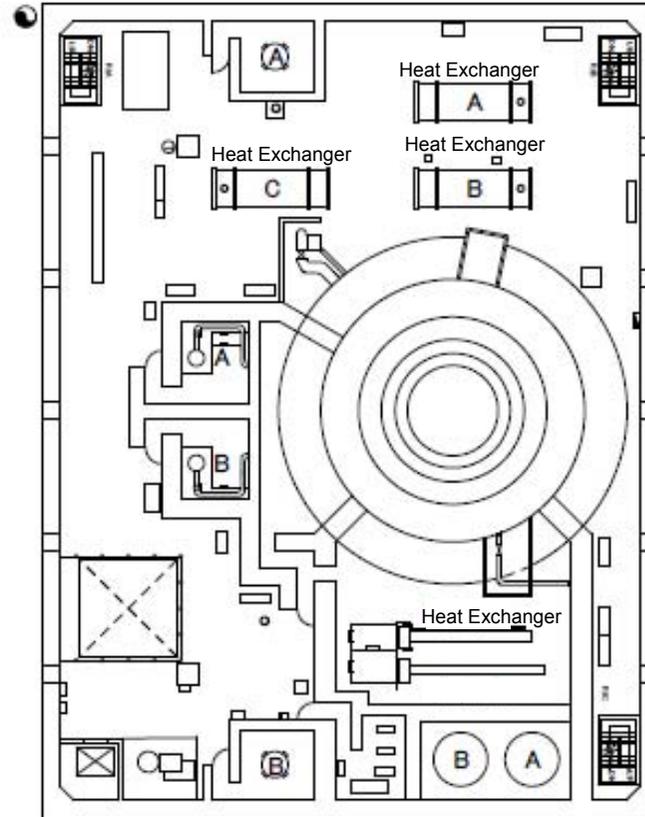


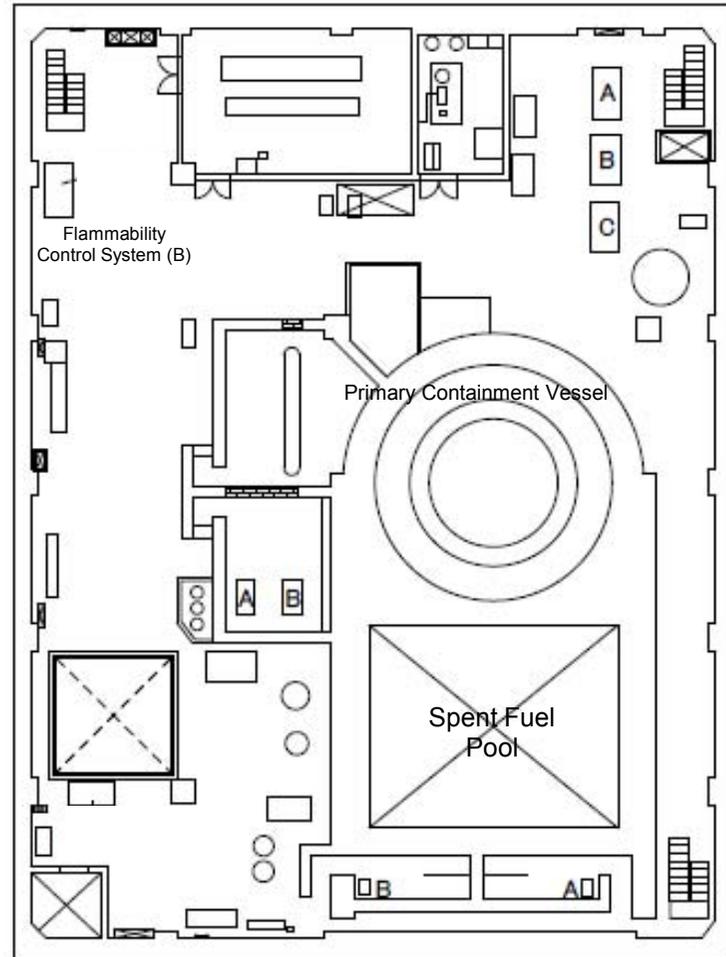

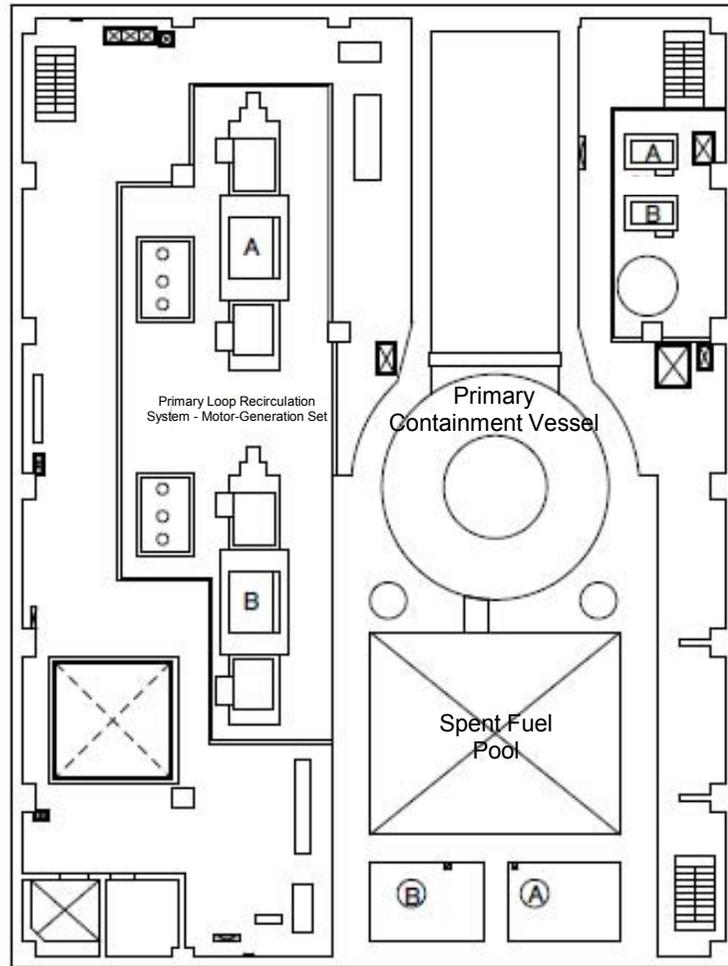

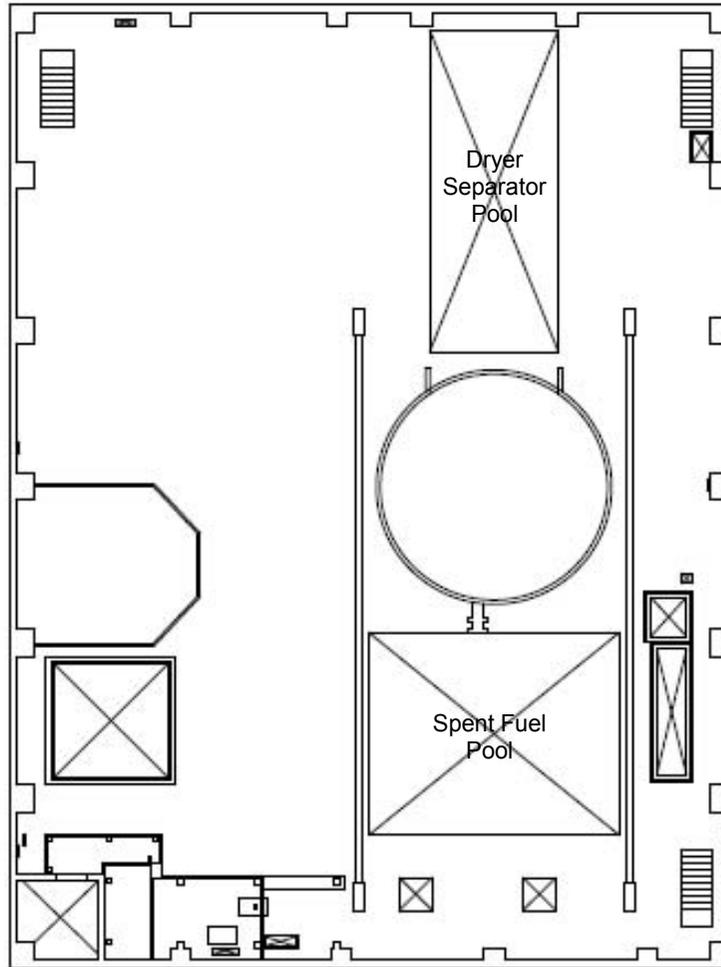

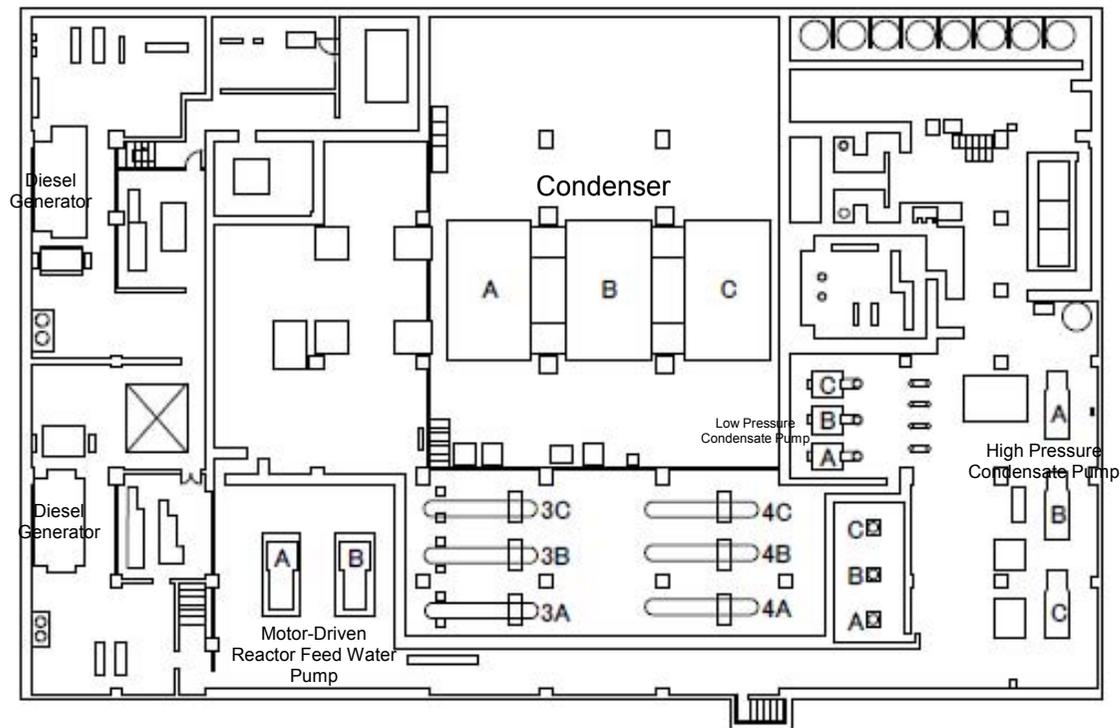



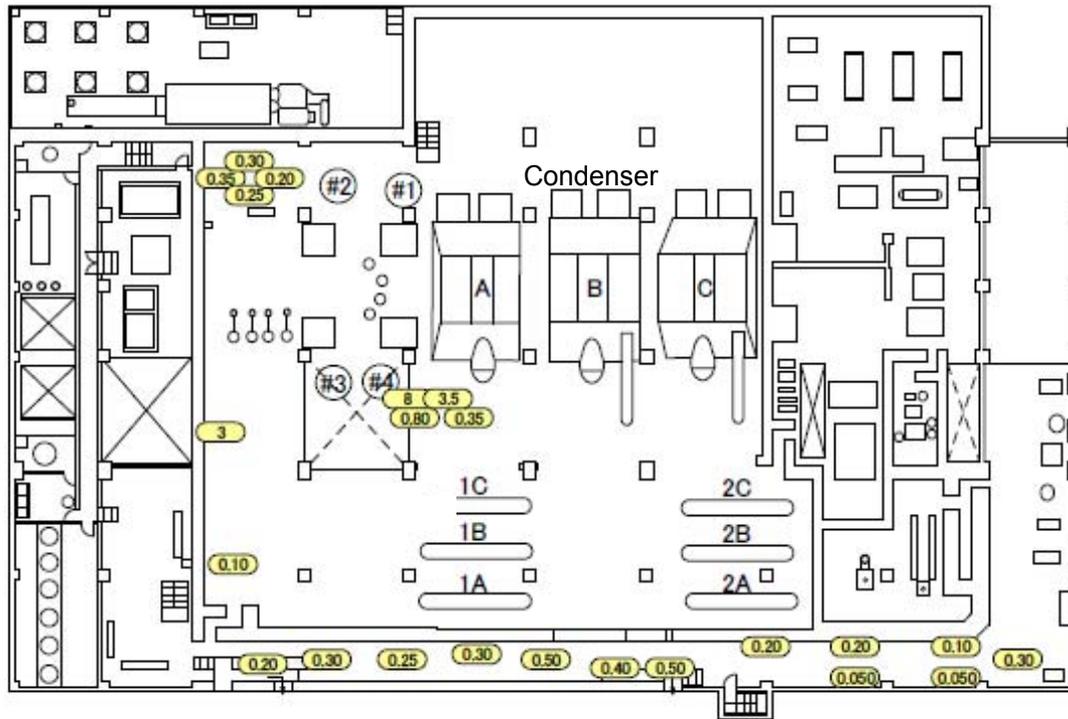



Fukushima Daiichi NPS

Unit 3 Turbine Building 2nd Floor

[mSv/h]

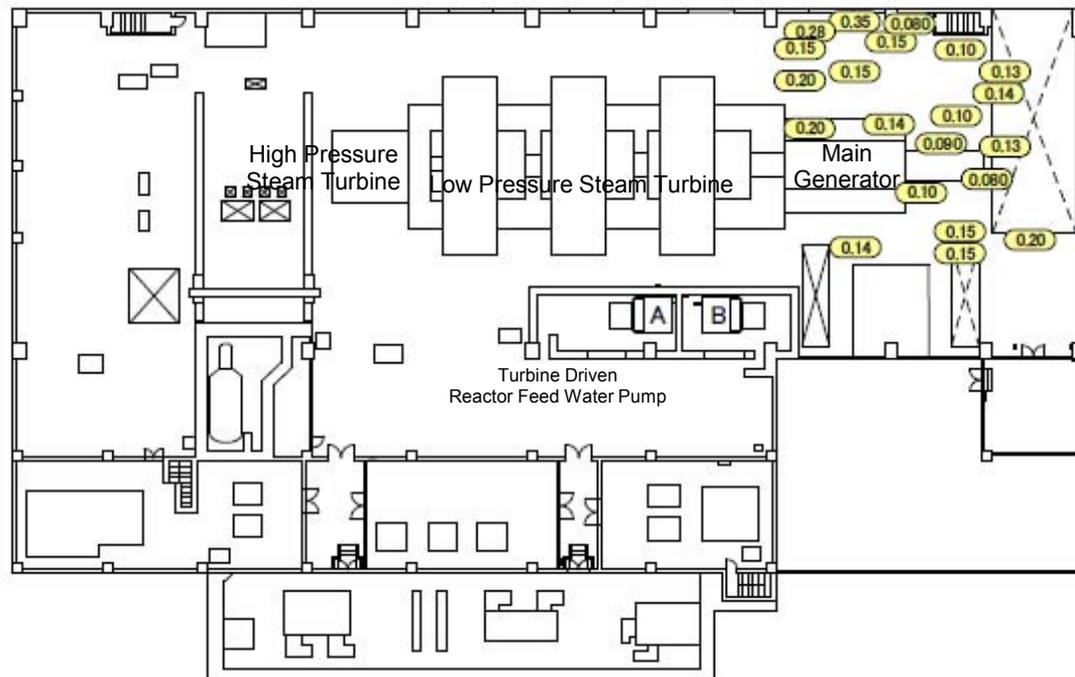


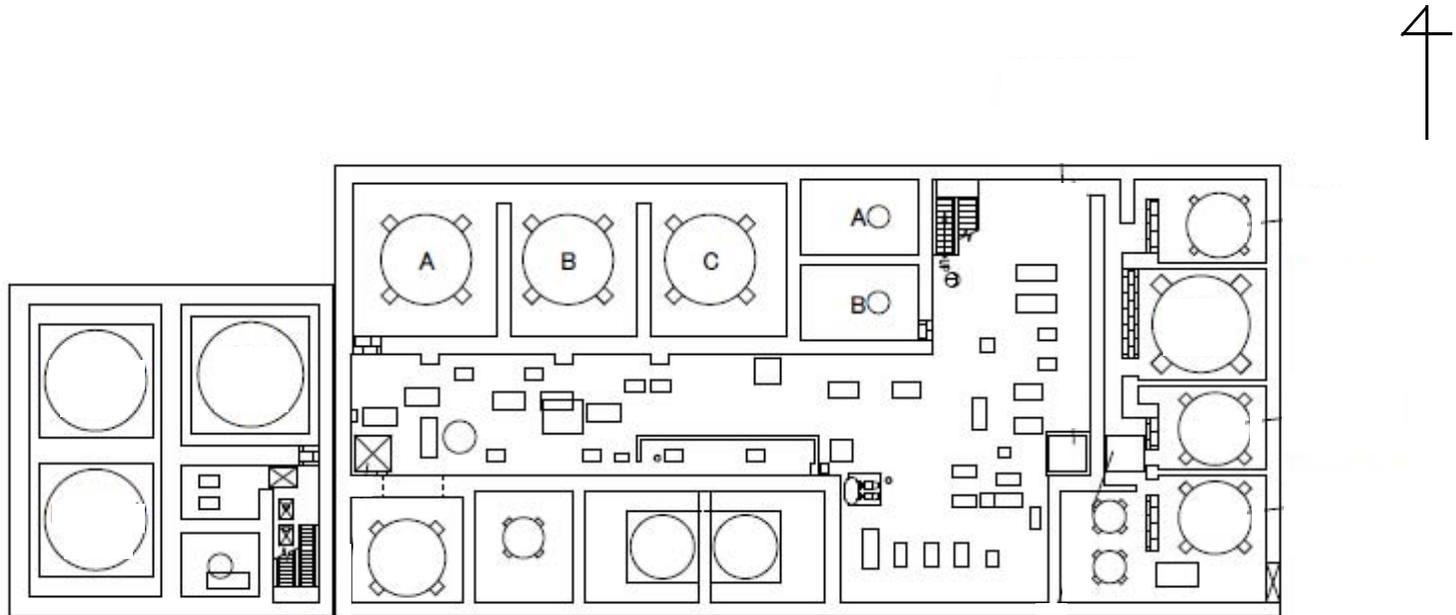


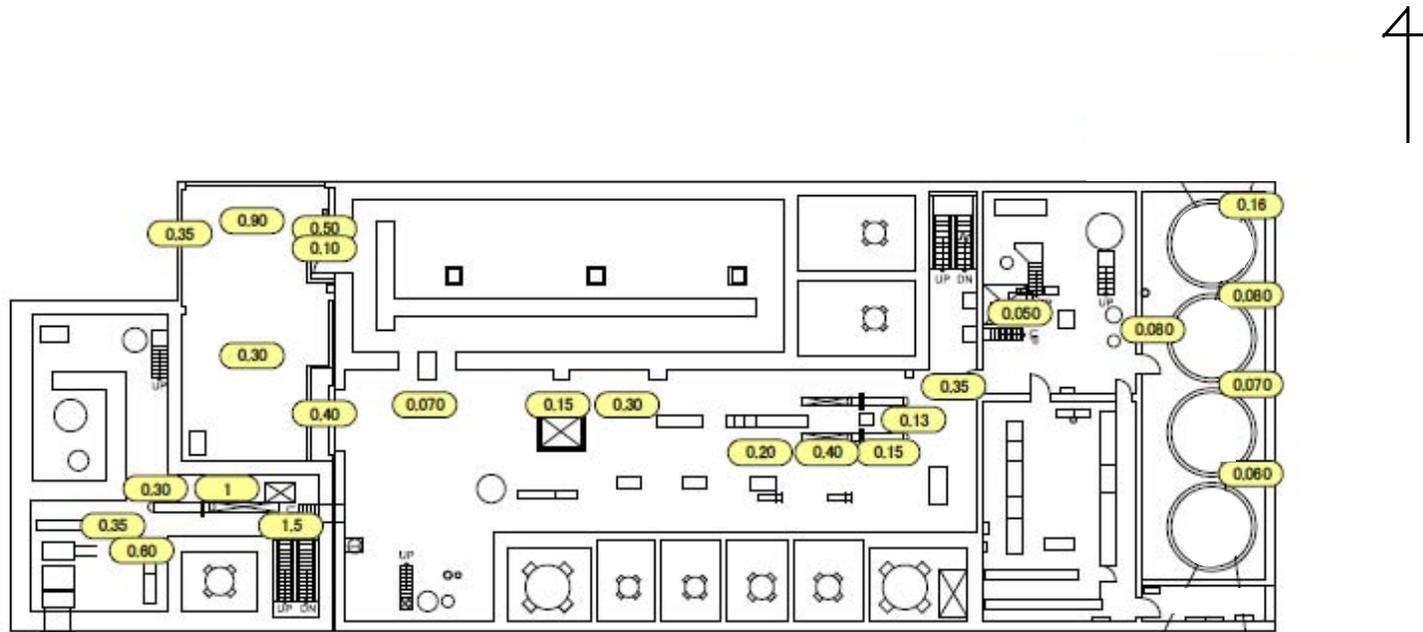

Fukushima Daiichi NPS

Units 3 and 4 Service Building 1st Basement Floor


[mSv/h]

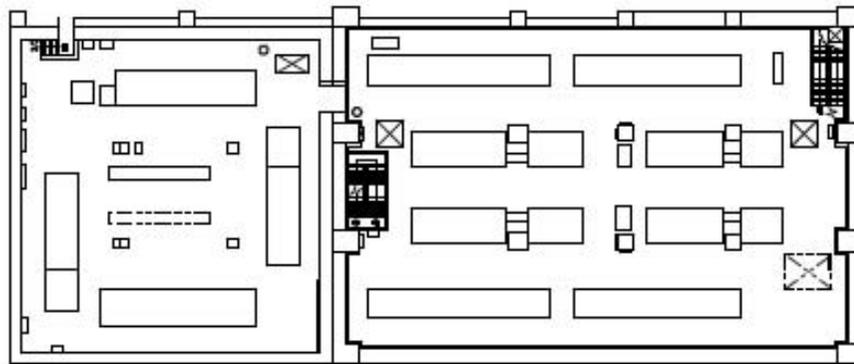

Fukushima Daiichi NPS

Units 3 and 4 Service Building Semi-Basement Floor


[mSv/h]

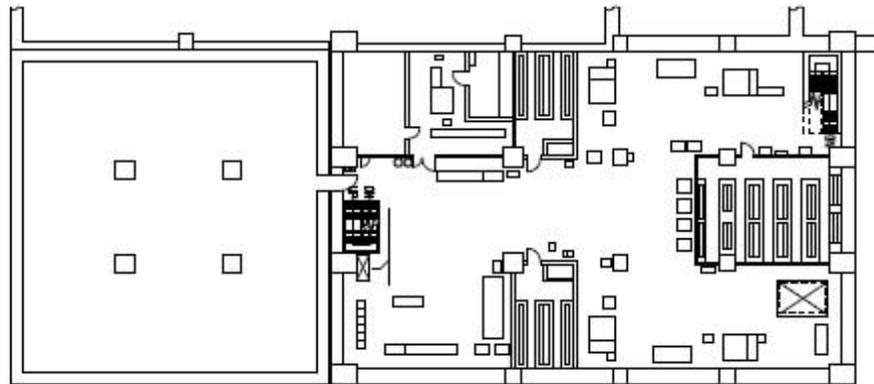

Fukushima Daiichi NPS

Units 3 and 4 Service Building 1st Floor

[mSv/h]

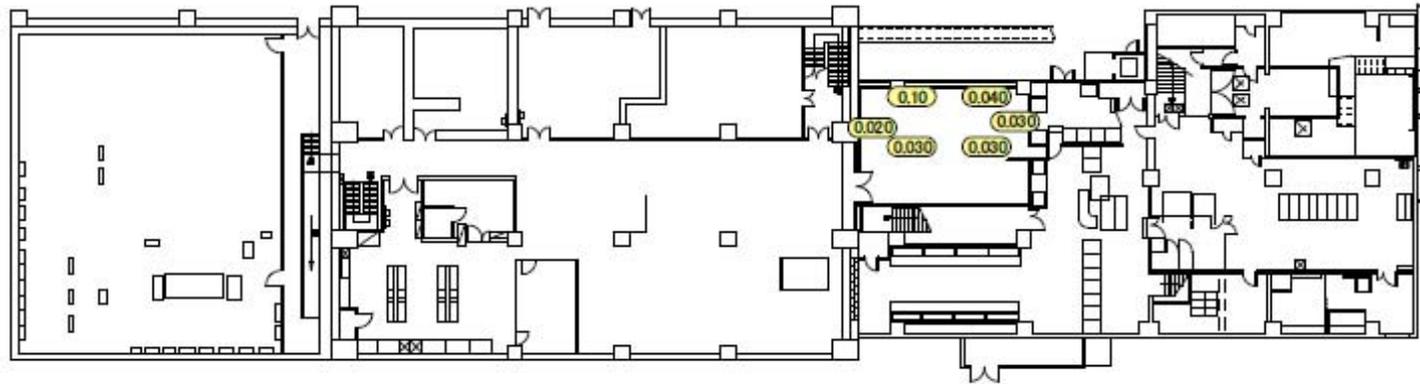

Fukushima Daiichi NPS

Units 3 and 4 Service Building 2nd Floor

[mSv/h]

