

April 28, 2016

Tokyo Electric Power Company Holdings, Inc.

Air Dose Rates inside the Buildings



Sampling Period

Unit 4: from February 1, 2016 to February 29, 2016

Fukushima Daiichi NPS

Unit 4 Reactor Building Semi-Basement Floor


[mSv/h]

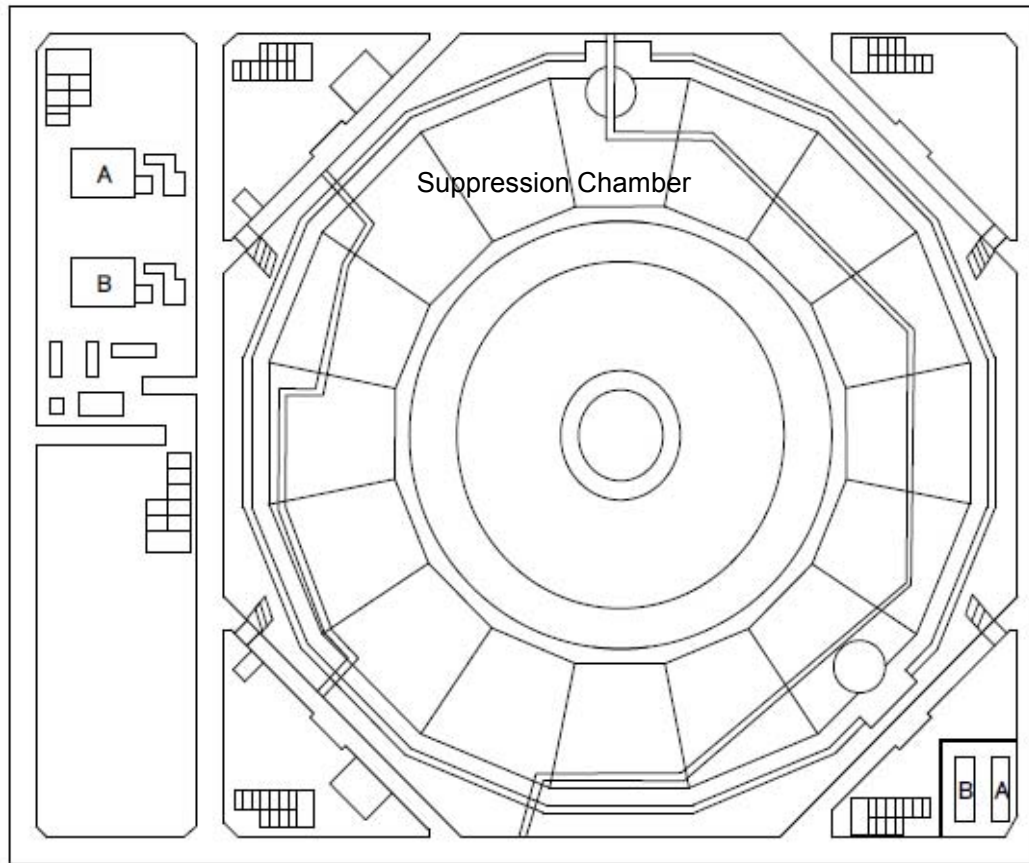


Fukushima Daiichi NPS


Unit 4 Reactor Building 1st Floor



[mSv/h]


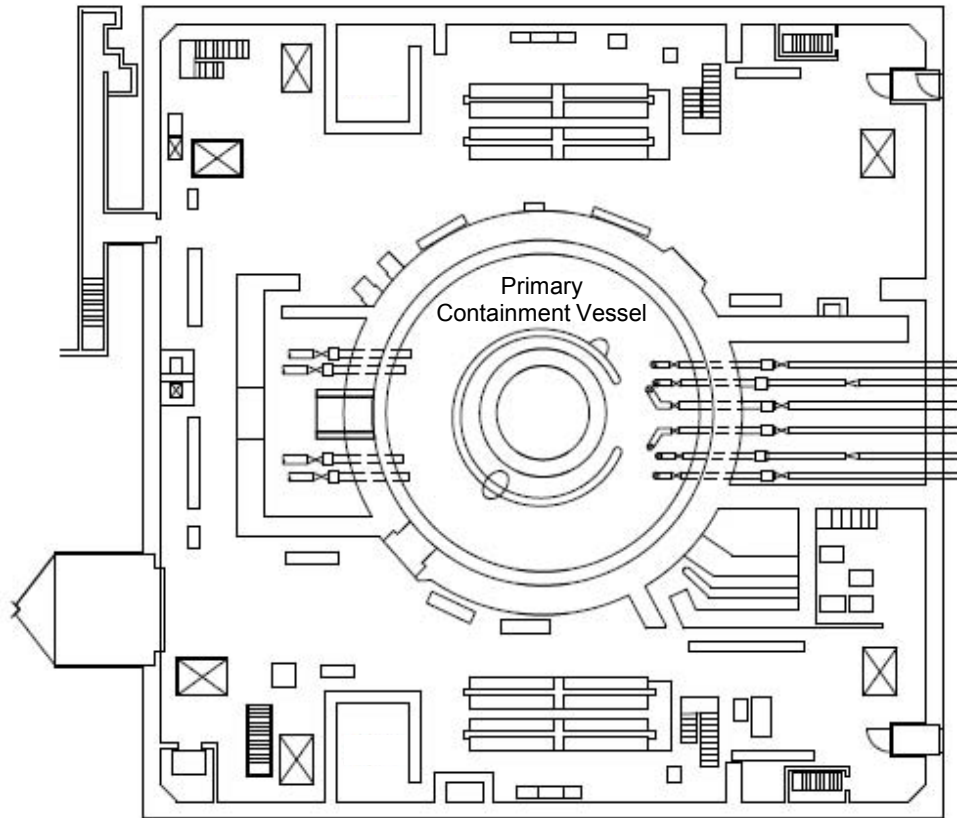



4

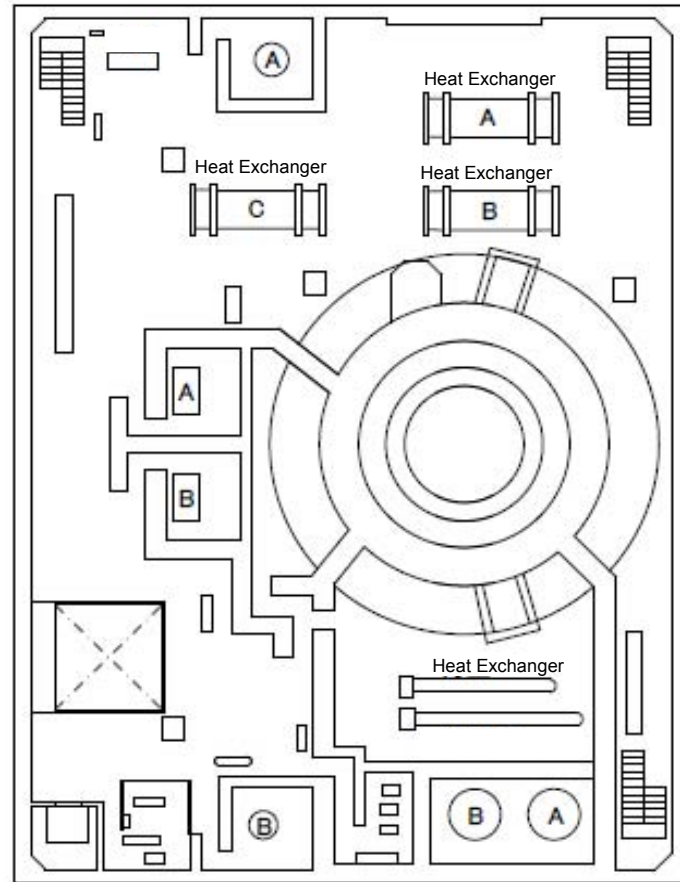

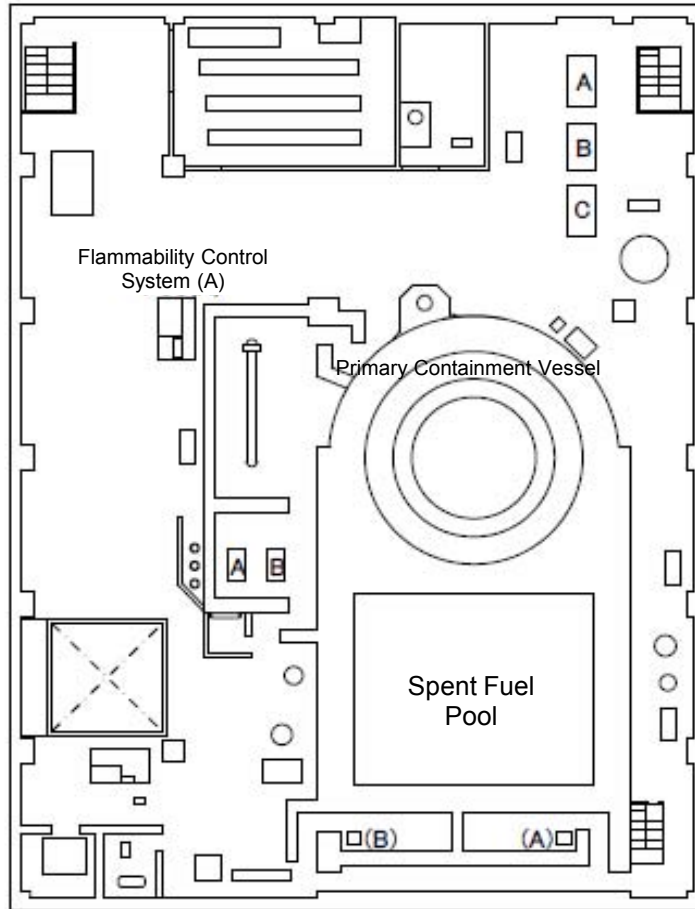

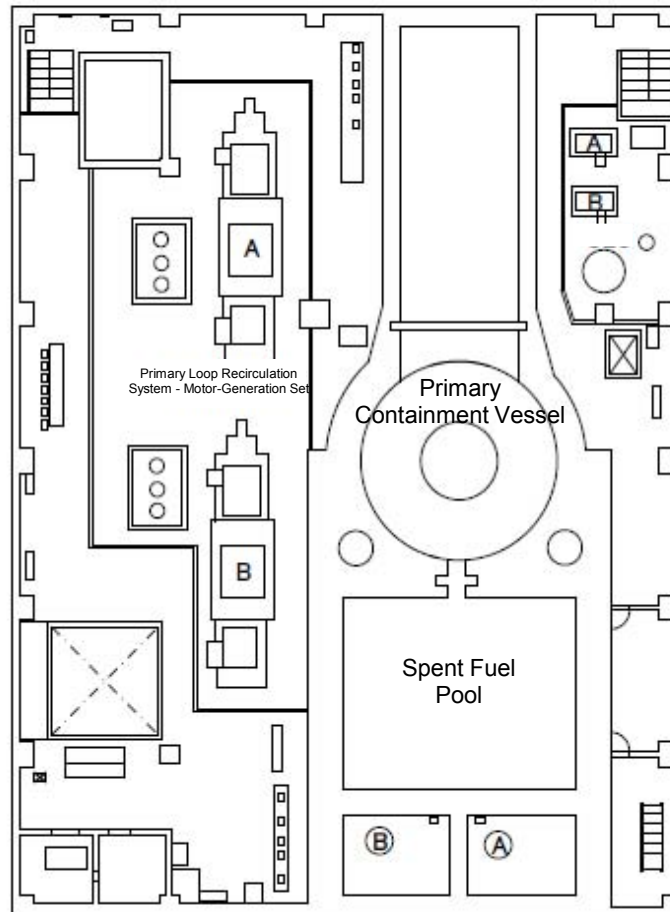

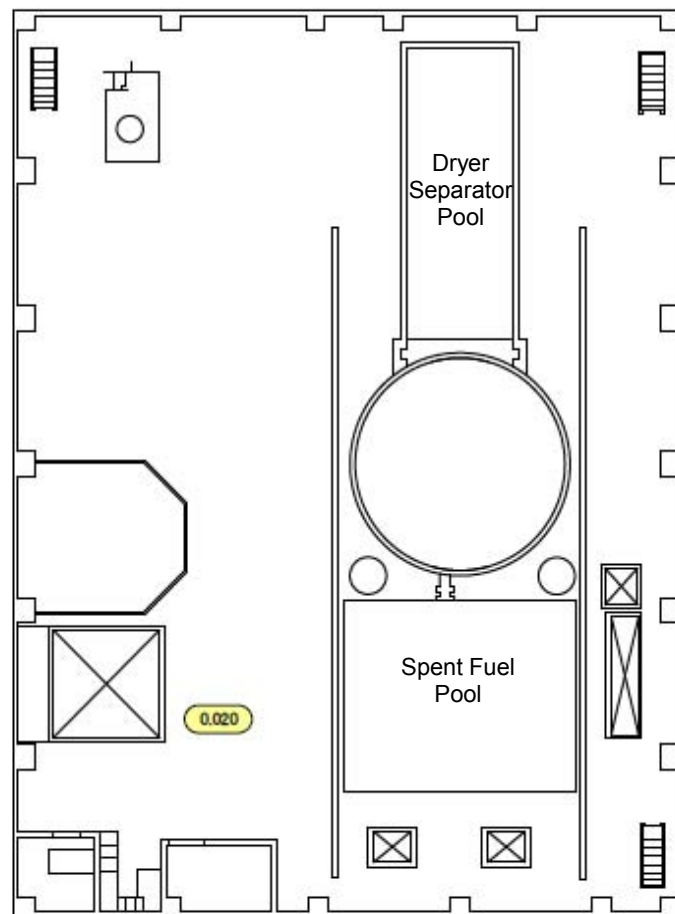




Fukushima Daiichi NPS

Unit 4 Radioactive Waste Treatment Facility 1st Floor



[mSv/h]

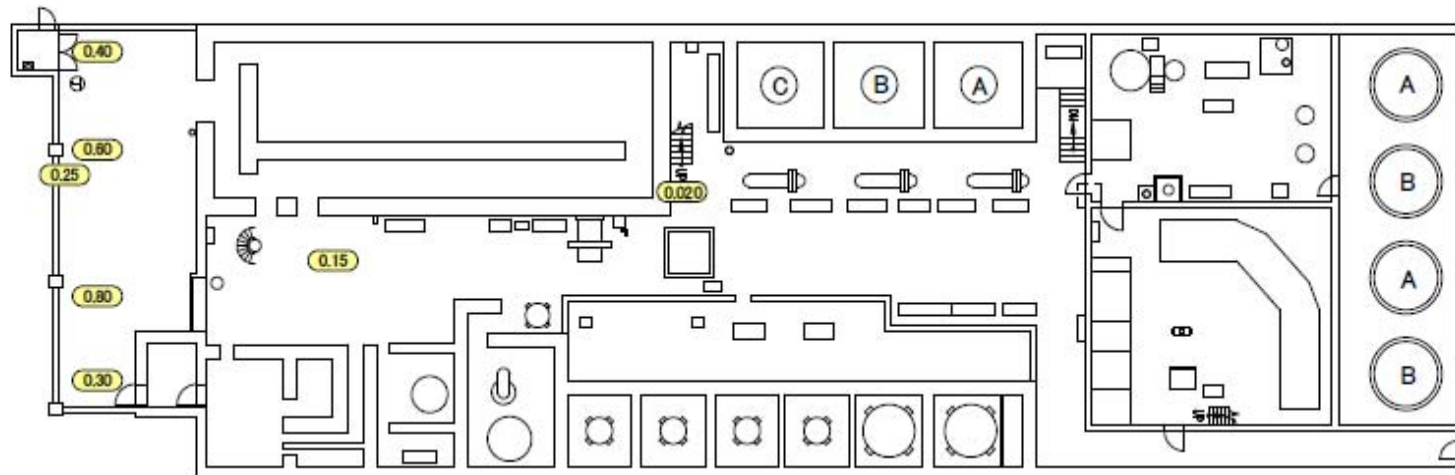


Fukushima Daiichi NPS

Unit 4 Radioactive Waste Treatment Facility 2nd Floor

[mSv/h]

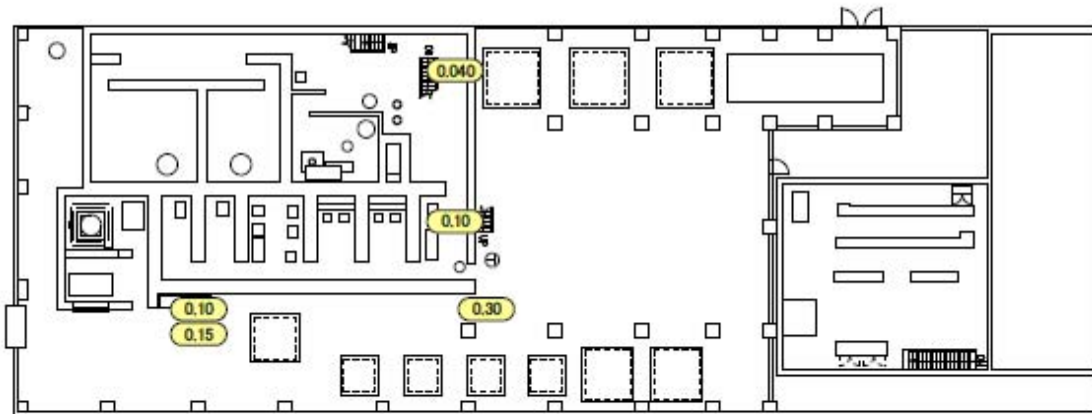

Fukushima Daiichi NPS	Unit 4 Radioactive Waste Treatment Facility 3rd Floor	[mSv/h]
-----------------------	---	---------

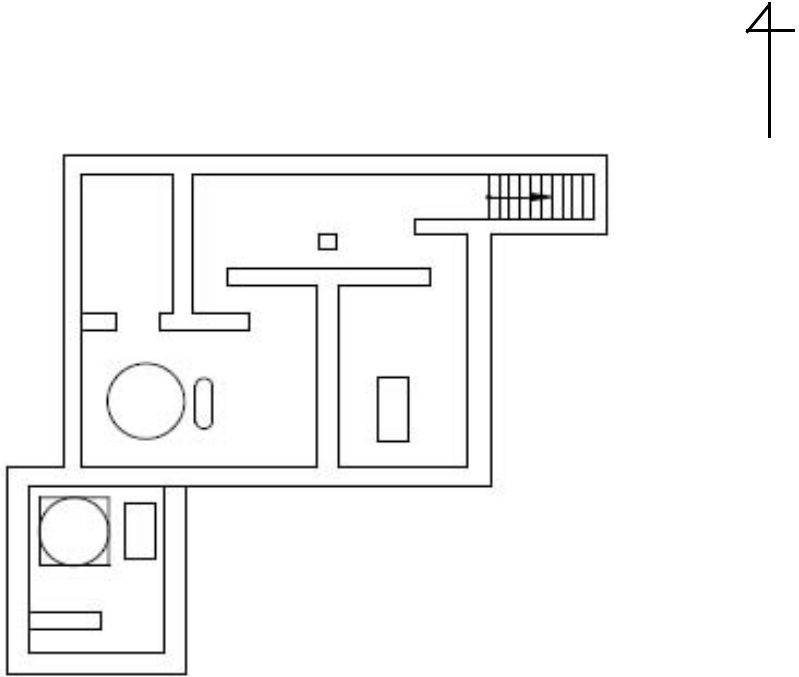

Fukushima Daiichi NPS

Unit 4 Radioactive Waste Treatment Facility 4th Floor

[mSv/h]

