As of 12:00 AM on February 23, 2015

February 23, 2015
Tokyo Electric
Power Company

Analysis Results of Seawater Obtained around Fukushima Daiichi NPS
(Inside of the Port of Fukushima Daiichi NPS)

Unit: Bq/L "ND"s below indicate that the measurement results are below the detection limits, and the detection limit of each nuclide is provided in parentheses.

East side in the port

Cs-134 :	ND(1.3)	Sampled on 2/22
Cs-137 :	ND(1.2)	Sampled on 2/22
Gross β :	ND(15)	Sampled on 2/22

Port entrance

Cs-134 :	ND(1.2)	Sampled on 2/22
Cs-137 :	ND(1.1)	Sampled on 2/22
Gross β :	15	Sampled on 2/22

South side in the port

Cs-134 :	ND(1.1)	Sampled on 2/22
Cs-137 :	ND(1.3)	Sampled on 2/22
Gross β :	ND(15)	Sampled on 2/22

West side in the port

Cs-134 :	ND(1.5)	Sampled on 2/22
Cs-137 :	1.9	Sampled on 2/22
Gross β :	ND(15)	Sampled on 2/22

Water intake channel of Unit 2
(in front of impermeable wall)

Cs-134 :	(ND)1.8	Sampled on 2/22
Cs-137 :	2.8	Sampled on 2/22
Gross β :	22	Sampled on 2/22

North side in the port

Cs-134 :	ND(1.2)	Sampled on 2/22
Cs-137 :	1.9	Sampled on 2/22
Gross β :	19	Sampled on 2/22

North side of Unit 1-4 water intake channel
(Outside of silt fence)*

Cs-134 :	ND(3.3)	Sampled on 2/22
Cs-137 :	3.9	Sampled on 2/22
Gross β :	24	Sampled on 2/22

*This area is different from the one where we usually conduct water sampling.

In front of Unit 6 water intake channel

Cs-134 :	ND(2.1)	Sampled on 2/22
Cs-137 :	ND(2.1)	Sampled on 2/22
Gross β :	17	Sampled on 2/22

In front of shallow draft quay

Cs-134 :	ND(2.3)	Sampled on 2/22
Cs-137 :	3.3	Sampled on 2/22
Gross β :	22	Sampled on 2/22

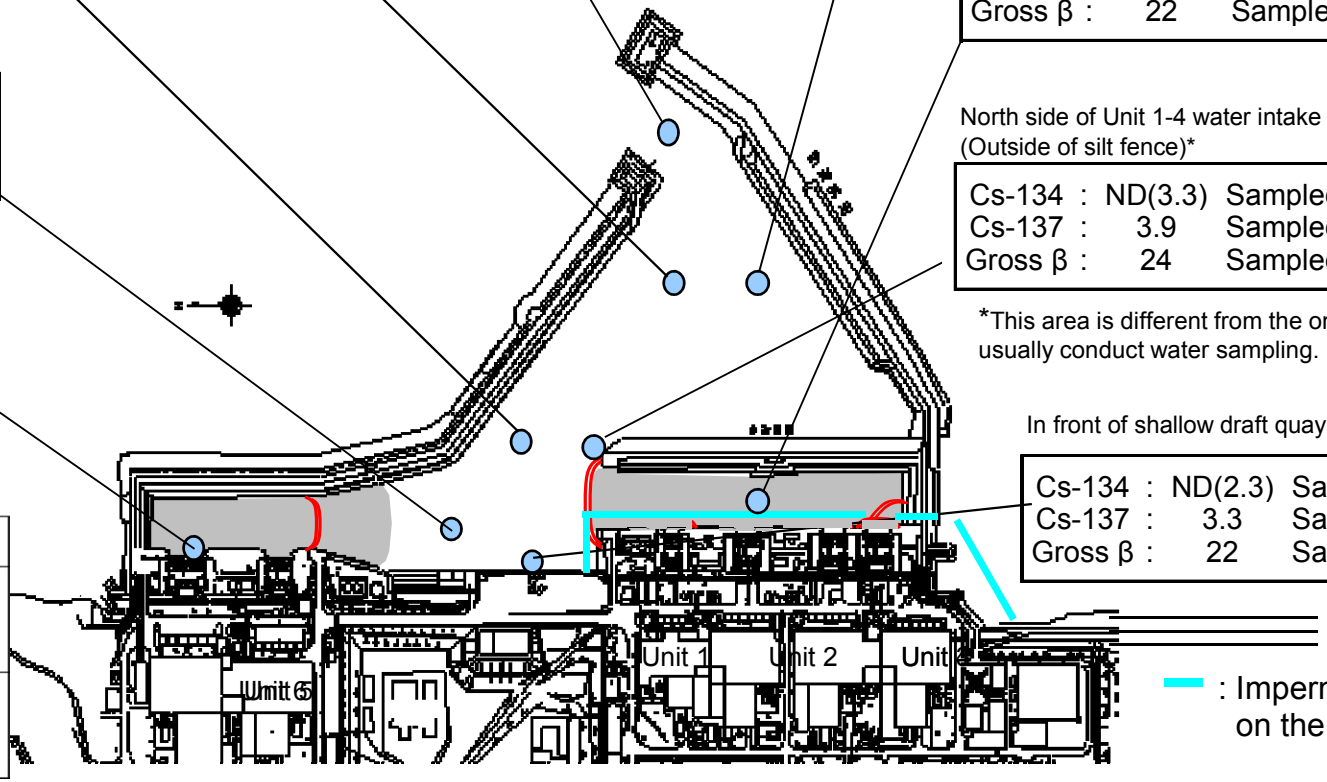

: Impermeable wall on the sea side

	Cs-134	Cs-137	H-3	Sr-90
Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)	60	90	60,000	30
WHO Guidelines for drinking-water quality	10	10	10,000	10

Density Limit Specified by the Rule: Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)