


## Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

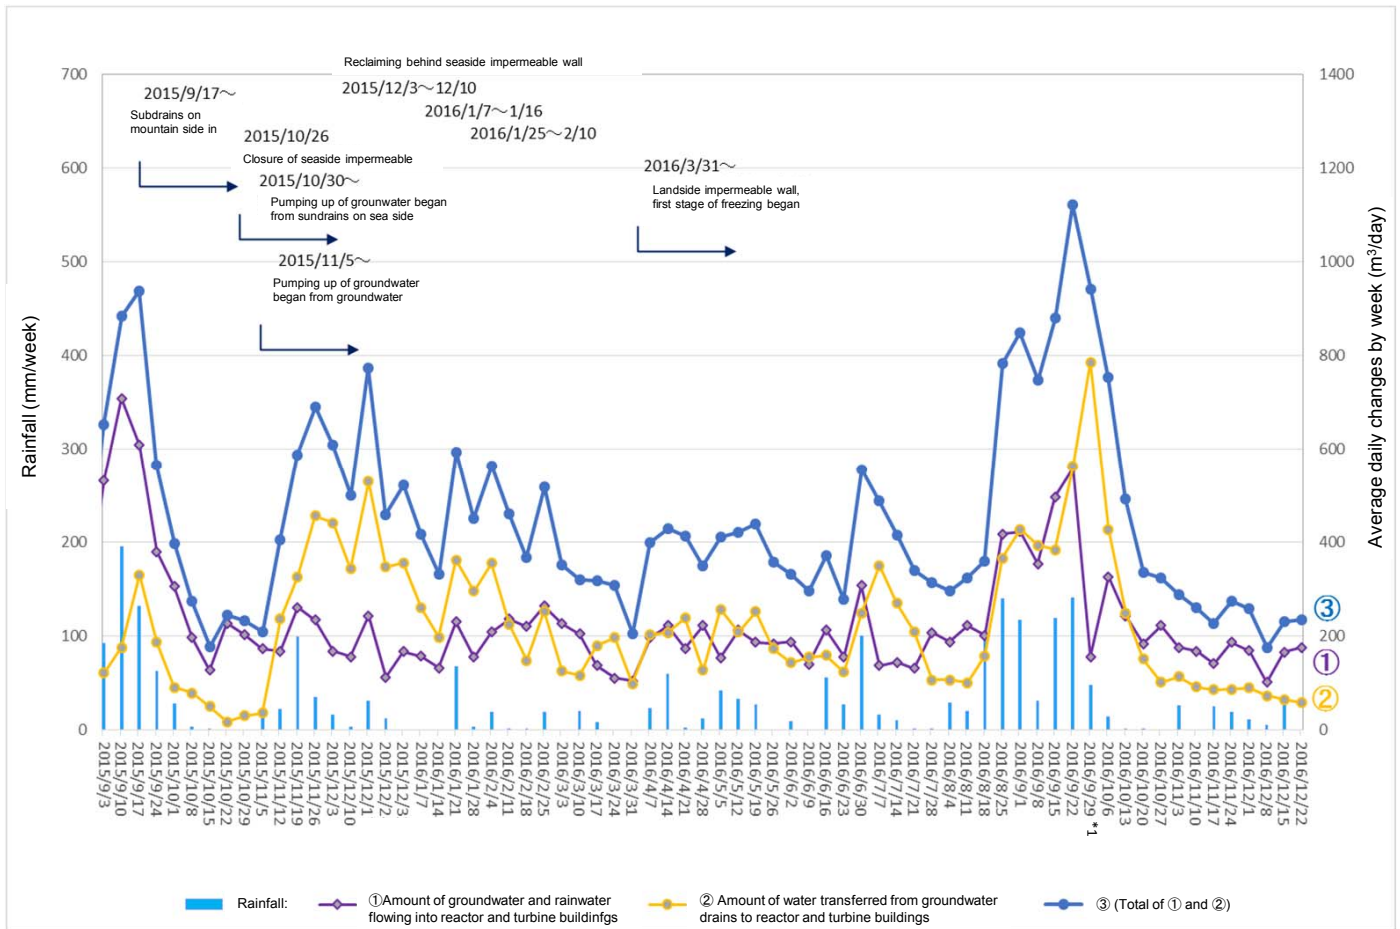

### Amount of water transferred from groundwater drains to reactor and turbine buildings (From December 15 to December 21, 2016/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*2 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*2 (β)	
Dec. 15	38	0	0	38	26	0	0	26	64
Dec. 16	38	0	0	38	28	0	0	28	66
Dec. 17	36	0	0	36	24	0	0	24	60
Dec. 18	35	0	0	35	23	0	0	23	58
Dec. 19	31	0	0	31	23	0	0	23	54
Dec. 20	27	0	0	27	21	0	0	21	48
Dec. 21	26	0	0	26	26	0	0	26	52

\* ①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 176m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 58m³/day, ③(Total of ① and ②): 234m³/day, Rainfall: 0mm/week

\*1 Water gauges in reactor and turbine buildings were calibrated.

\*2 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.