


Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

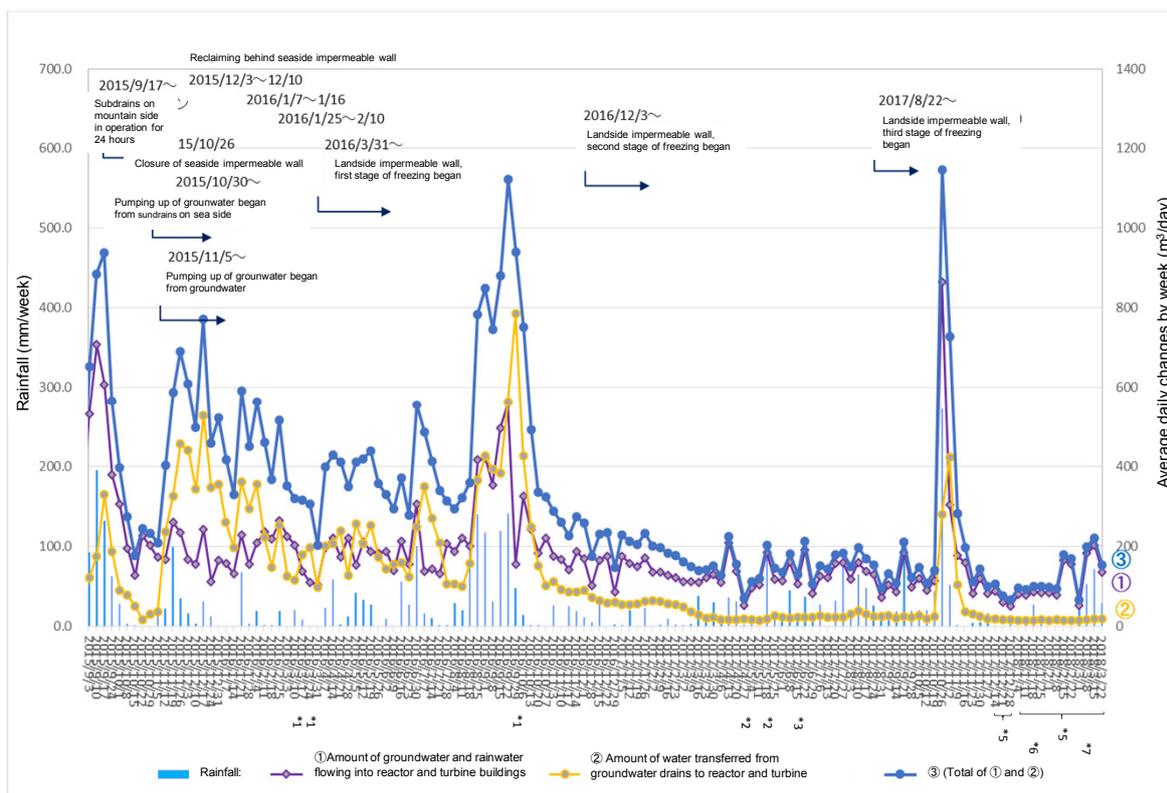

Amount of water transferred from groundwater drains to reactor and turbine buildings (From March 15, 2018 to March 21, 2018/ 24 hours per day)

Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
	A	B	C	Total*4 (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total*4 (β)	
Mar.15	0	0	0	0	26	0	0	26	26
Mar.16	0	0	0	0	23	0	0	23	23
Mar.17	0	0	0	0	31	0	0	31	31
Mar.18	0	0	0	0	7	0	0	7	7
Mar.19	0	0	0	0	17	0	0	17	17
Mar.20	0	0	0	0	16	0	0	16	16
Mar.21	0	0	0	0	7	0	0	7	7

*①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 136m³/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 18m³/day, ③(Total of ① and ②): 154m³/day, Rainfall: 29mm/week

*1 Water gauges in reactor and turbine buildings were calibrated.

*2 The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.

*3 The amount of water levels was revision the cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility from June 1, 2017 on.

*4 There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

*5 In the amount of groundwater and rainwater flowing into the Unit1 was conducted, excluding the trenches.

*6 From January 18, 2018, revision of the method. (including groundwater and rainwater flowing into remaining water area.)

*7 According to water gauges of the Unit3 turbin building were calibrated, the data was increased. (Approx. 30m³/day)