Unit 4 Spent Fuel Pool Circulating Cooling System
Oozing Water from Flexible Hose
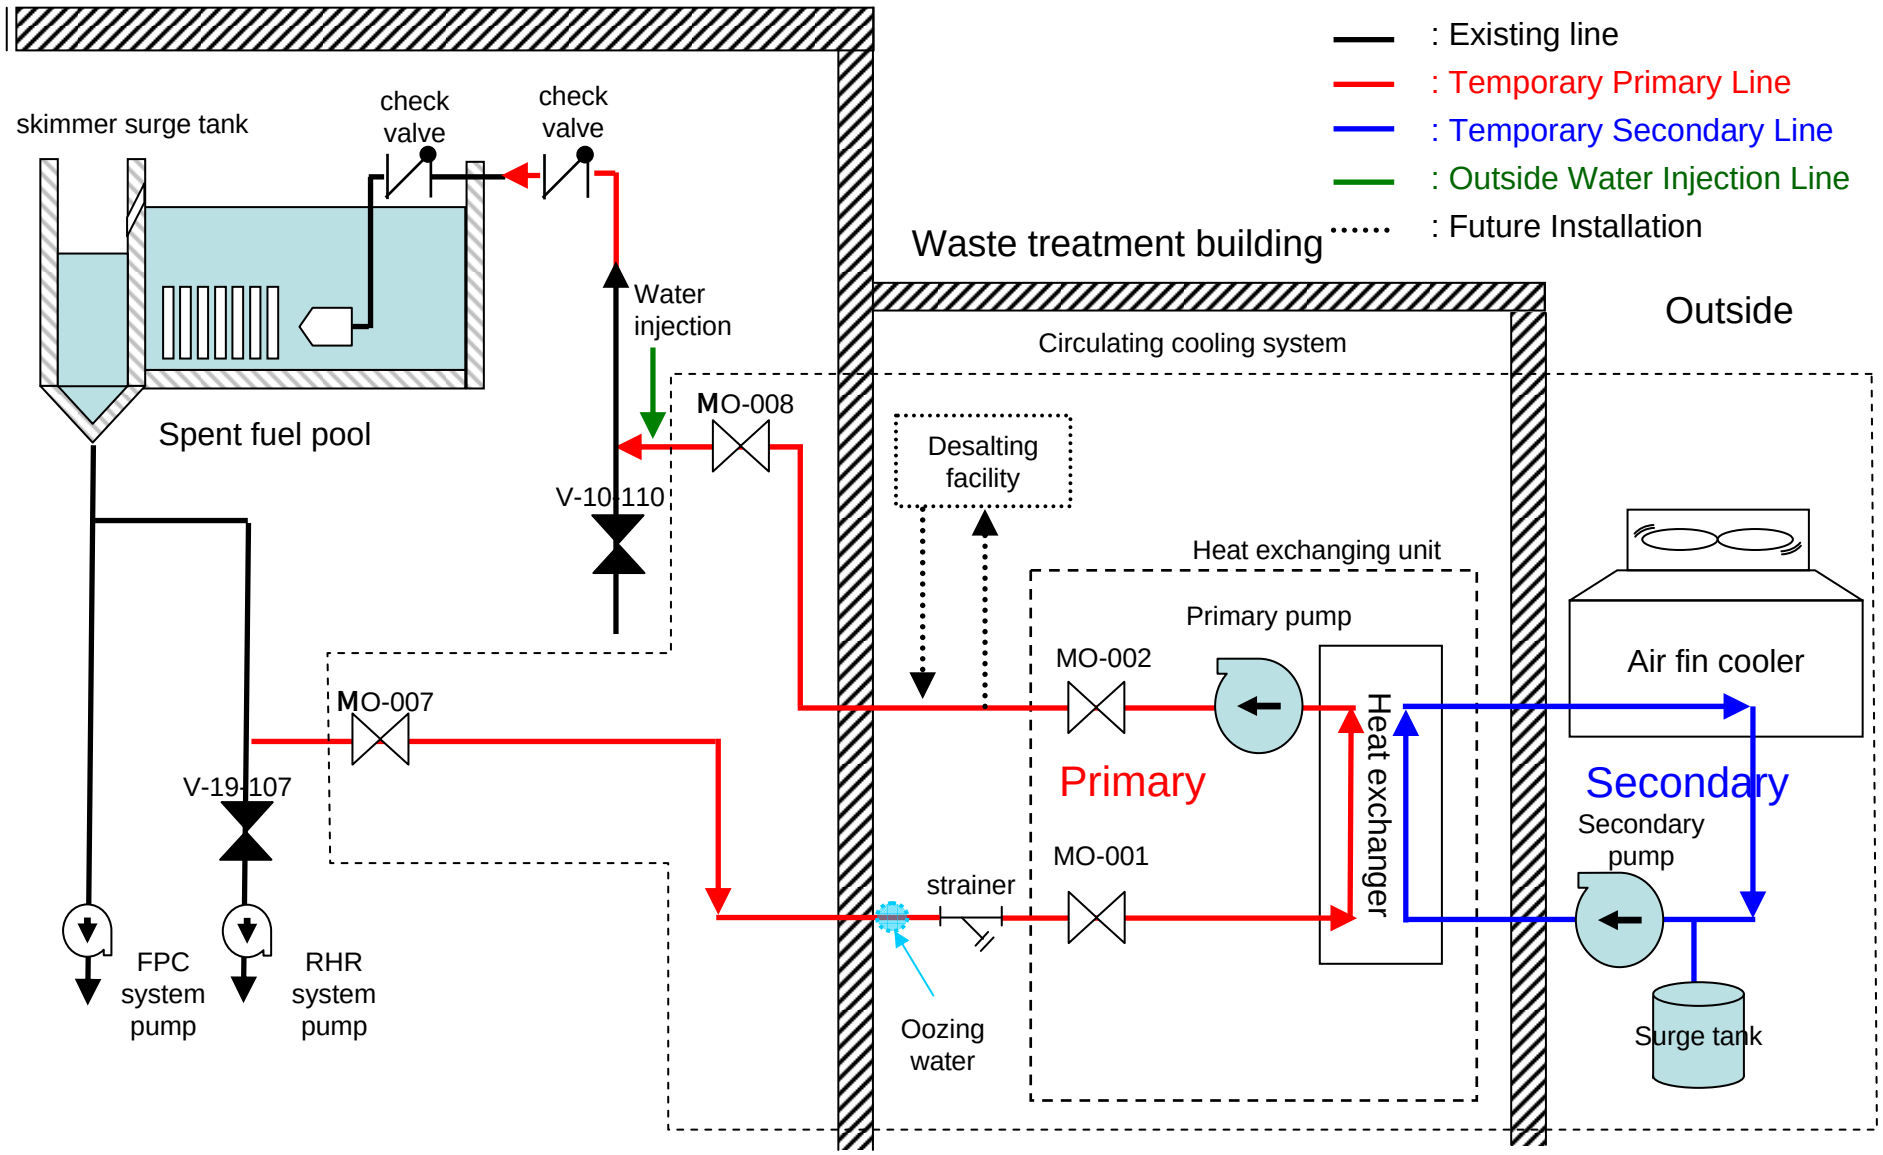
August 23, 2011
Tokyo Electric Power Company