


# Countermeasures against expansion of leakage between SPT(B) and Water Desalinations (reverse osmosis membrane)

April 9, 2012  
Tokyo Electric  
Power Company



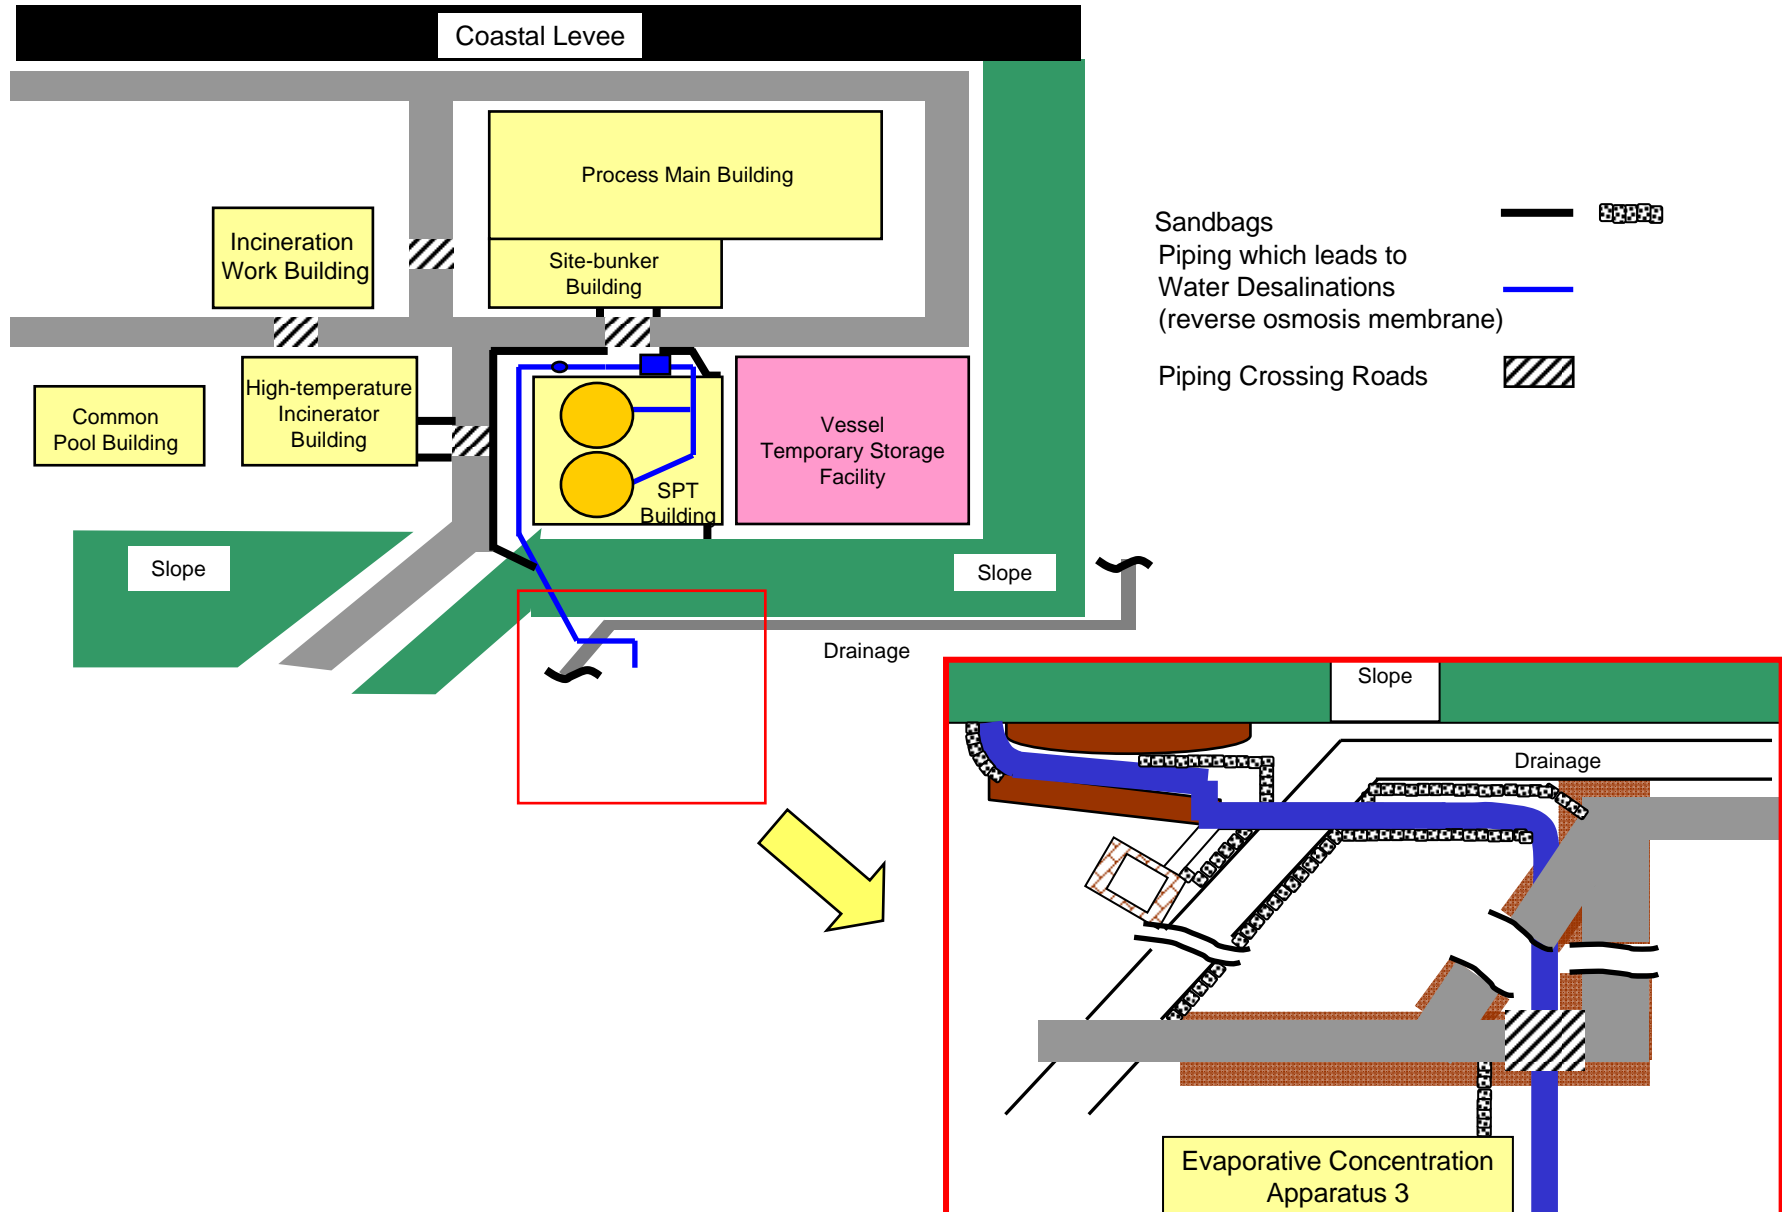

<Sandbags placed on the piping which crosses the road>



<Sandbags placed on the slope>



<Sandbags placed around the drainage>