Change of Water Level in the High Temperature Incinerator Building (HTIB)

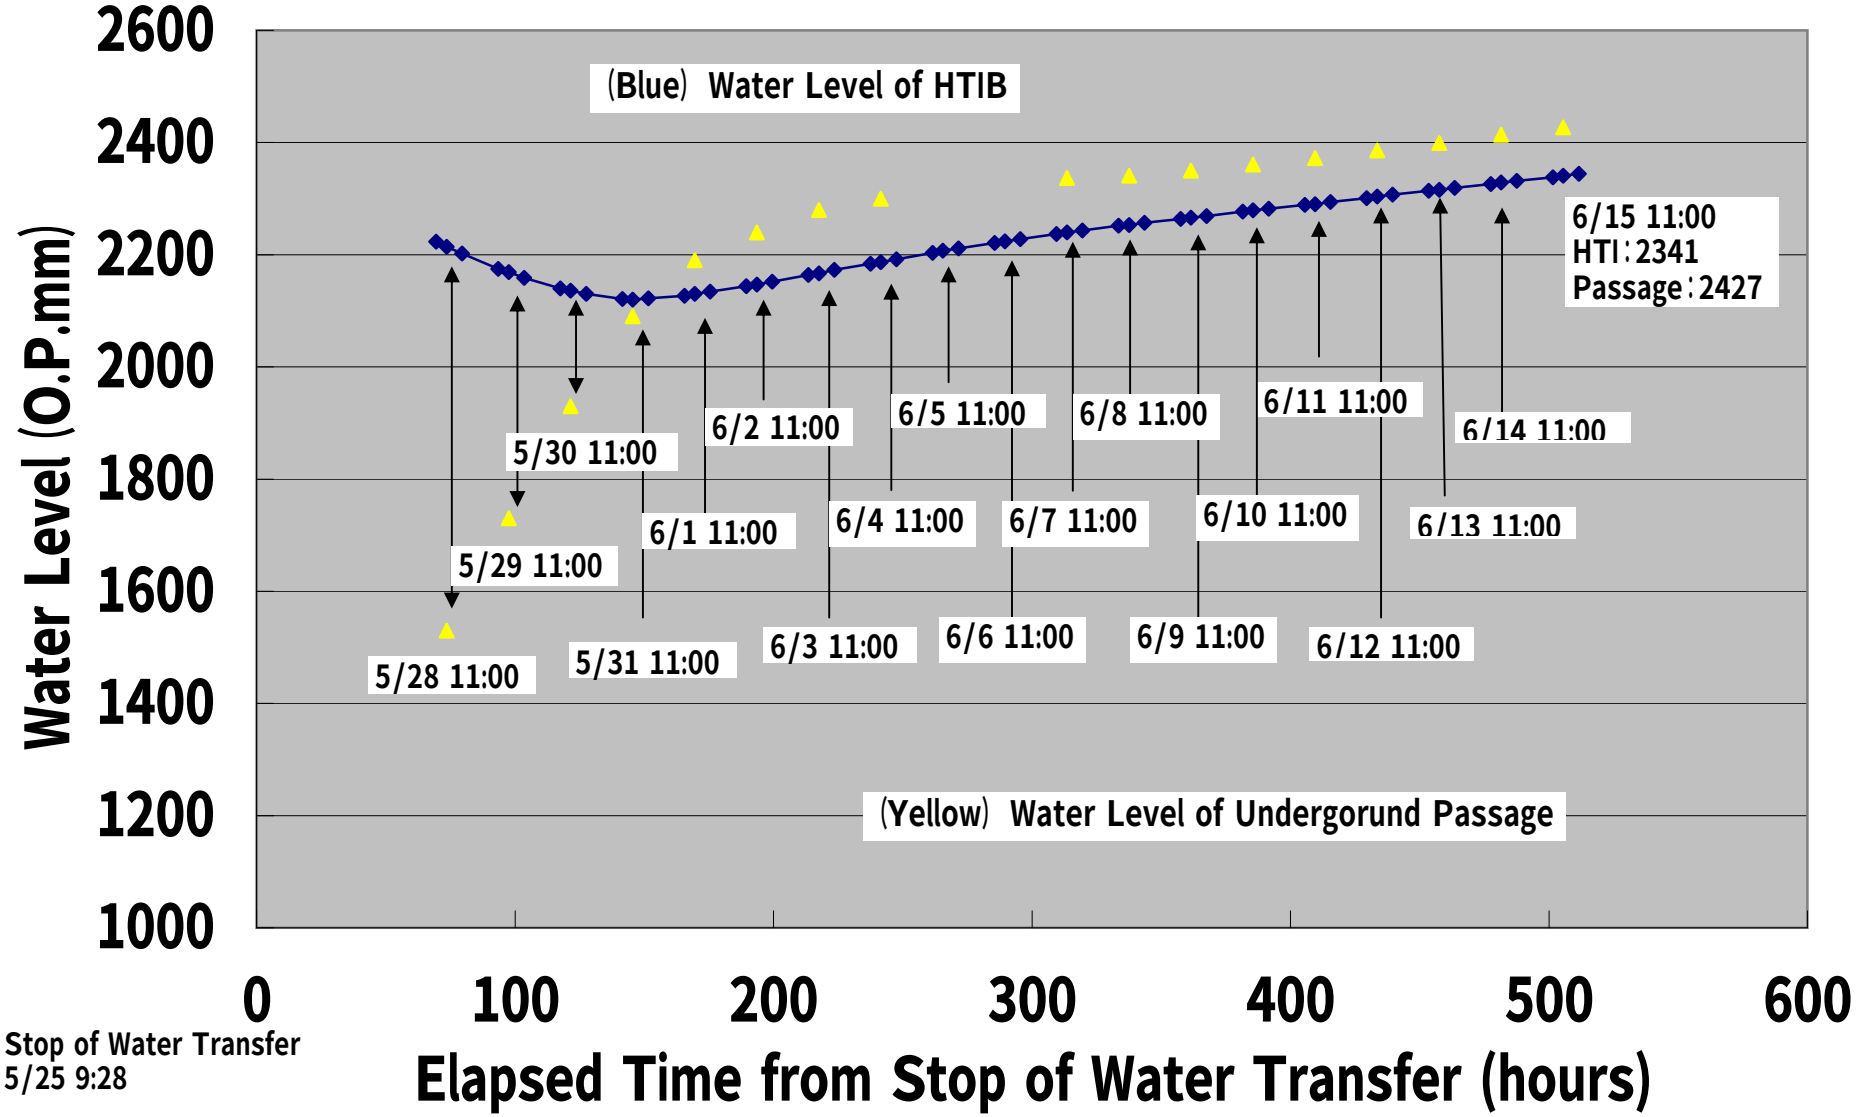

Stop of Water Transfer
5/25 9:28

Attachment-2