


Contamination by radioactive materials in piping arrangement room in the reactor building
(controlled area)

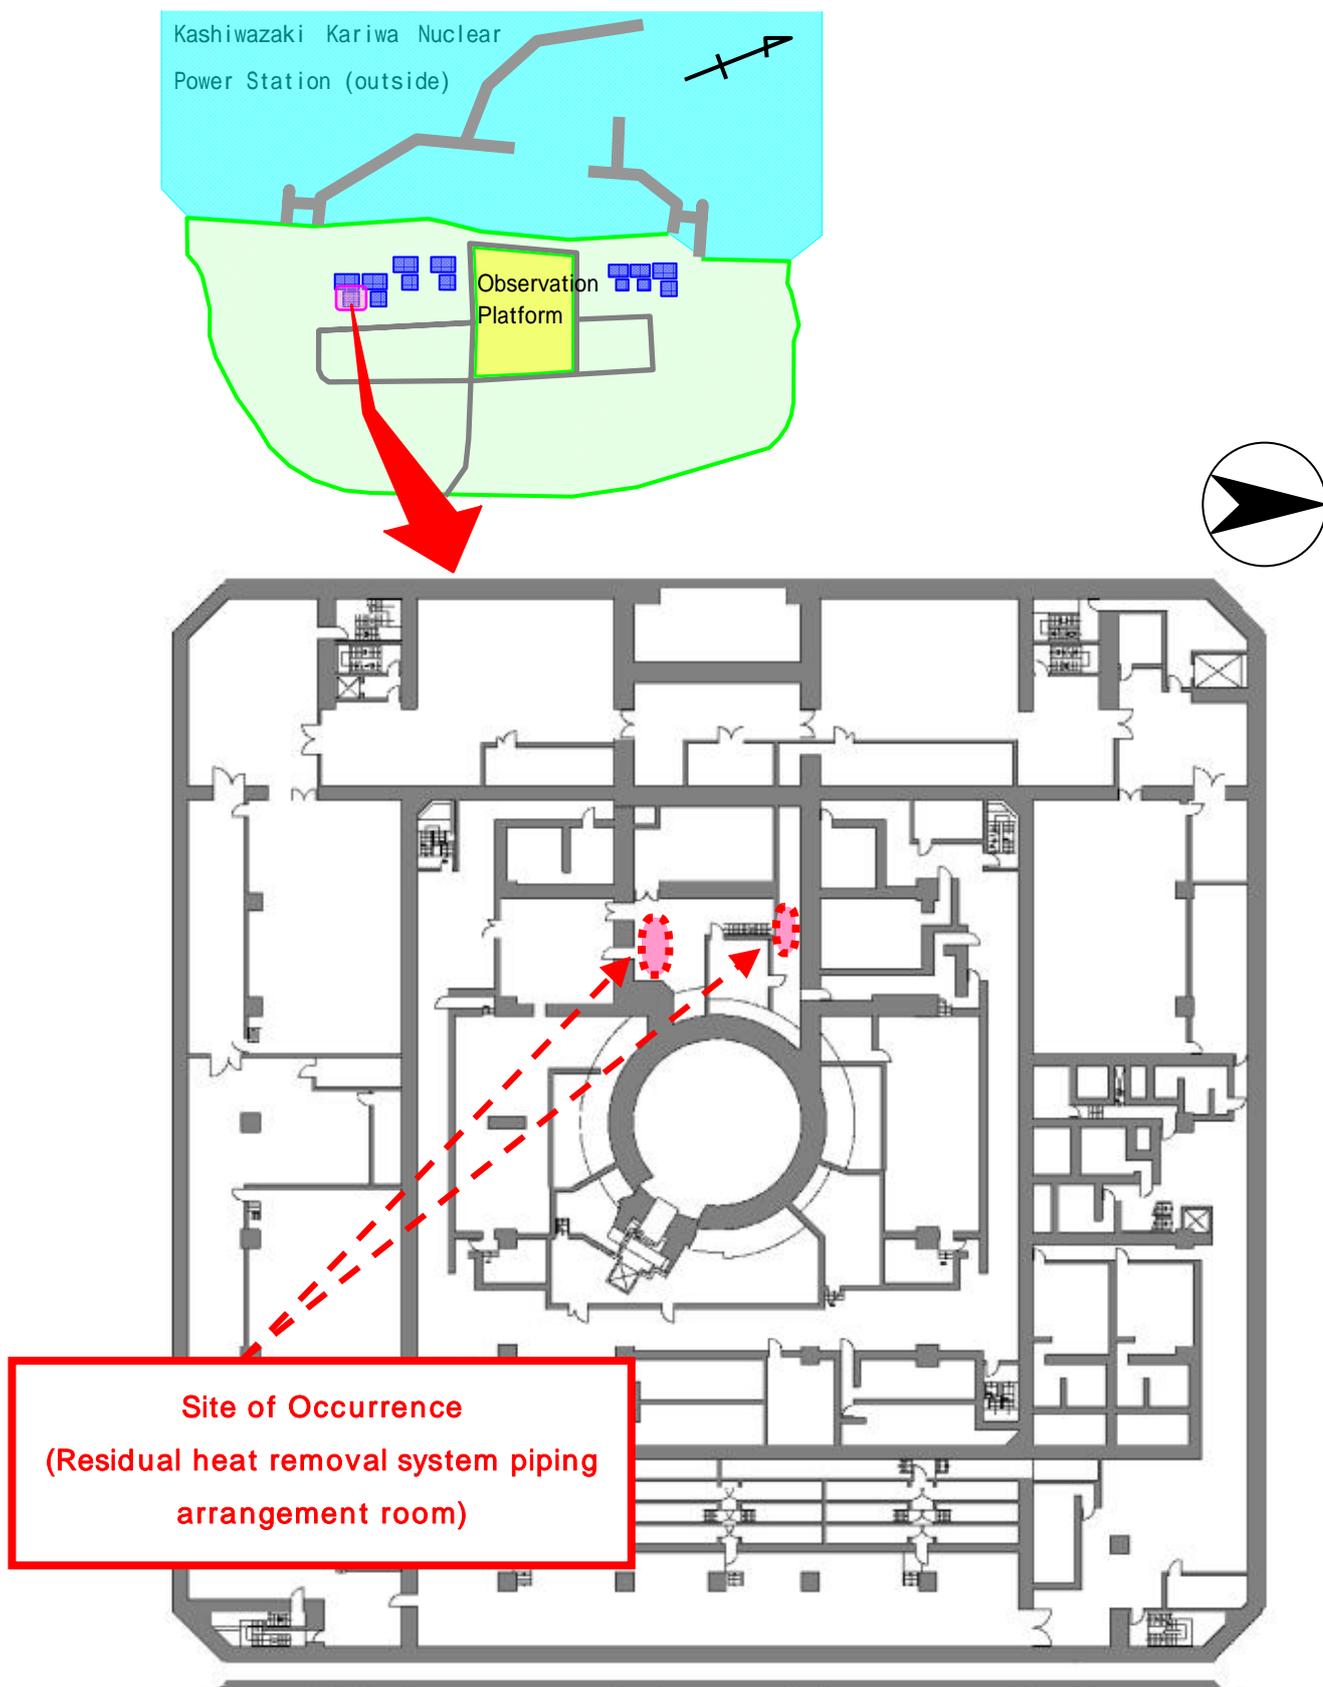

Kashiwazaki Kariwa Nuclear Power Station, Unit1 (First Basement Level)