


Plan Drawing of Circulating Cooling System Layout for Spent Fuel Pool of Unit4



Exterior of the Heat Exchanger in Heat Exchanger Unit

Exterior of the Air Cooled Heat Exchanger

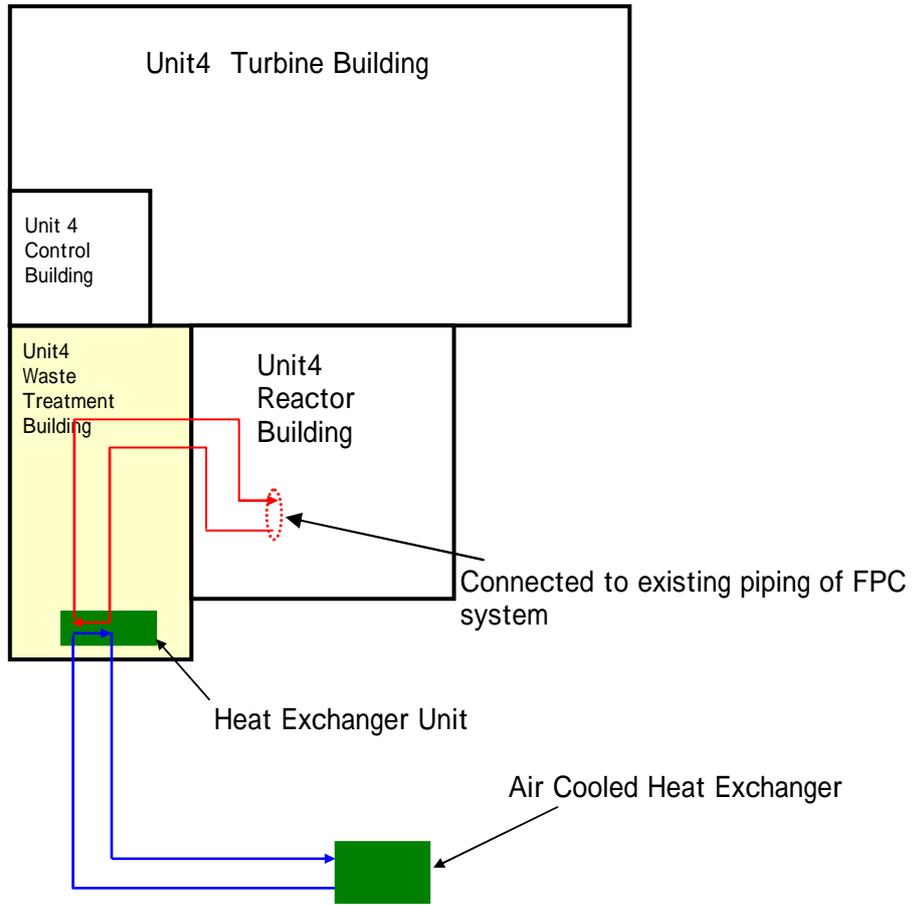